

*Chulalongkorn University
Bangkok, Thailand*

*CANDU Fuel Management
and Advanced Fuel Cycles:
Research at École Polytechnique*

by

D. Rozon


December 18, 1997

Institut de génie nucléaire
École Polytechnique
Montréal, QC
Canada H3C 3A7


Introduction

- Fuel Management (F/M) is essential for continued normal operation
 - changes in fuel composition with irradiation
 - fuel depletion leads to decline in potential reactivity of fuel
 - power distribution varies (slowly) with time, because burnup is not uniform
 - size of reactor core is minimized, to minimize capital costs (heavy water).
 - in a PWR, size of the pressure vessel is a similar issue
 - flux shape must be flattened to minimize peak fuel rating
- F/M objectives
 - select refueling to allow continued full power operation at minimal operating cost (fuelling costs)
 - in a PWR, batch refuelling with reactor shutdown (annual);
 - in CANDU, on-power refueling (daily)
 - satisfy safety margins
 - maintain power distribution close to nominal;
 - in CANDU, avoid ROPT trip
- F/M variables

	<i>CANDU</i>	<i>PWR</i>
<i>fuel element</i>	bundle (50 cm)	assembly (6 m)
<i>fresh fuel</i>	Nat U, SEU, MOX, DUPIC	SEU (3-4%), MOX
<i>axial F/M</i>	axial shuffling scheme	no (burnable poisons)
<i>radial F/M</i>	channel selection	assembly repositionning
<i>excess reactivity</i>	small	large (boron)

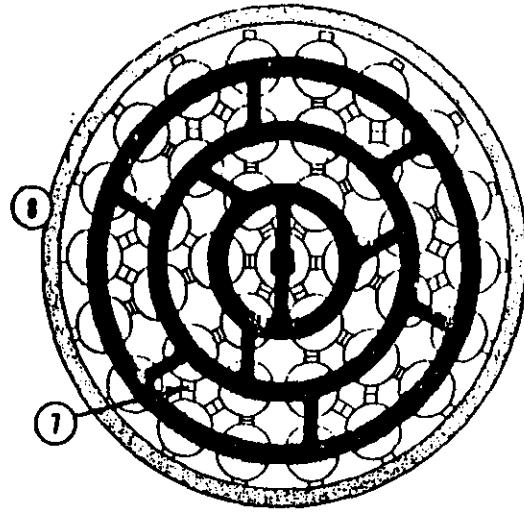

END VIEW INSIDE
PRESSURE TUBE

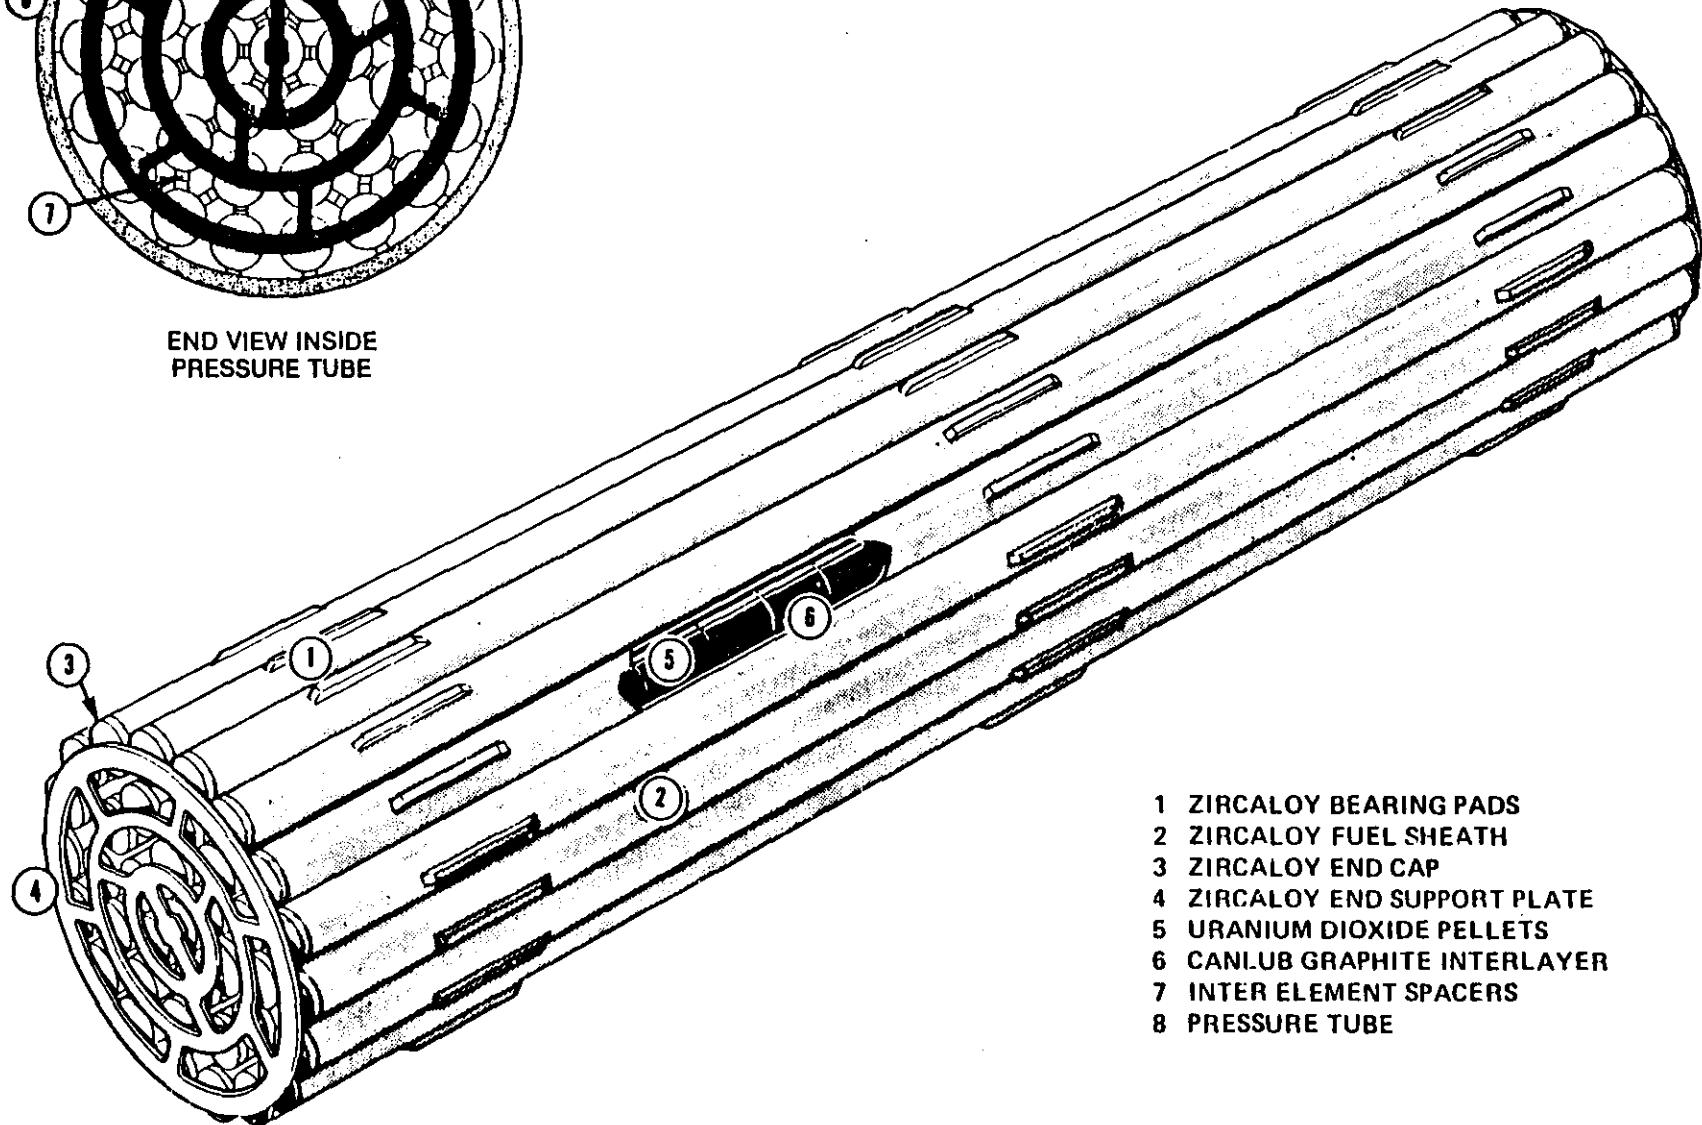

- 1 ZIRCALOY BEARING PADS
- 2 ZIRCALOY FUEL SHEATH
- 3 ZIRCALOY END CAP
- 4 ZIRCALOY END SUPPORT PLATE
- 5 URANIUM DIOXIDE PELLETS
- 6 CANLUB GRAPHITE INTERLAYER
- 7 INTER ELEMENT SPACERS
- 8 PRESSURE TUBE

FIGURE 2.6-1 37-ELEMENT FUEL BUNDLE

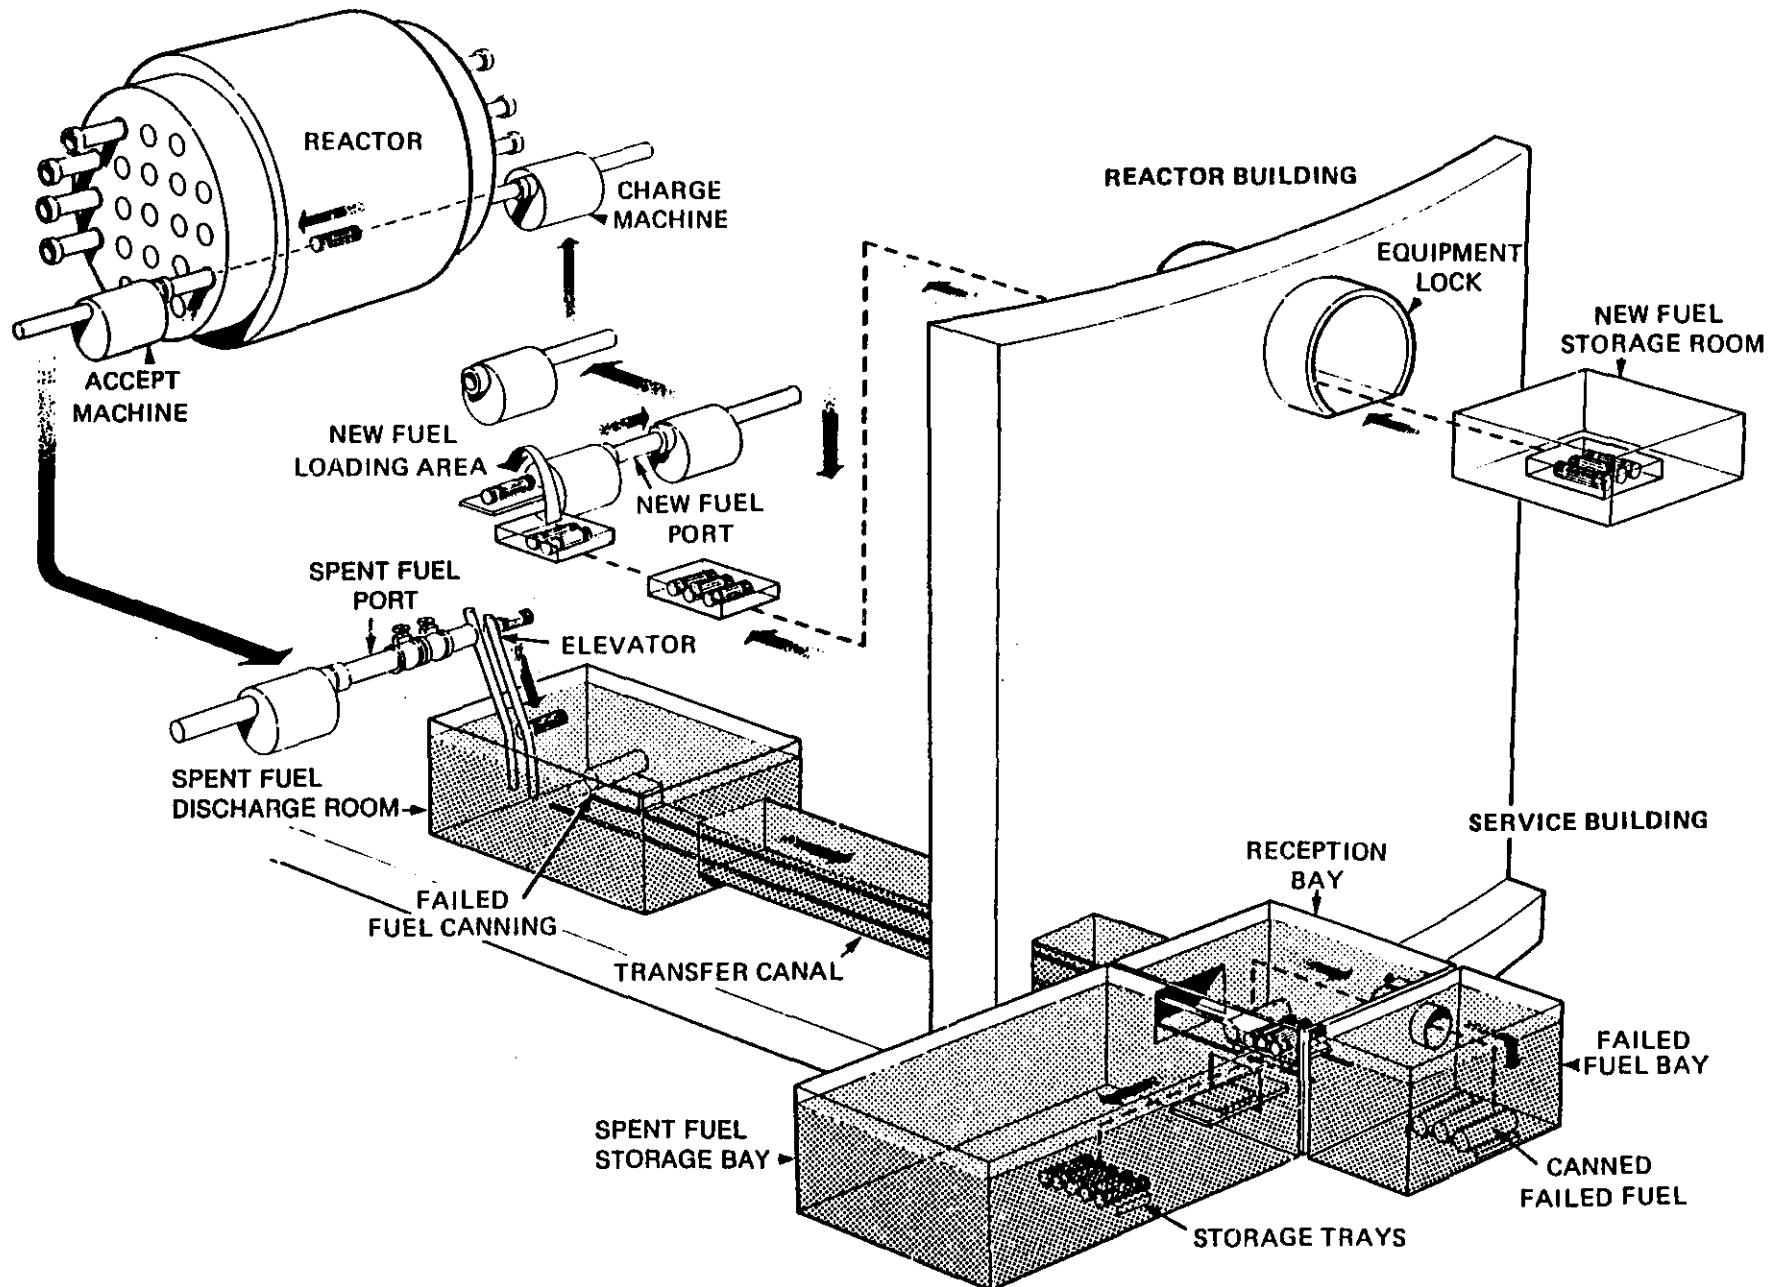


FIGURE 5.0-3 FUEL HANDLING SYSTEM SCHEMATIC

Fuel Management Research Topics

1. Computational Reactor Physics

- DRAGON
- DONJON

2. Generalized Perturbation Theory Applications

- core design (equilibrium refuelling)
- zone controller response to refuellings

3. Global Depletion Schemes


- feedback model for local parameters
- block depletion

4. Advanced Fuel Cycles in CANDU


- SEU, MOX vs. Natural Uranium
- DUPIC

1. Basic Concepts

Major Nuclear Reactions in Uranium-based Fuel

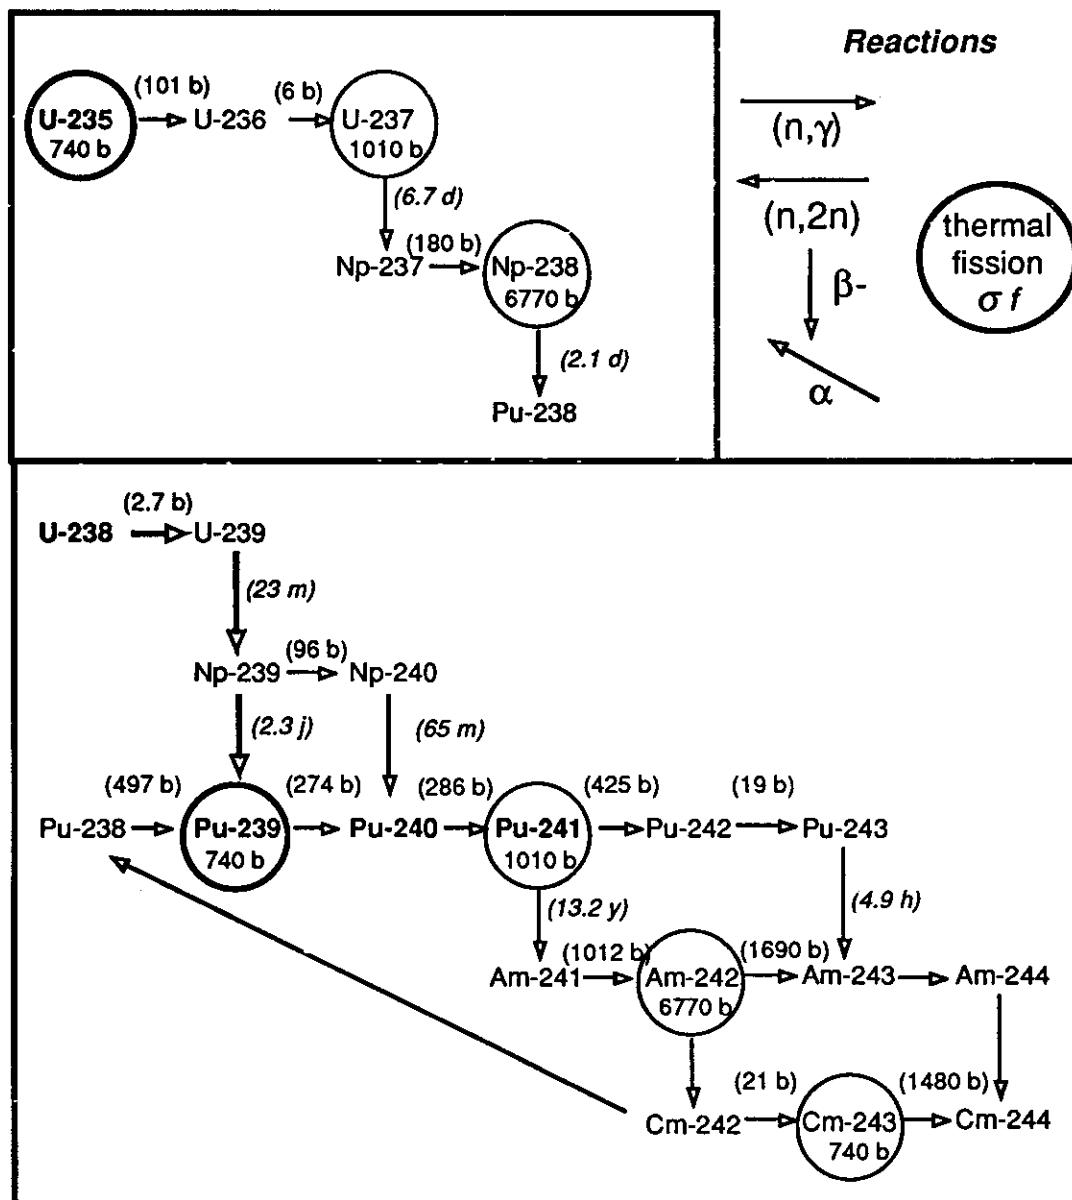


Cross Sections

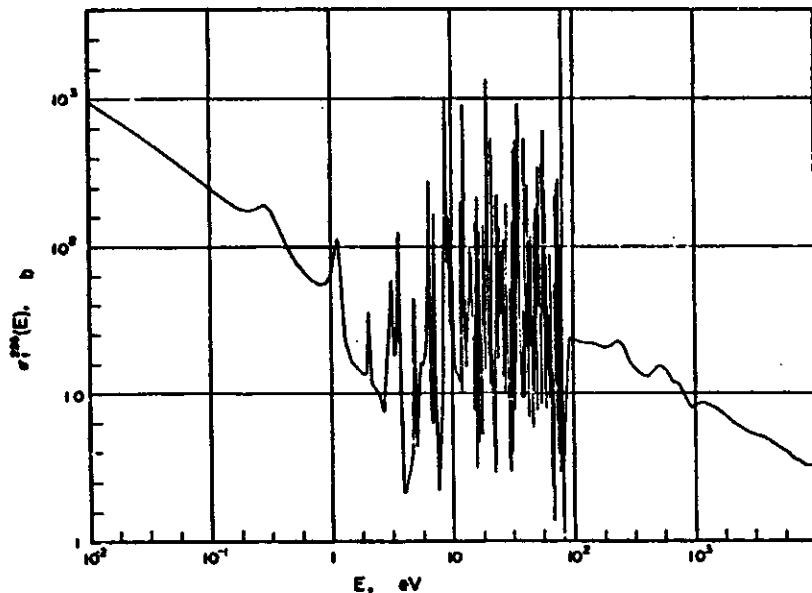

- Cross sections vary with neutron energy
 - Complex behaviour
 - Evaluated Nuclear Data Files (ENDF-B-5,...)
- Neutron energy spectrum:
 - fission neutrons average 1.2 MeV
 - thermal reactors (moderator): $20^\circ\text{C} \Rightarrow 0.0625 \text{ eV}$
 - CANDU: cold heavy water moderator (90% of volume), warm heavy water coolant in pressure tube (5% of volume)
 - PWR: warm light water moderator (coolant), occupies 65% of volume.
- Neutron flux distribution:
 - chain of reactor physics calculations required to determine the flux distribution (transport theory \Rightarrow diffusion theory)
 - reactor is highly heterogeneous (fuel channels/assemblies, rods, ...)

Fuel Depletion

- Transport theory calculation in unit cell of CANDU 600 (WIMS): depletion at constant power in bundle, at nominal local conditions:
 - exact (hot) geometry of bundle
 - initial fuel composition (natural uranium)
 - fuel density + temperature
 - coolant isotopes + density + temperature
 - moderator isotopes + density + temperature

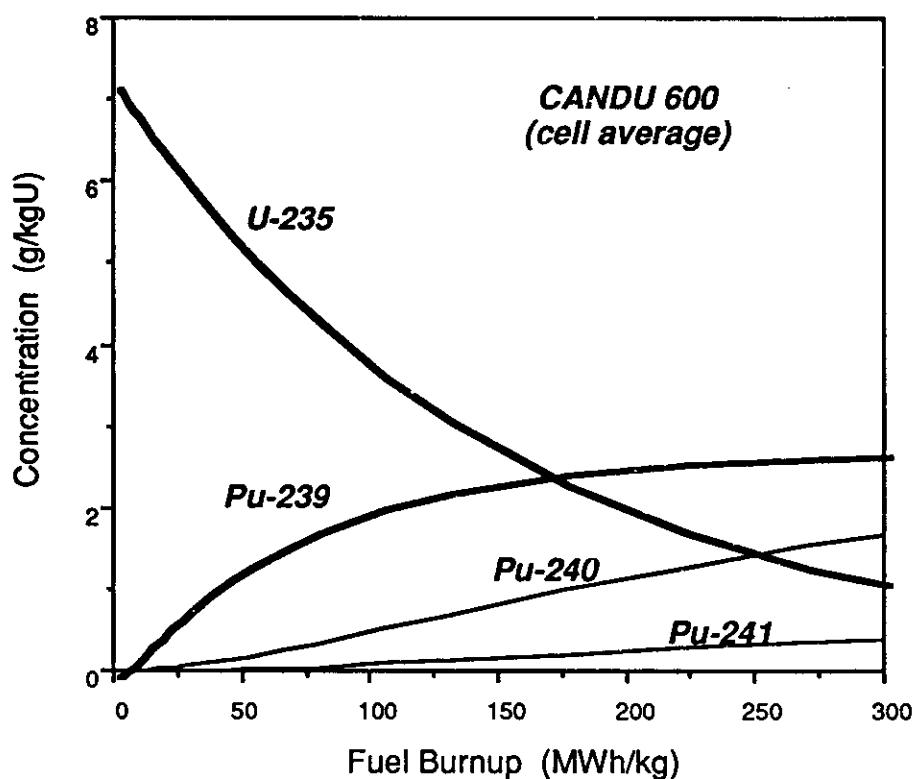

- Fuel burnup distribution is not uniform because neutron flux distribution is non-uniform.
- Significant change in cell multiplication factor (k_{∞}) with burnup.
- Fuel burnup distribution in reactor will affect the flux shape (i.e. problem is nonlinear)


Flux Flattening

- Typical safety limits CANDU 600:

- 8.3 MW (channel)
- 950 kW (bundle)


- homogeneous core:

$$\phi(r,z) = \phi_0 J_0\left(\frac{2.405}{R}r\right) \cos\left(\frac{\pi}{H}z\right)$$

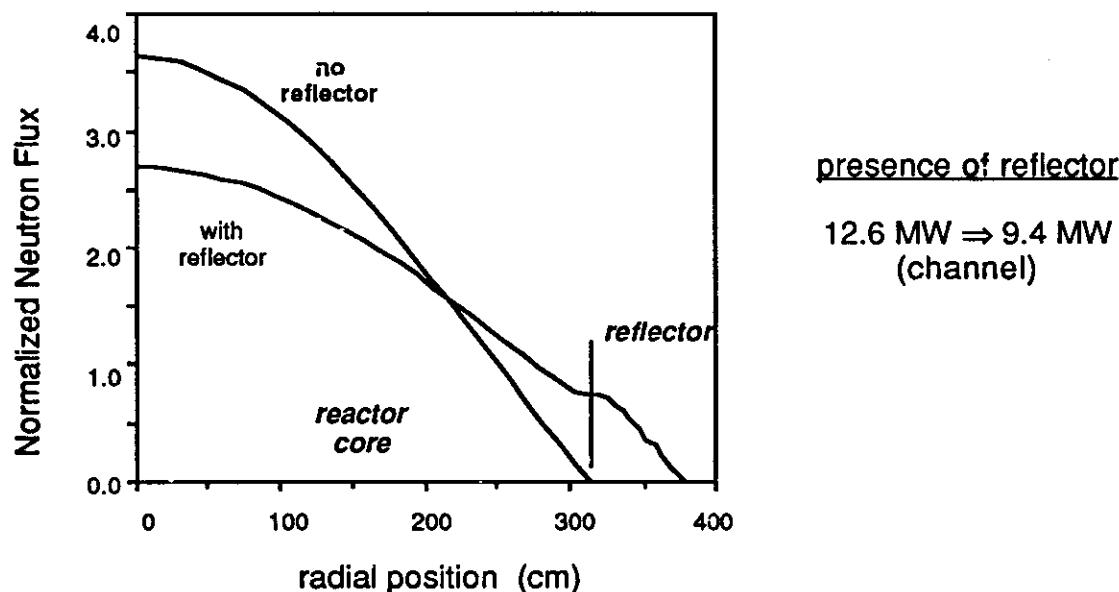


- heterogeneous core (2 zones); flattening due to:

- burnup difference (0.7): $9.4 \text{ MW} \Rightarrow 8.7 \text{ MW}$
- adjuster rods: $8.7 \text{ MW} \Rightarrow 6.4 \text{ MW}$

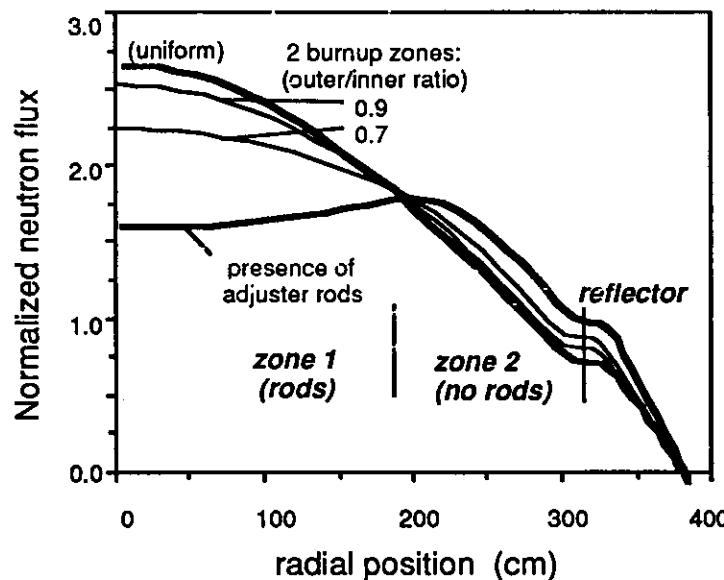

On-Power Refueling

- simple push-through axial shuffling scheme
 - Ex.: 4-bundle scheme (4BS), refueling with flow:

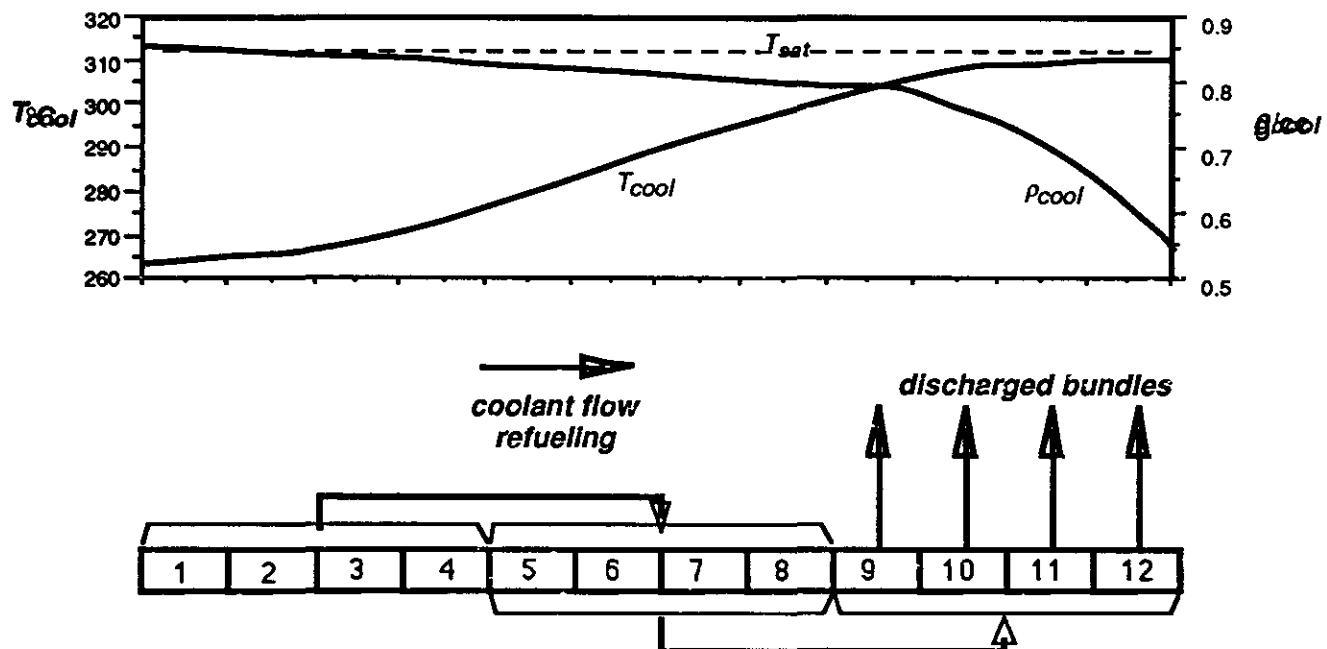

- local parameters of unit cells (bundles) change upon refueling, introducing a history effect in fuel depletion
 - distributed parameters along channel:
 - fuel temperature
 - coolant density
 - coolant temperature
 - axial distribution of neutron flux along channel is not known in unit cell (It is obtained from a separate diffusion theory calculation for the whole reactor)

Fuel Management Effects

- flow and refueling are *bi-directional* , i.e. alternating direction in neighbouring channels
- *fixed axial shuffling scheme* (uniform or in 2 radial zones)
- channel refueling frequency is *arbitrary*, but average fueling rate must compensate the reactivity decline due to fuel burnup in reactor, within the limits of the fuel handling system.
- a specific fuel management strategy has a characteristic effect on neutron flux and fission power distributions:
 - **zone control level response to refuelings**
 - **Channel Power Peaking Factor (CPPF)**, fuel management «ripple»
- an equilibrium refueling model (Time-Average) can be defined to predict fuel management effects

Equilibrium Refueling Model

- When a *fixed fuel management strategy* is applied over time, the refueling frequency eventually (6 months) becomes *constant* within regions of the core. A *refueling cycle* (period T_j) is thus defined in each channel j
- by definition, instantaneous channel power and bundle power vary around the *time-average* values: P_j and p_{jk} .
- at equilibrium refueling, local (bundle k) macroscopic cross sections are averaged over the refueling cycle (in channel j):

$$\Sigma_{jk} = \frac{1}{\Delta B_{jk}} \int_{B_{jk}^{(BOC)}}^{B_{jk}^{(EOC)}} \Sigma(\theta) d\theta$$

- the bundle burnup increment during the cycle is simply:

$$\begin{aligned}\Delta B_{jk} &= B_{jk}^{(EOC)} - B_{jk}^{(BOC)} \\ &= p_{jk} \cdot T_j\end{aligned}$$

- the energy produced in channel j during the cycle:

$$\begin{aligned}E_j &= P_j \cdot T_j \\ &= n_j \cdot B_j\end{aligned}$$

where B_j is the average exit burnup (in MWd/TeU) and n_j is the number of bundles removed at each refueling (axial bundle shift);

- therefore:


$$\begin{aligned}\Delta B_{jk} &= B_{jk}^{(EOC)} - B_{jk}^{(BOC)} \\ &= n_j B_j \psi_{jk}\end{aligned}$$

where ψ_{jk} is the *axial power (flux) shape*

$$\psi_{jk}(\phi) = \frac{p_{jk}}{P_j} = \frac{\text{bundle power}}{\text{channel power}}$$

- the T/A procedure is *nonlinear*

Time-Average Procedure in Reactor Calculation

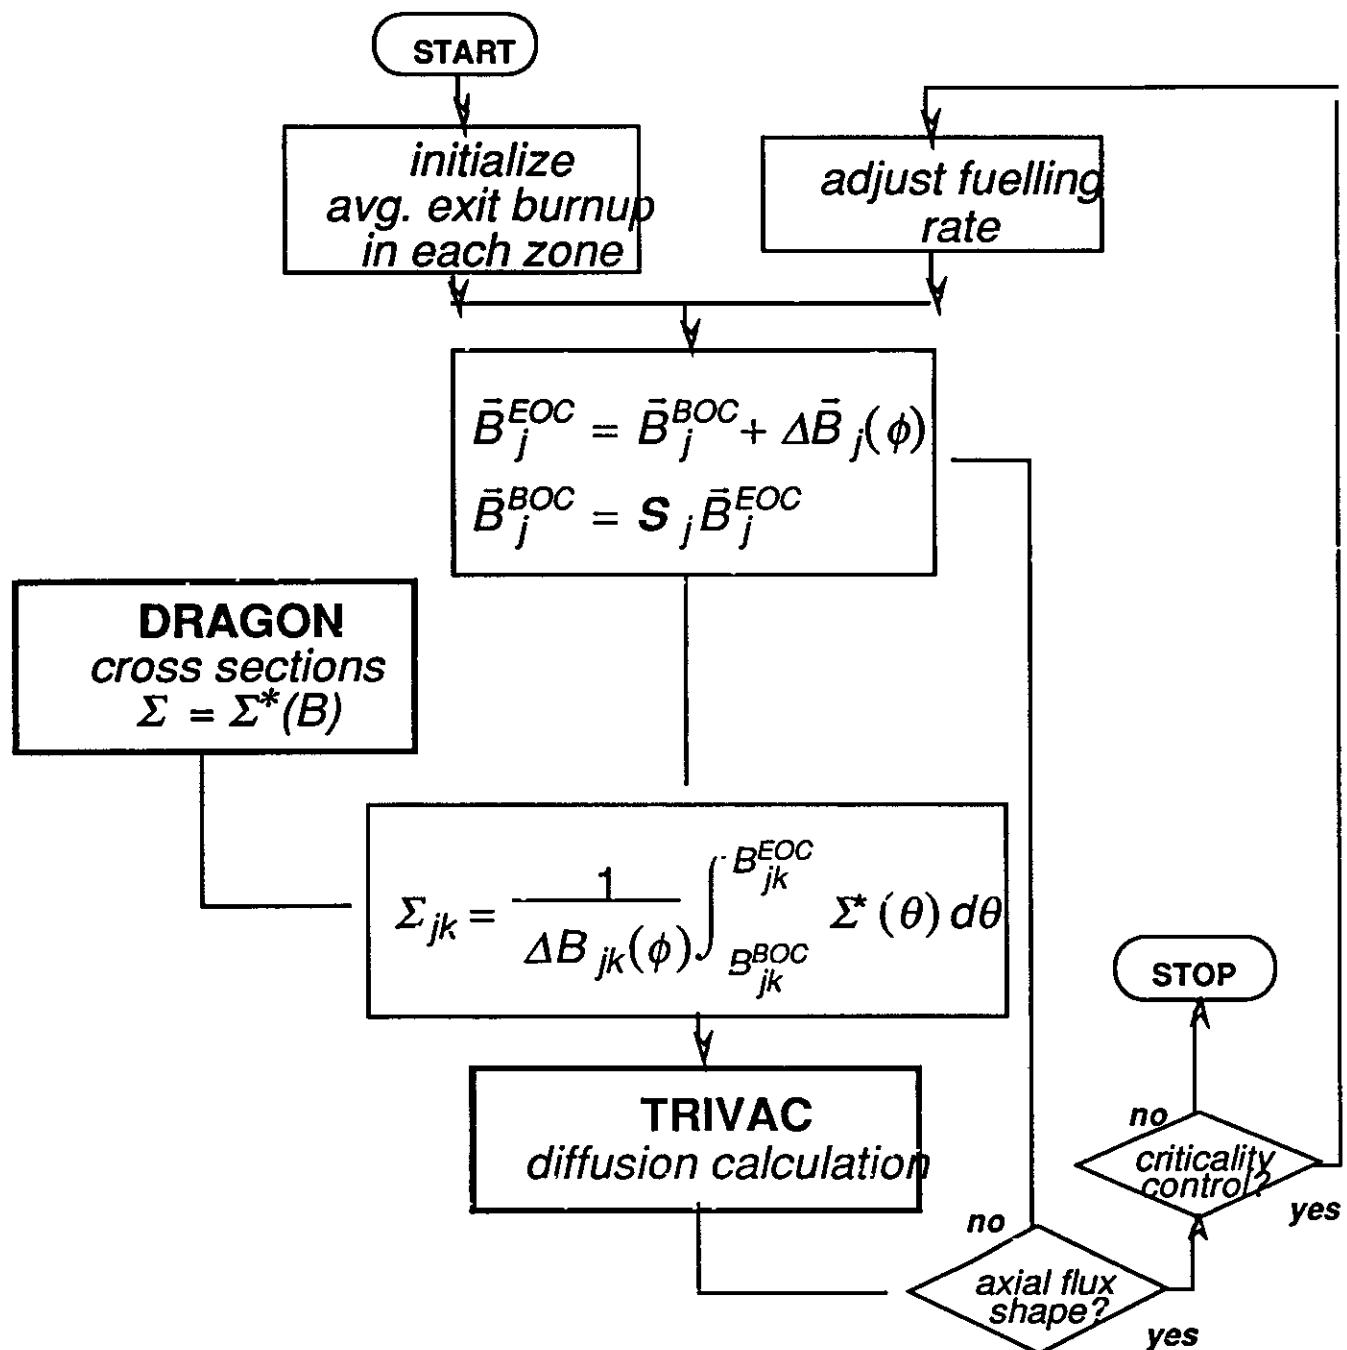

Instantaneous Power Distribution

- *power limits* on fuel must never be exceeded (instantaneous power distribution)
- due to fuel depletion, refuelings and controller movements, actual *channel and bundle power varies with time*;
- *peak channel and bundle powers* are necessarily *higher* than the maximum T/A values;
- any realistic instantaneous power distribution shows a «*fuel management ripple*»:
 - function of the refueling perturbation
 - *bundle shift* (fraction of channel refueled)
 - *fresh fuel enrichment* (fissile isotopes)
 - *average exit burnup* (fuel depletion)
- channel «age» model:
 - an instantaneous value of burnup can be assigned to each bundle:

$$B_{jk}(t) = B_{jk}^{BOC} + f_j(t) \cdot \Delta B_{jk}(\phi_{T/A})$$

where $f_j(t)$ is the «age» of channel j ($0 < f_j < 1$)

- the distribution of $f_j(t)$ must reflect a *refueling sequence*
- diffusion calculation with $\Sigma(B_{jk})$ yields an *instantaneous power distribution*, $P_j(t)$

Channel Power Peaking Factor (CPPF)


- definition:

maximum ratio of instantaneous to T/A channel power

$$CPPF(t) = \max_j \left\{ \frac{P_j(t)}{\bar{P}_j} \right\}$$

- for current CANDU's, CPPF < 1.15
- varies according to actual *refueling history* in operating reactor
 - axial bundle shift
 - initial enrichment
 - exit burnup
 - refueling sequence
- must be evaluated for ROPT recalibration during operation (for continued protection against dryout)
- must be evaluated during design (to verify safety margins)

Instantaneous vs Time-Average Power Distributions

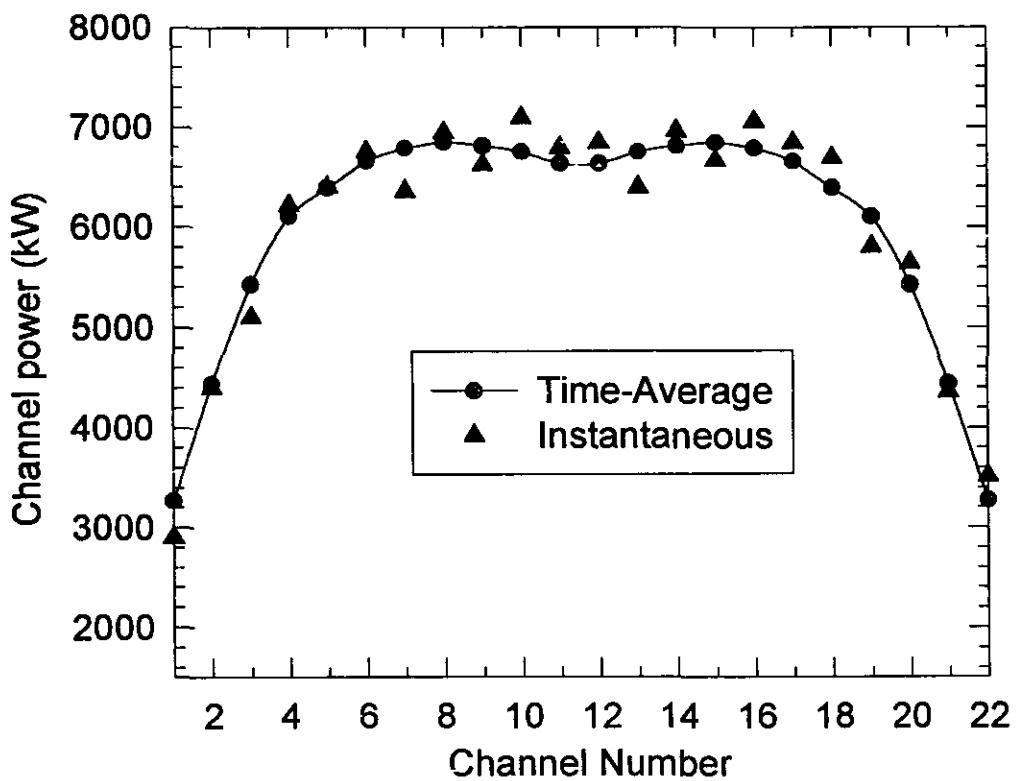


**Radial Channel Power Profiles
(NAT. U, 8BS, Row L)**


2- Reactor Physics Analysis of CANDU Reactors

- A complete suite of reactor physics codes must be used to analyse the fuel management behaviour of a reactor, dealing successfully with:
 - heterogeneity of materials
 - variety and complexity of neutron cross sections
 - neutron transport and streaming
 - temperature feedback
 - radioactive decay...
- This is achieved through a breakdown of the task at two levels, carrying out separate lattice and reactor calculations for the neutron field:
 1. Using an appropriate microscopic cross section library, the transport code DRAGON solves the integral transport theory equation over an infinite lattice of unit cells (in 2D) and various supercells (in 3D), using many neutron energy groups;
 2. Knowledge of the detailed flux within these cells allows DRAGON to homogenize the macroscopic cross sections over the cells (bundles), and to condense the nuclear properties down to a few energy groups (usually 2);
 3. Reactor code DONJON can access the data tabulated by DRAGON to construct a diffusion theory model of the entire reactor, including fuel shuffling and control rod motion. The 3D multigroup diffusion module TRIVAC can solve for direct, adjoint, generalized adjoint and harmonic flux distributions in cartesian and hexagonal geometries.
 4. Fuel management needs to predict fuel burnup accurately. Because of the separation in the nuclide field, separate cell depletion and global depletion calculations are required, with an inherent difficulty in dealing with the distributed local parameters.

Separate Lattice and Core Calculations

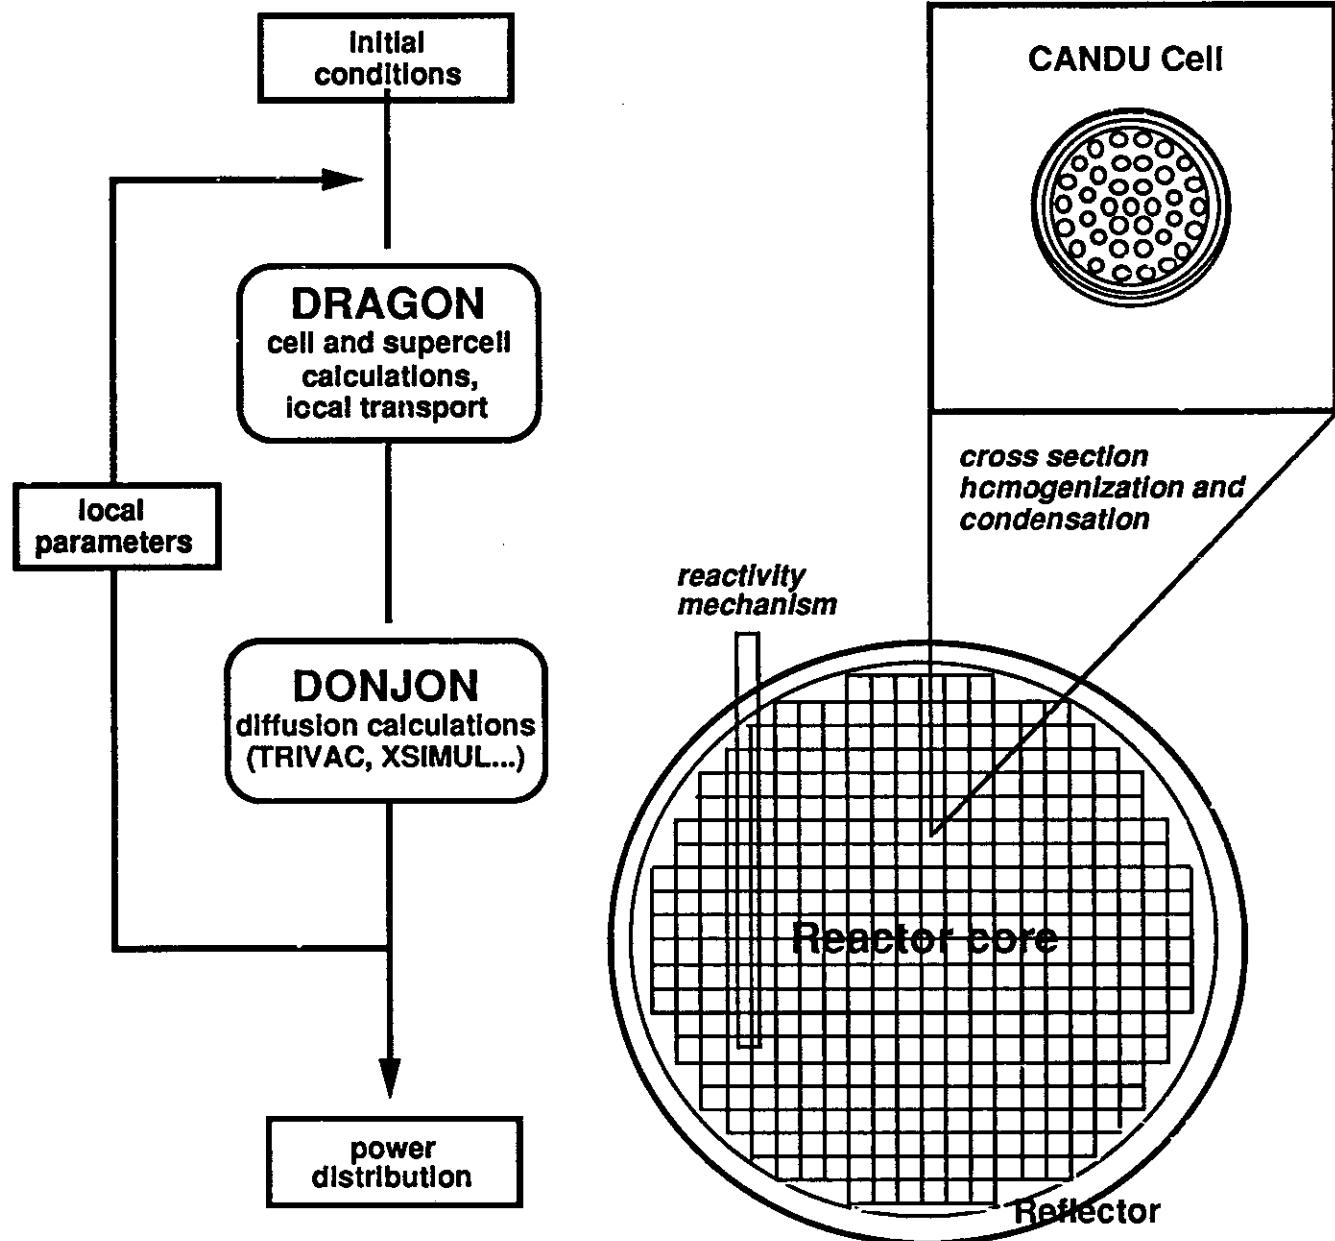


Chaining of Cross Section Processing Codes

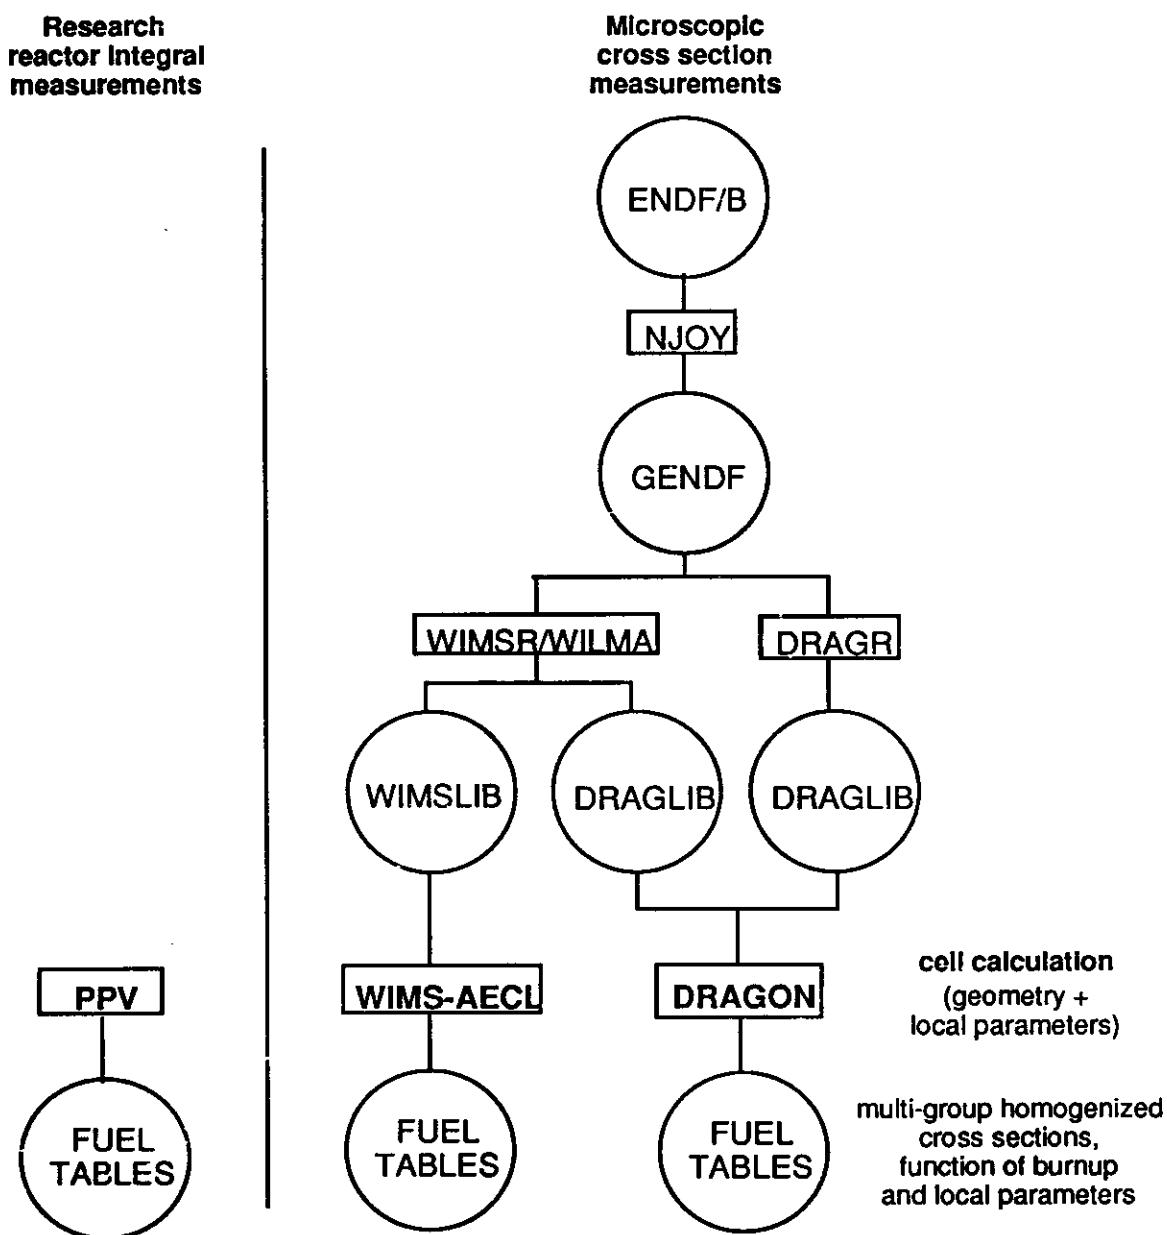


CLE-2000 language, GAN driver


Reactor Physics Chain of Codes at Polytechnique

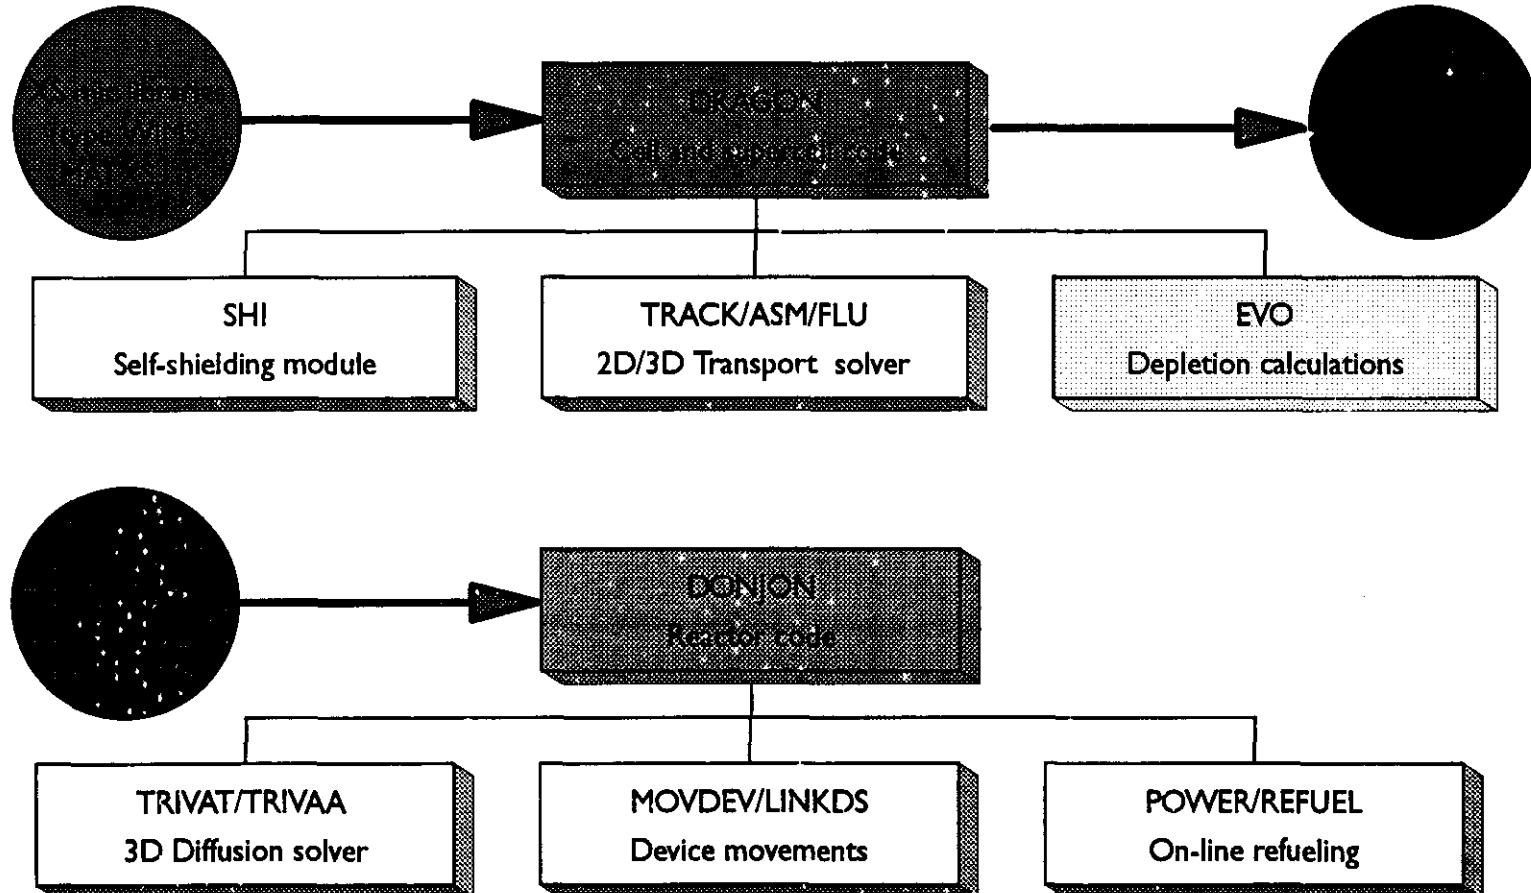

DRAGON Transport Code

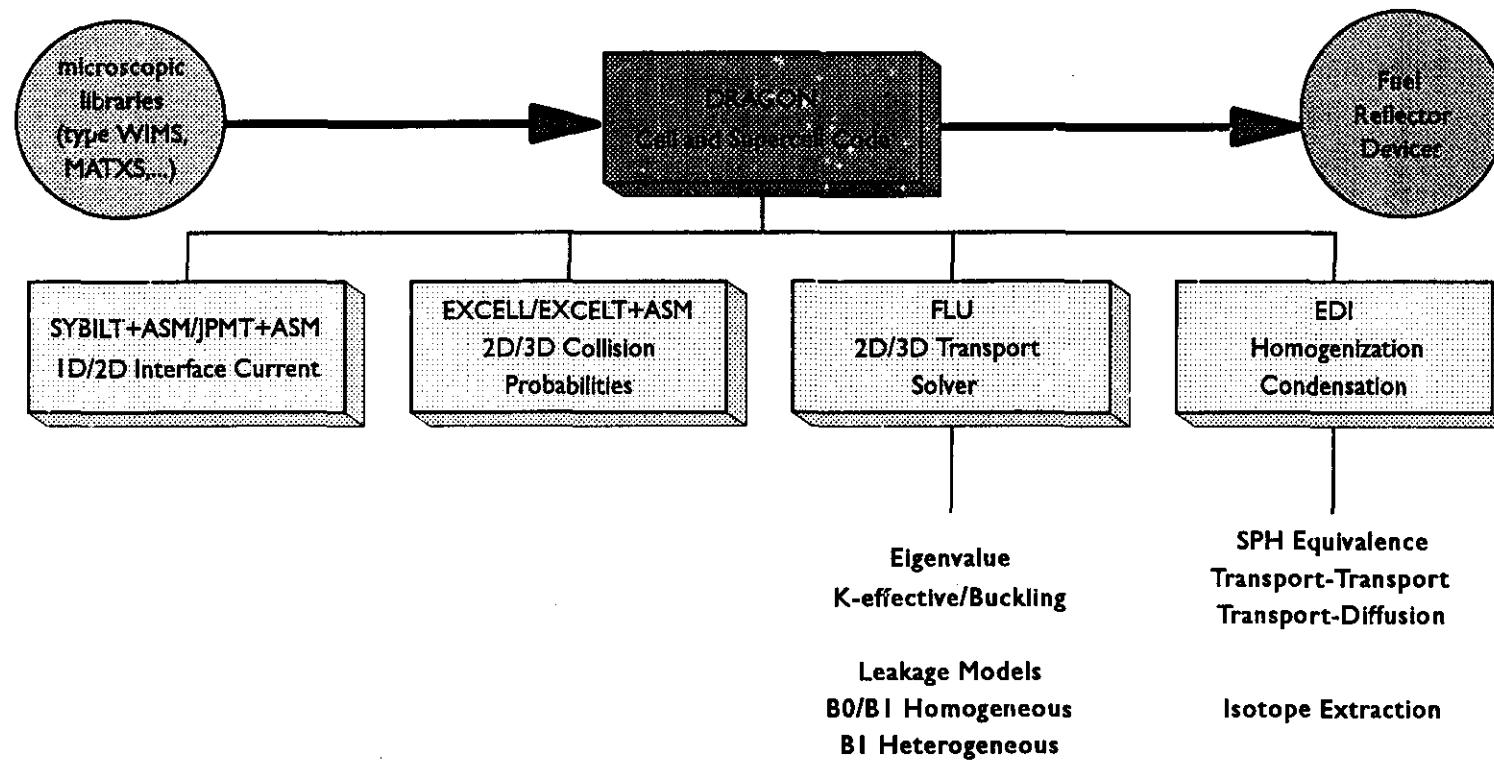


DONJON Diffusion Code

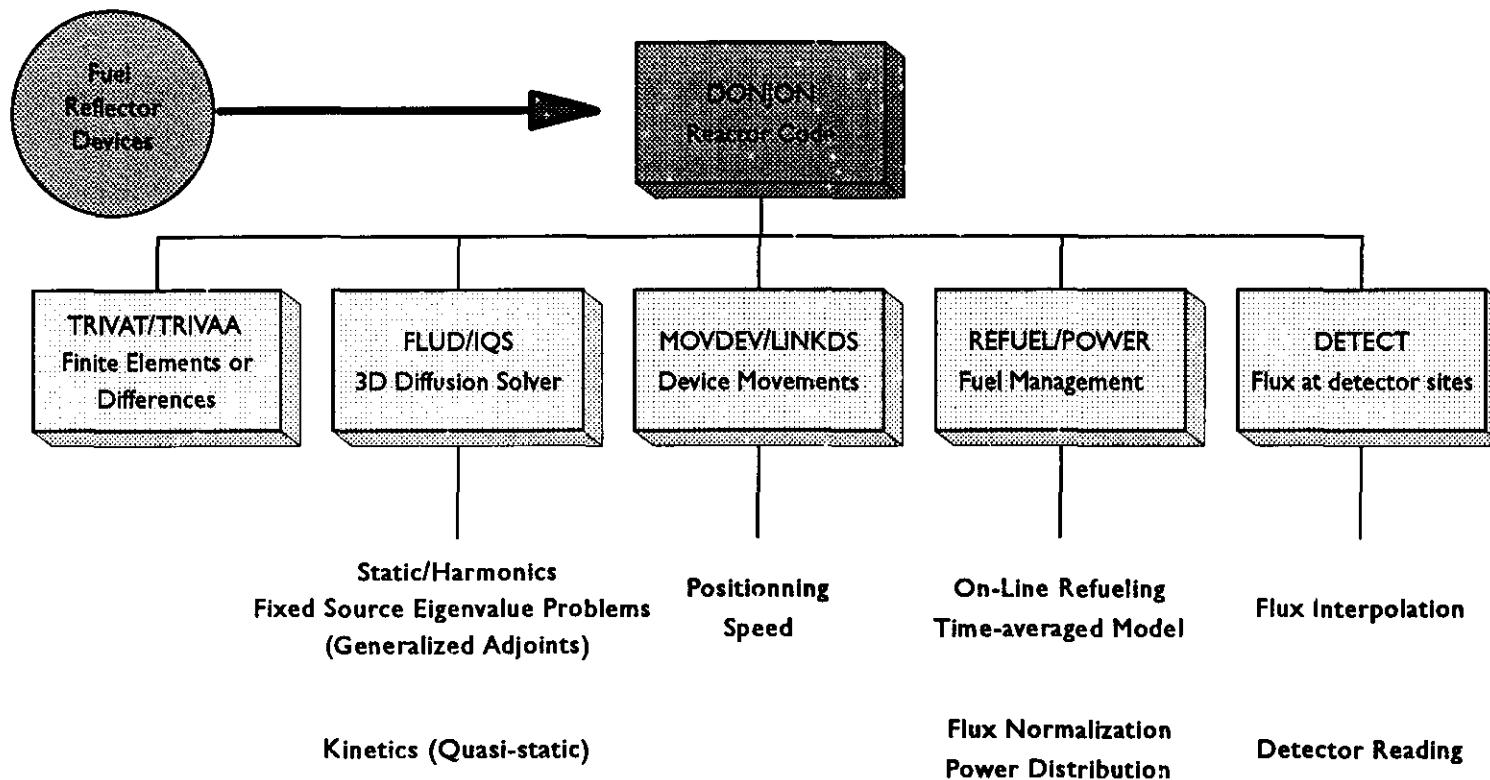


DRAGON Macroscopic Cross Sections

- CANDU Cell Calculations (2D)
 - Bundle Local Parameters
 - Self-Shielding
 - Flux Calculation with Critical Buckling Search
 - Depletion Calculations
 - Condensation/Homogenization

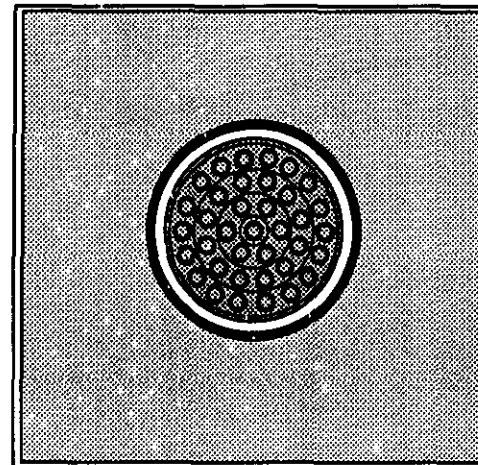

DRAGON Macroscopic Cross Sections (next)

- Supercell Calculations (3D)
 - Multigroup Properties
 - 3D Geometry for Devices
 - Flux Calculation with Critical Buckling Search
 - Condensation/homogenization

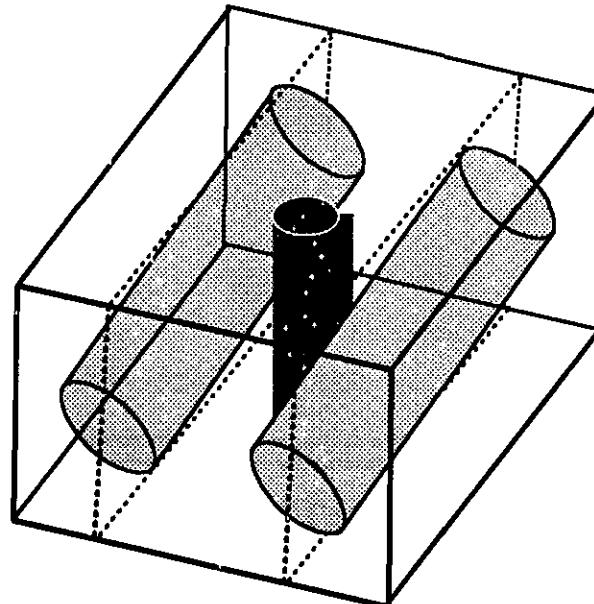

3. Generalized Perturbation Theory (GPT)

- GPT is widely used in LWR Fuel Management Analysis
 - first and second order estimates of system characteristics (arbitrary flux functionals)
 - optimization of reload patterns
 - usually 2D analysis
- Use of GPT in CANDU
 - developped at École Polytechnique
 - 1992: application of first order GPT in 3D to simultaneous optimization of adjuster layout and equilibrium refuelling in OPTEX-4 (core design)
 - 1997: prediction of zone controller level response to refuelling perturbations in DONJON (selection of refuelling sites)
- Future Application
 - advanced fuel cycles evaluation, uncertainty due to heterogeneity effect in DUPIC, optimization of refuelling sequence.

Generalized Adjoints

- Examples of flux functionals

- zonal power (ratio) in zone ℓ

$$p_\ell(\bar{X}, \phi) = \frac{\langle H, \phi \rangle_{V_\ell}}{\langle H, \phi \rangle_B}$$

fuelling costs

$$F(\bar{X}, \phi) = \frac{\langle CH, \phi \rangle}{\langle H, \phi \rangle}$$

where \bar{X} is a state vector (enrichment, exit burnup, poisons, ...). H , C , B are functions of \bar{X} .

- Unperturbed Flux Distribution (diffusion equation)

$$M\phi_0 = \lambda F\phi_0$$

- Perturbations in channel (or zone) j

- if $\Delta M(j)$ and $\Delta F(j)$ are changes in diffusion equation operators due a perturbation in region j (ex. refuelling), the zone power response zone ℓ is:

$$\Delta p_\ell^{(j)} = \Delta p_\ell^{(j)}\Big|_{A\Sigma} + \Delta p_\ell^{(j)}\Big|_{A\phi}$$

where

$$\left. \Delta p_\ell^{(j)} \right|_{\Delta\Sigma} = \frac{\langle \Delta H^{(j)}, \phi_o \rangle_{V_\ell}}{\langle H, \phi_o \rangle_B} - p_\ell \frac{\langle \Delta H^{(j)}, \phi_o \rangle_R}{\langle H, \phi_o \rangle_B}$$

and

$$\Delta p_\ell^{(j)} \Big|_{\Delta \phi} = - \left\langle \Gamma_\ell^*, \left(\Delta M^{(j)} - \lambda_o \Delta F^{(j)} \right) \phi_o \right\rangle$$

Generalized Adjoint Equation

- Generalized Adjoint is solution to the fixed source eigenvalue problem:

$$(M_o^* - \lambda_o F_o^*) \Gamma_\ell^* = S_\ell^*$$

where


$$S_\ell^* = \frac{\partial p_\ell}{\partial \phi}(\bar{r}) = \frac{[\delta V_\ell - p_\ell] H_o(\bar{r})}{\langle H, \phi_o \rangle_R}$$

- Orthogonality condition:

$$\langle \Gamma_\ell^*, F_o \phi_o \rangle_R = 0$$

- Arbitrary variations of flux functionals can be obtained using unperturbed flux only.
 - application with mathematical programming to solve reactor design optimization problem (OPTEX-4)
 - response of Liquid Zone Controllers to refuelling perturbations


NLP Algorithm in OPTEX-4

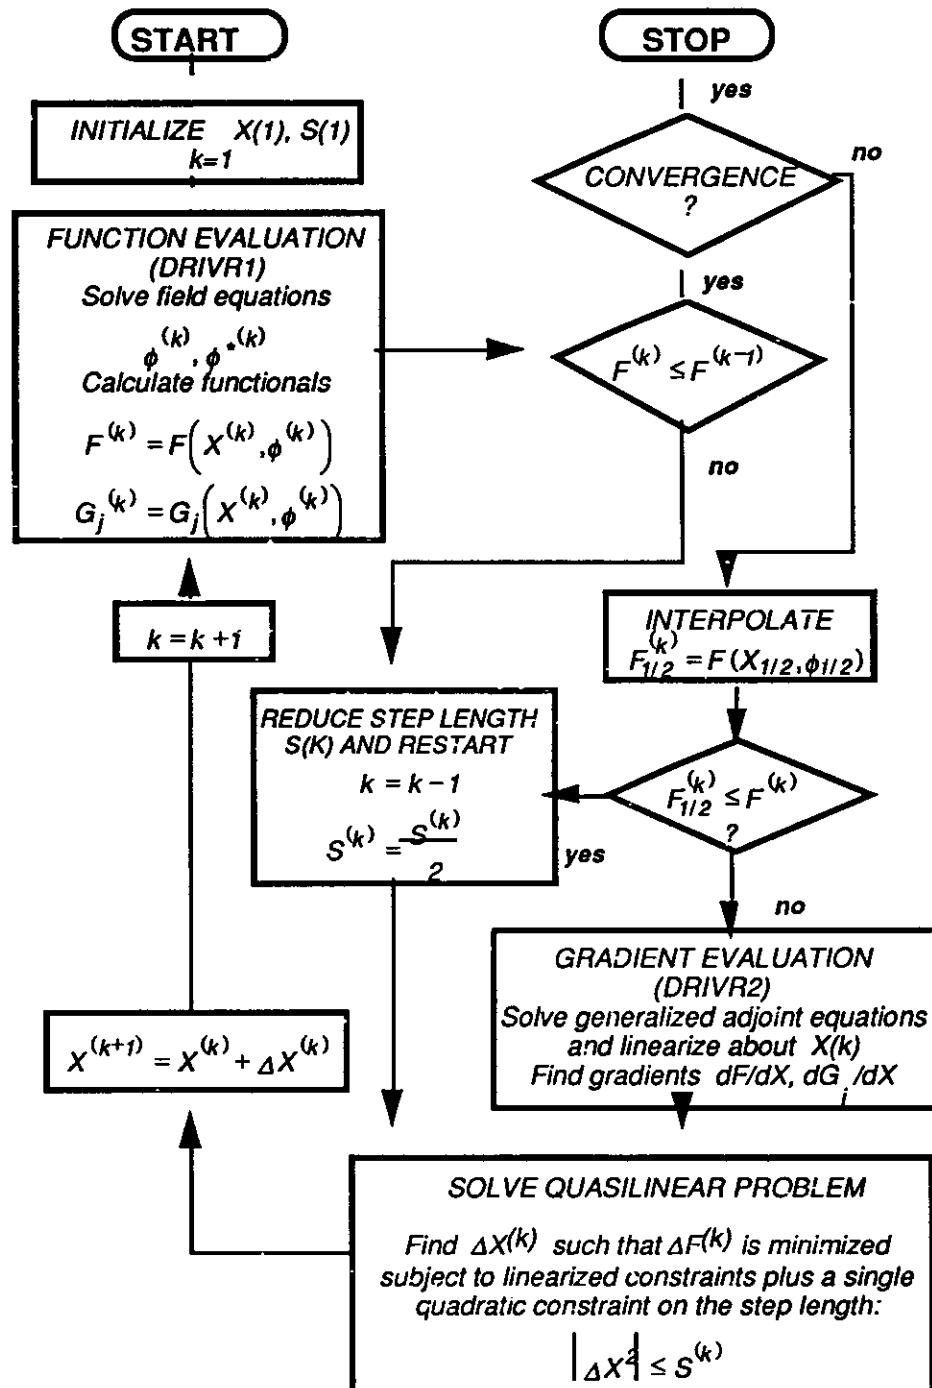


4. Global Depletion Schemes

- Separate lattice calculation creates a problem for treatment of local parameters in core calculation
 - introduction of a Feedback Model (FBM) in DRAGON/DONJON
- Block depletion
 - large number of unknowns for the nuclide field in global block depletion methods;
 - introduction of a simplified global depletion method

Depletion Calculations in DRAGON

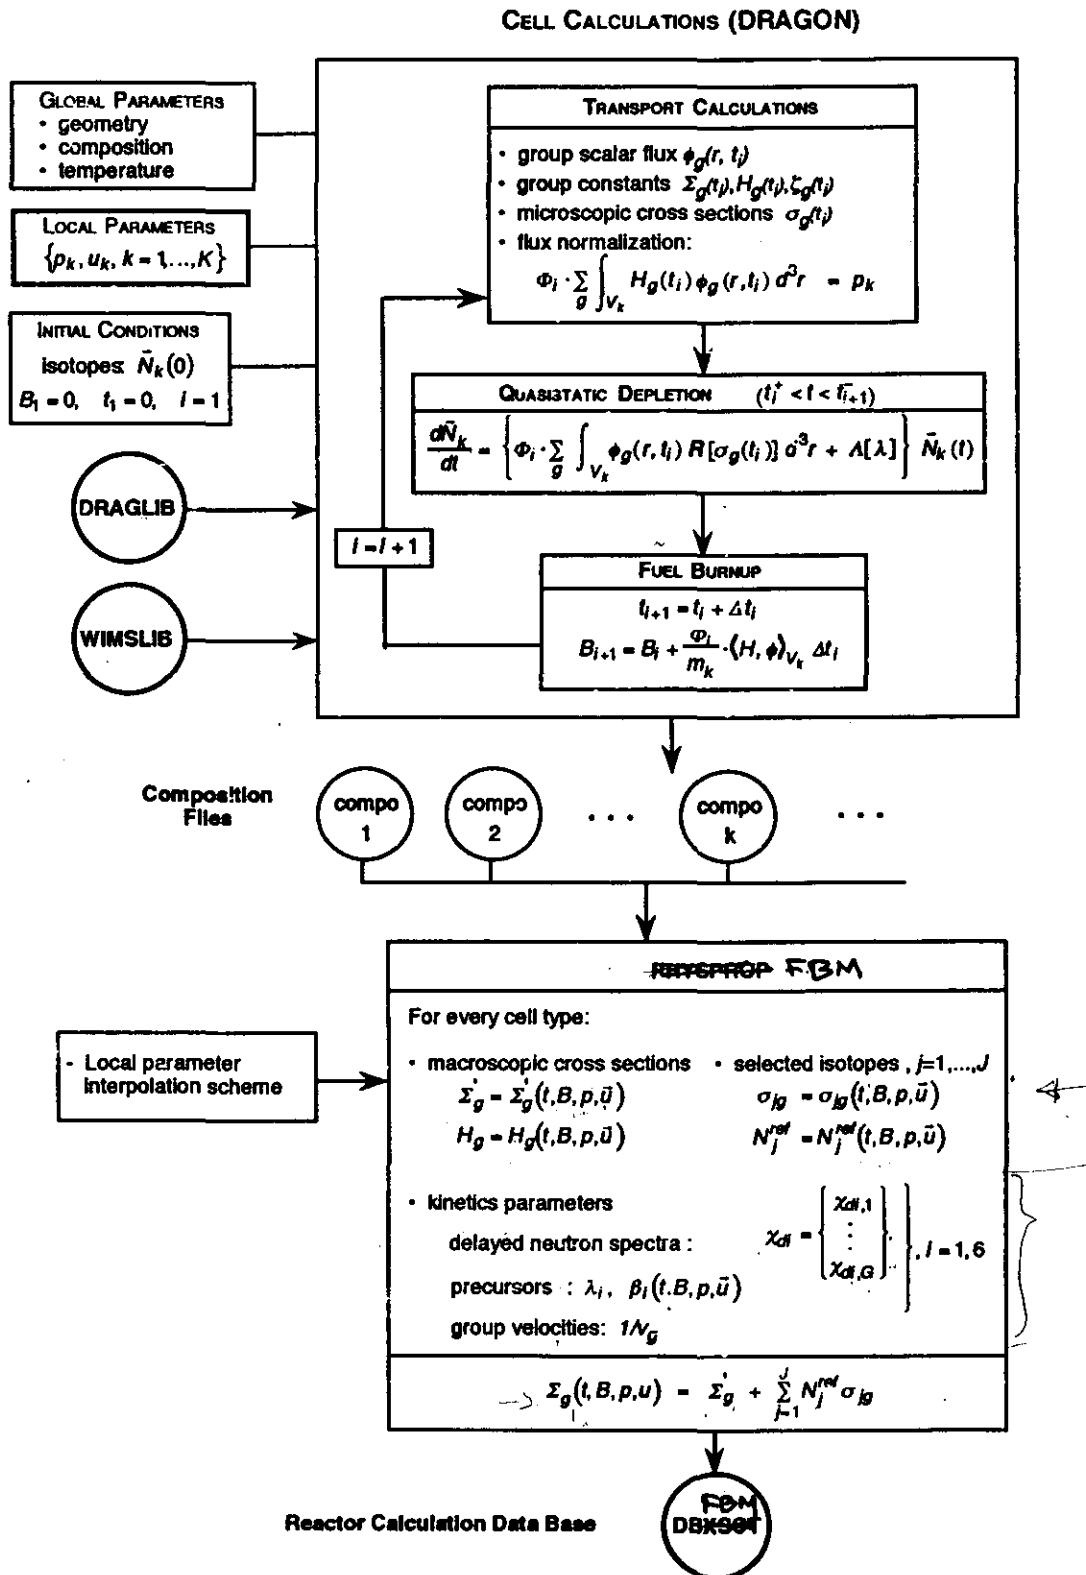

Global Depletion Calculations in DONJON

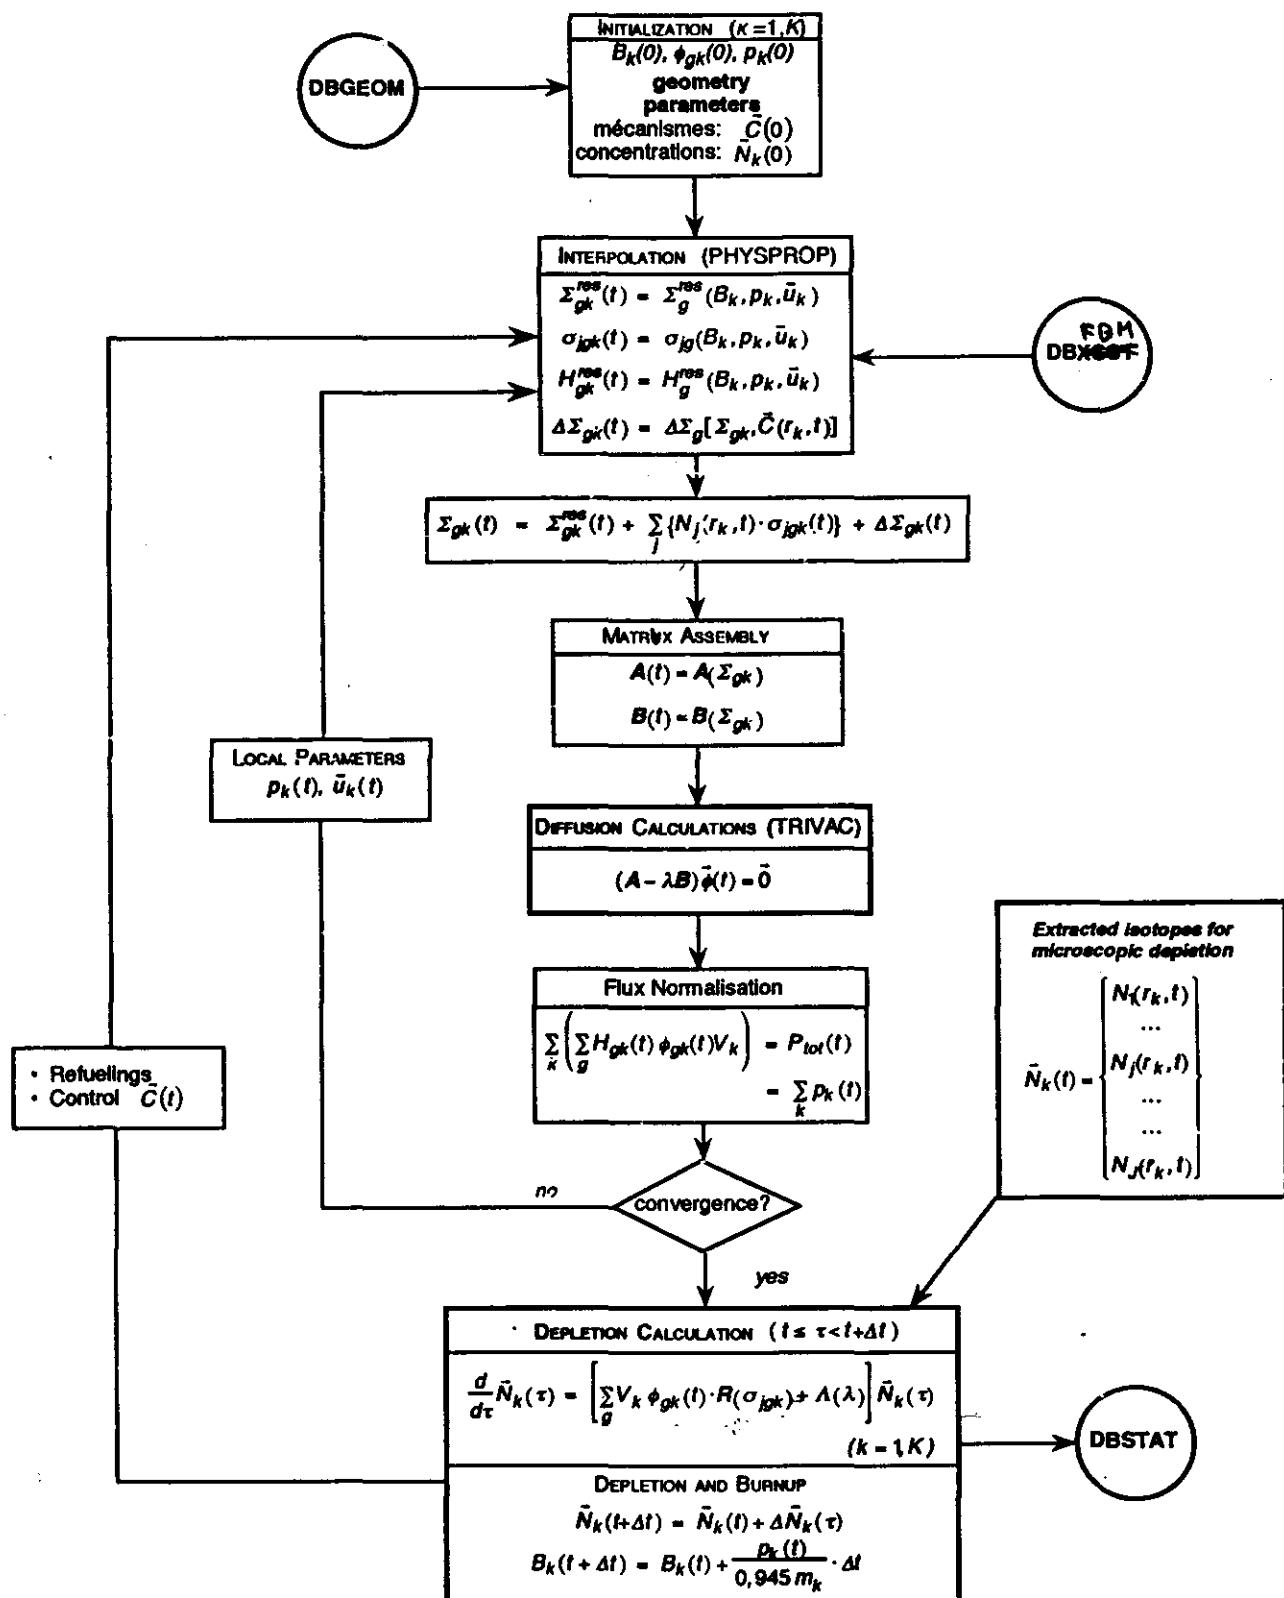

TOWARDS A GLOBAL DEPLETION CALCULATION METHOD IN DRAGON AND DONJON

G. Marleau, M. Boubcher and H. Benjaafar

1. The Cell Depletion Model of DRAGON
2. A Viable Depletion Model in DONJON
3. A Simplified Reactor Depletion Model

The Cell Depletion Model of DRAGON (1)

- Requirements

1. A multigroup cross section library

The multigroup microscopic cross section for each isotope and each reaction type x , $\sigma_{x,i}^g$

2. A depletion chain coherent with this library

The decay rate for each isotope λ_i

The production yield for each isotope $Y_{x,i \rightarrow j}$ for production reaction p including decay ($p = d$)

3. Global cell parameters

- Geometry including material composition and mesh decomposition
- Local parameters including temperature, power, etc.
- Initial conditions $N_{i,r}(t_0)$ for isotope i in region r at $t = t_0$

+

+

The Cell Depletion Model of DRAGON (2)

- Calculation process

1. Multigroup macroscopic material cross section calculation

Using $N_{i,r}(t)$ at $t = t_o$ and $\sigma_{x,i}^g$

$$\Sigma_{x,r}^g(t) = \sum_i N_{i,r}(t) \sigma_{x,i}^g$$

2. Flux calculation

Using $\Sigma_{x,r}^g(t)$, solve the transport equation using collision probability method for flux ϕ_r^g in each region r for each energy group g .

3. Depletion calculation

Solve the isotopic depletion for $N_{j,r}(t_f)$ giving the final concentration of each nuclide j in region r at $t = t_f$ assuming a constant power of flux between time t_o and t_f , namely:

$$\begin{aligned} \frac{dN_{j,r}(t)}{dt} &= \sum_i N_{i,r}(t) \sum_x Y_{x,i \rightarrow j} \sum_g \phi_r^g \sigma_{x,i}^g \\ &+ \sum_i N_{i,r}(t) Y_{d,i \rightarrow j} \lambda_i \end{aligned}$$

4. Go back to step 1

+

2

+

+

The Cell Depletion Model of DRAGON (3)

- Dimension of the cell problem:

1. Total number of regions:

Relatively small (31 for a typical CANDU cell)

2. Number of fuel regions:

Relatively small (4 for a CANDU cell)

3. Number of groups:

Relatively large (69 or 89 groups for our libraries)

4. Number of isotopes per region:

Relatively large (from 50 to 100 depending on the library)

+

+

+

A Viable Depletion Model in DONJON

- Dimension of the reactor problem with fuel depletion model

1. Total number of regions:

Very large (at least 5×4560 regions for a CANDU with 4 fuel regions and a moderator region)

2. Number of groups:

Relatively small (generally 2 groups for CANDU)

3. Number of isotopes per region:

Relatively large (from 50 to 100 depending on the library)

- Total number of unknowns in depletion equation
$$N_d = N_f N_c N_i$$

Number of cells: $N_c = 4560$

Number of fuel regions per cell: $N_f = 4$

Number of isotopes per fuel region: $N_i = 50$

Total number of unknowns $N_d = 912000$

+

4

+

+

A Simplified Reactor Depletion Model (1)

- Combine the N_f fuel regions into a single region

$$F_i^g(t) = \frac{\sum_r N_{i,r}(t)\phi_r^g(t)}{N_i(t)\phi^g(t)}$$

with $\phi^g(t)$ the average flux in the cell and $N_i(t)$ the average concentration of isotope i in the cell.

- New depletion equation:

$$\begin{aligned} \frac{dN_j(t)}{dt} &= \sum_i N_i(t) \sum_x Y_{x,i \rightarrow j} \sum_g F_i^g(t) \phi^g \sigma_{x,i}^g \\ &+ \sum_i N_i(t) Y_{d,i \rightarrow j} \lambda_i \end{aligned}$$

+

+

+

A Simplified Reactor Depletion Model (2)

- Combine many fission products into a pseudo-fission product

$$\begin{aligned}
 N_{\text{pf}}(t) &= \sum_{i \in \text{pf}} N_i(t) \\
 Y_{x,i \rightarrow \text{pf}} &= \sum_{j \in \text{pf}} Y_{x,i \rightarrow j} \\
 Y_{x,\text{pf} \rightarrow \text{pf}} &= \frac{\sum_{i \in \text{pf}} \sum_{j \in \text{pf}} N_i(t) Y_{x,i \rightarrow j}}{N_{\text{pf}}(t)} \\
 \lambda_{\text{pf}} &= \frac{\sum_{i \in \text{pf}} \sum_{j \in \text{pf}} N_i(t) Y_{d,i \rightarrow j} \lambda_i}{N_{\text{pf}}(t) Y_{d,\text{pf} \rightarrow \text{pf}}}
 \end{aligned}$$

- New depletion equation for pseudo-fission product:

$$\begin{aligned}
 \frac{dN_{\text{pf}}(t)}{dt} &= \sum_i N_i(t) \sum_x Y_{x,i \rightarrow \text{pf}} \sum_g F^g(t) \phi^g \sigma_{x,i}^g \\
 &+ \sum_i N_i(t) Y_{d,i \rightarrow \text{pf}} \lambda_i \\
 &+ N_{\text{pf}}(t) \sum_x Y_{x,\text{pf} \rightarrow \text{pf}} \sum_g F^g(t) \phi^g \sigma_{x,\text{pf}}^g \\
 &+ N_{\text{pf}}(t) Y_{d,\text{pf} \rightarrow \text{pf}} \lambda_{\text{pf}}
 \end{aligned}$$

+

+

+

A Simplified Reactor Depletion Model (3)

- Combine many heavy isotopes (actinides) into a few pseudo-actinides

$$\begin{aligned}
 N_{\text{pa}}(t) &= \sum_{i \in \text{pa}} N_i(t) \\
 Y_{x,i \rightarrow \text{pa}} &= \sum_{j \in \text{pa}} Y_{x,i \rightarrow j} \\
 Y_{x,\text{pa} \rightarrow \text{pa}} &= \frac{\sum_{i \in \text{pa}} \sum_{j \in \text{pa}} N_i(t) Y_{x,i \rightarrow j}}{N_{\text{pa}}(t)} \\
 \lambda_{\text{pa}} &= \frac{\sum_{i \in \text{pa}} \sum_{j \in \text{pa}} N_i(t) Y_{d,i \rightarrow j} \lambda_i}{N_{\text{pa}}(t) Y_{d,\text{pa} \rightarrow \text{pa}}}
 \end{aligned}$$


- New depletion equation for pseudo-actinide:

$$\begin{aligned}
 \frac{dN_{\text{pa}}(t)}{dt} &= N_{\text{pa}}(t) \sum_x Y_{x,\text{pa} \rightarrow \text{pa}} \sum_g F^g(t) \phi^g \sigma_{x,\text{pa}}^g \\
 &\quad + N_{\text{pa}}(t) Y_{d,\text{pa} \rightarrow \text{pa}} \lambda_{\text{pa}}
 \end{aligned}$$

+

5. Advanced Fuel Cycles in CANDU

- use of natural uranium:
 - low fuel costs
 - simple fuel cycle (once-through)
 - reliable fuel handling and safe storage
 - daily refueling requires very small excess reactivity
 - no soluble poison (boron) in moderator
 - average exit burnup nearly 2x average burnup (continuous refueling limit)
 - average exit burnup achieved: 7500-8000 MWd/TeU
 - low fissile content of spent fuel (≈ 2.0 g/kg U-235, 2.4 g/kg Pu-239)
 - no commercial reprocessing

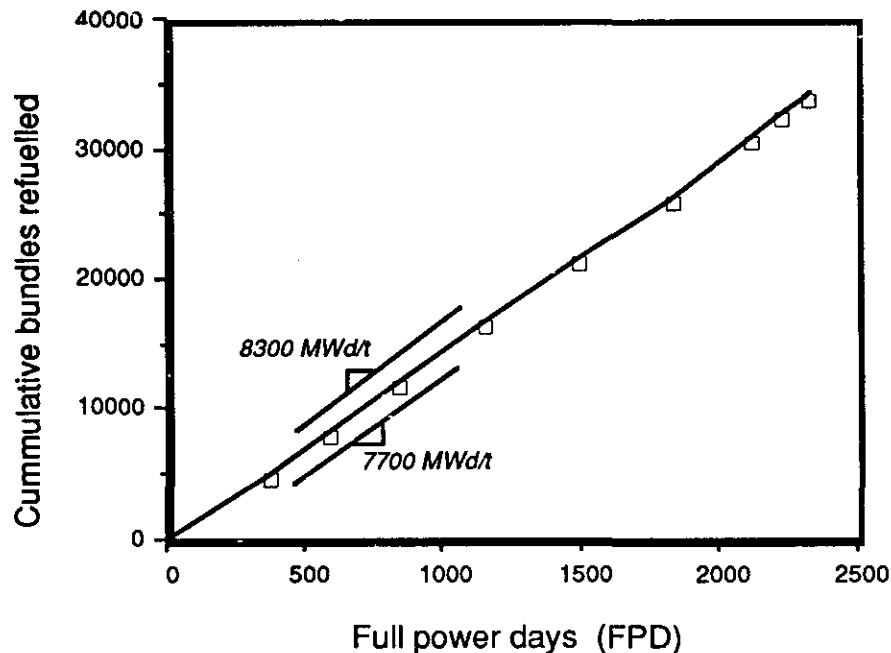

Actual average exit burnup in Gentilly-2


Advanced fuel cycles

- uranium enrichment
 - availability of U enrichment services
 - recovered uranium (RU) from commercial reprocessing of PWR fuel
 - modest fuel fabrication costs
 - improved resource utilization (higher burnup, lower fuel costs)
- MOX
 - availability of from military Pu disposal (or commercial reprocessing of PWR fuel)
 - feasibility study, reactor physics experiments
- DUPIC
 - direct use of PWR fuel in CANDU
 - dry reprocessing
 - OREOX process
 - reactor physics studies
 - heterogeneity problem
- DRAGON/DONJON results
 - compare various cycles at equilibrium refueling for different axial shuffling schemes
 - average exit burnup
 - channel and bundle power distributions
 - adjuster worth
 - CPPF
 - study heterogeneity problem in DUPIC (carrying out both PWR and CANDU depletion calculations)
 - full core CANDU 6 model, with adjusters and LZC
 - age model


Time Average Calculations

- unit cell depletion calculations with DRAGON:
 - 37-element fuel (Nat.U, SEU, MOX)
 - CANFLEX (DUPIC)
- nominal 615 kW bundle, local parameters
- 2-zone differential refueling (inner/outer core)


1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22

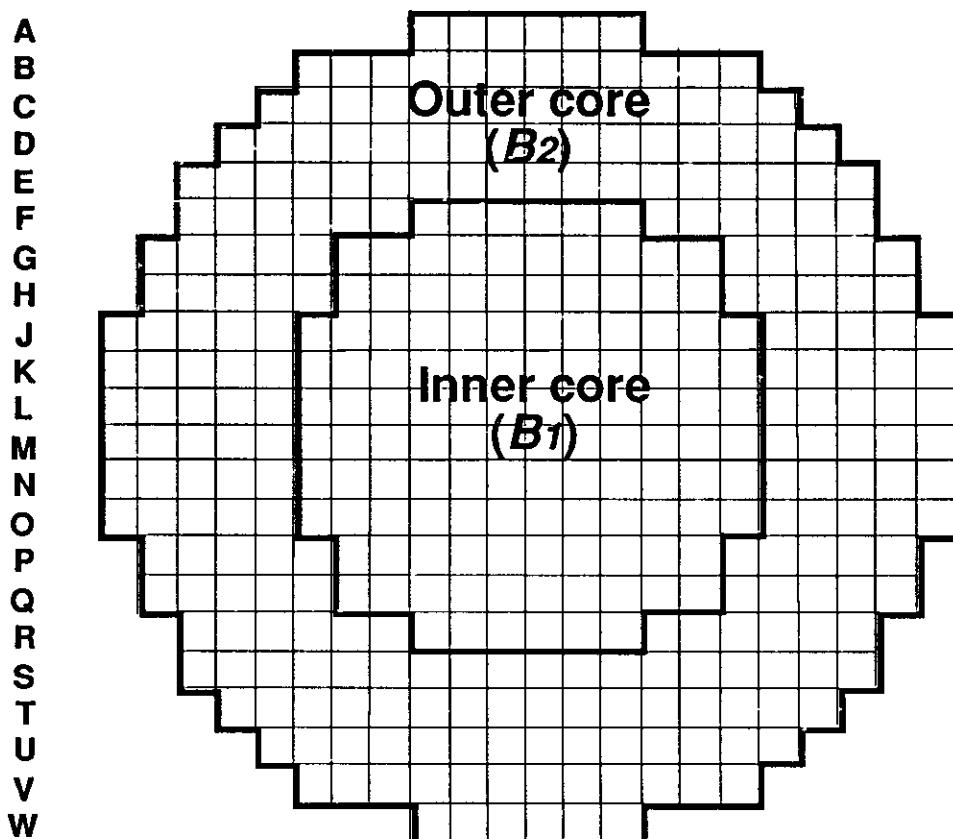

- *equilibrium refueling*: average exit burnup is adjusted to make T/A model critical
- ratio of inner core/outer core burnup adjusted to minimize peak power (radial flattening)

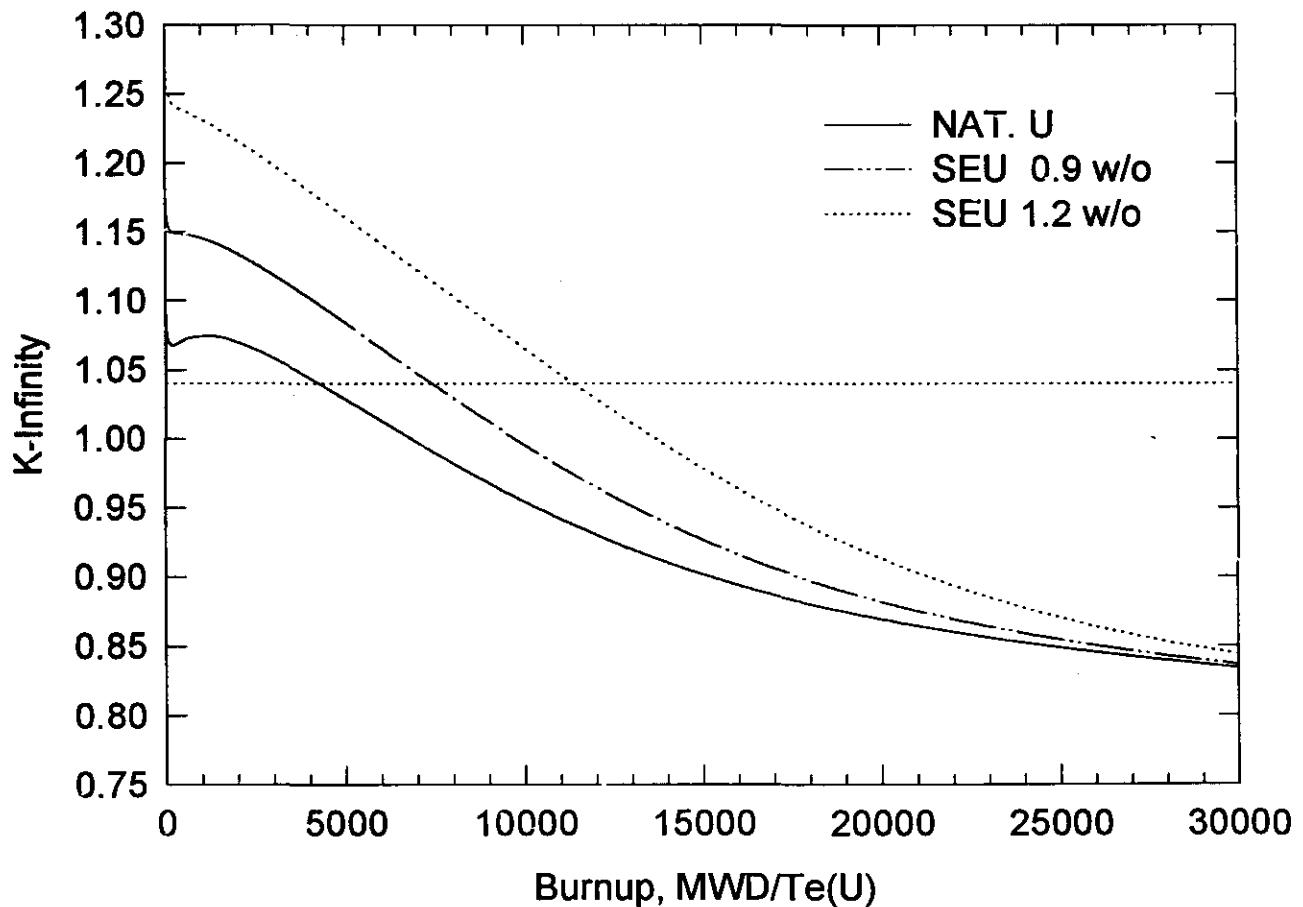

Lattice K-infinity vs. Burnup for Different Fuels

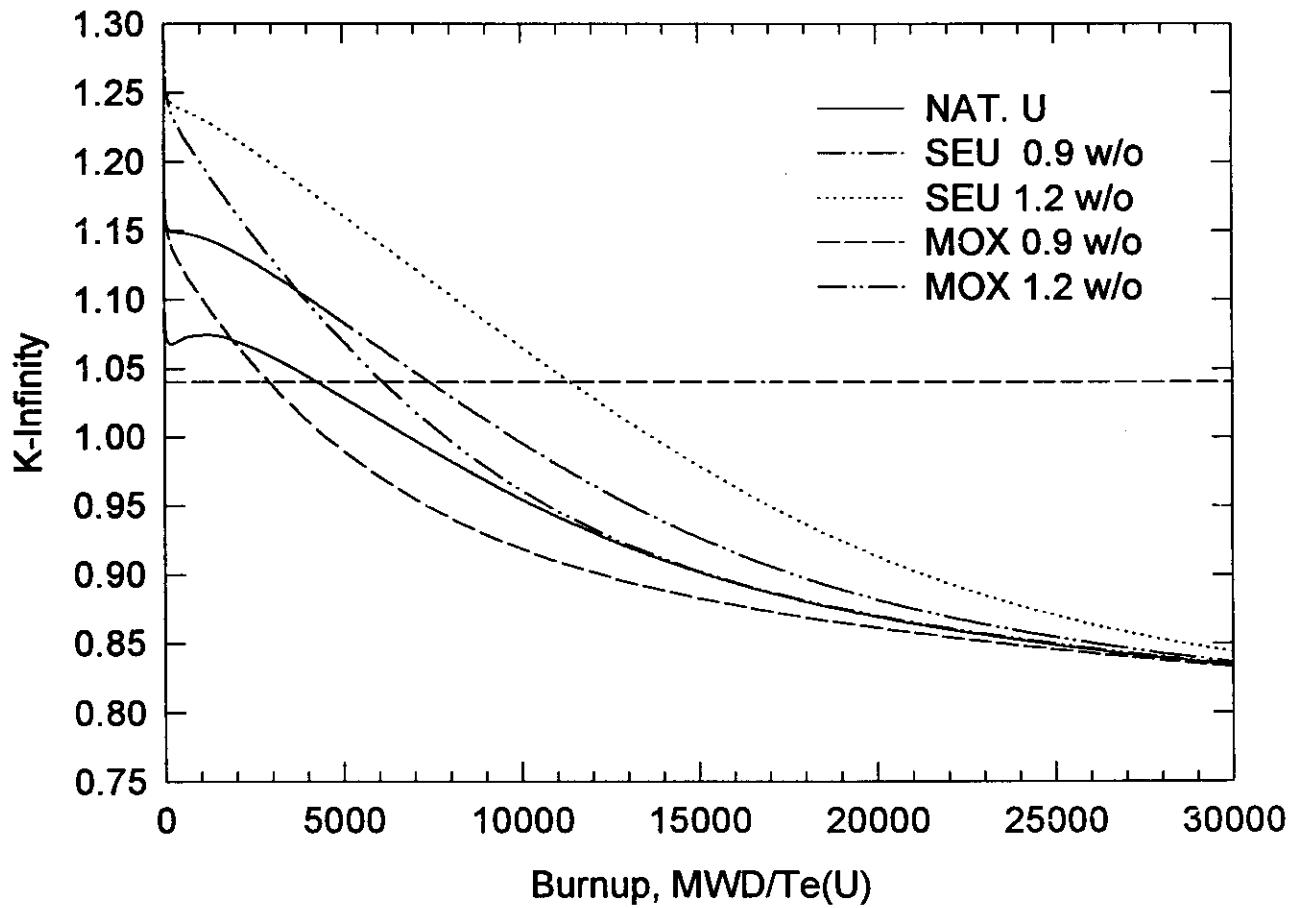

Lattice K-infinity vs. Burnup for Different Fuels

Numerical Results


- large increase in initial k_{∞} with SEU \Rightarrow higher burnup
- MOX: match initial k_{∞} of SEU
 - Pu is added (uniformly) to depleted uranium (0.2%)
 - k_{∞} drops more rapidly \Rightarrow lower burnup than SEU
- peak channel and bundle power sensitive to axial BS

Characteristics of CANDU-6 Core Refueled by Different Fuel Types


FUEL TYPE	BS	AVERAGE EXIT BURNUP MWd/T(U)	PEAK CHANNEL POWER (MW)	PEAK BUNDLE POWER (kW)	ADJUSTER WORTH (mk)
Nat. U	2	7710	7252 (J11)	868 (E12,6)	17.49
	4	7668	7231 (J11)	839 (E12,6)	17.62
	8	7613	6991 (H8)	837 (E12,6)	16.64
SEU 0.9 w/o	2	14226	6738 (F15)	777 (E11,7)	14.00
	4	14292	6748 (F15)	799 (E14,5)	14.43
	8	14768	6860 (H15)	856 (E12,6)	15.43
SEU 1.2 w/o	2	21715	6939 (E14)	865 (F15,3)	10.14
	4	22169	6806 (F8)	872 (F8,9)	12.30
	8	23799	6840 (H8)	867 (G8,7)	14.99
MOX 0.9 w/o	2	5931	6806 (E14)	732 (F15,4)	12.47
	4	6051	6773 (F15)	775 (F15,4)	13.44
	8	6327	6750 (G15)	859 (E12,6)	14.57
MOX 1.2 w/o	2	12454	6844 (F15)	850 (F15,3)	10.34
	4	12796	6859 (E14)	854 (F15,4)	10.61
	8	13907	6862 (H15)	865 (E11,7)	14.54

Power Distribution


- size of inner burnup zone not optimized for enriched core
- axial power profiles in selected channels:
 - axial offset increases with fuel enrichment
 - axial offset larger as BS is reduced ($8BS \Rightarrow 4BS \Rightarrow 2BS$)
 - flattening due to presence of adjusters

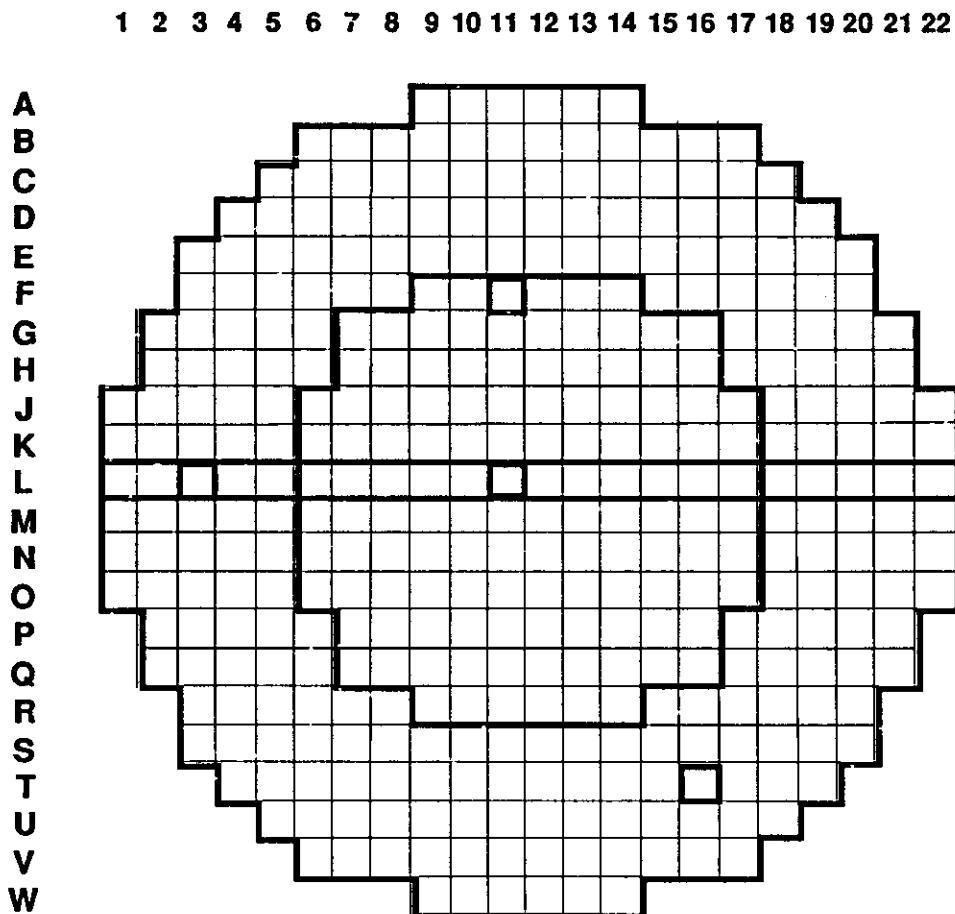


- reduction of adjuster worth: radial flattening, more absorption in fuel
- evaluation of CPPF: age model

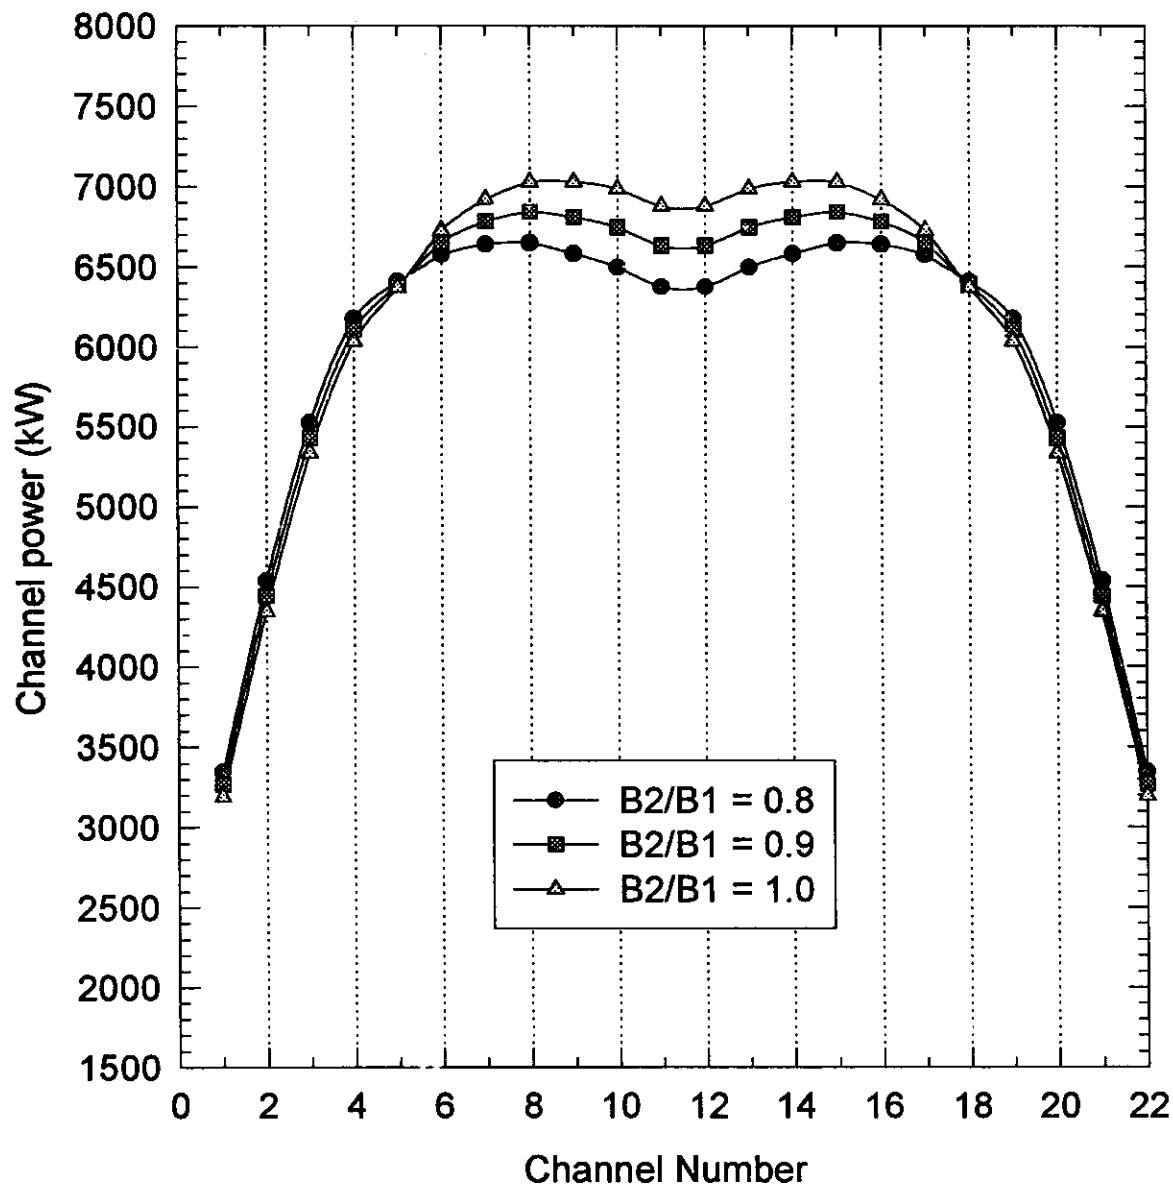


**Radial Channel Power Profiles
(NAT. U, 8 BS, Row L)**

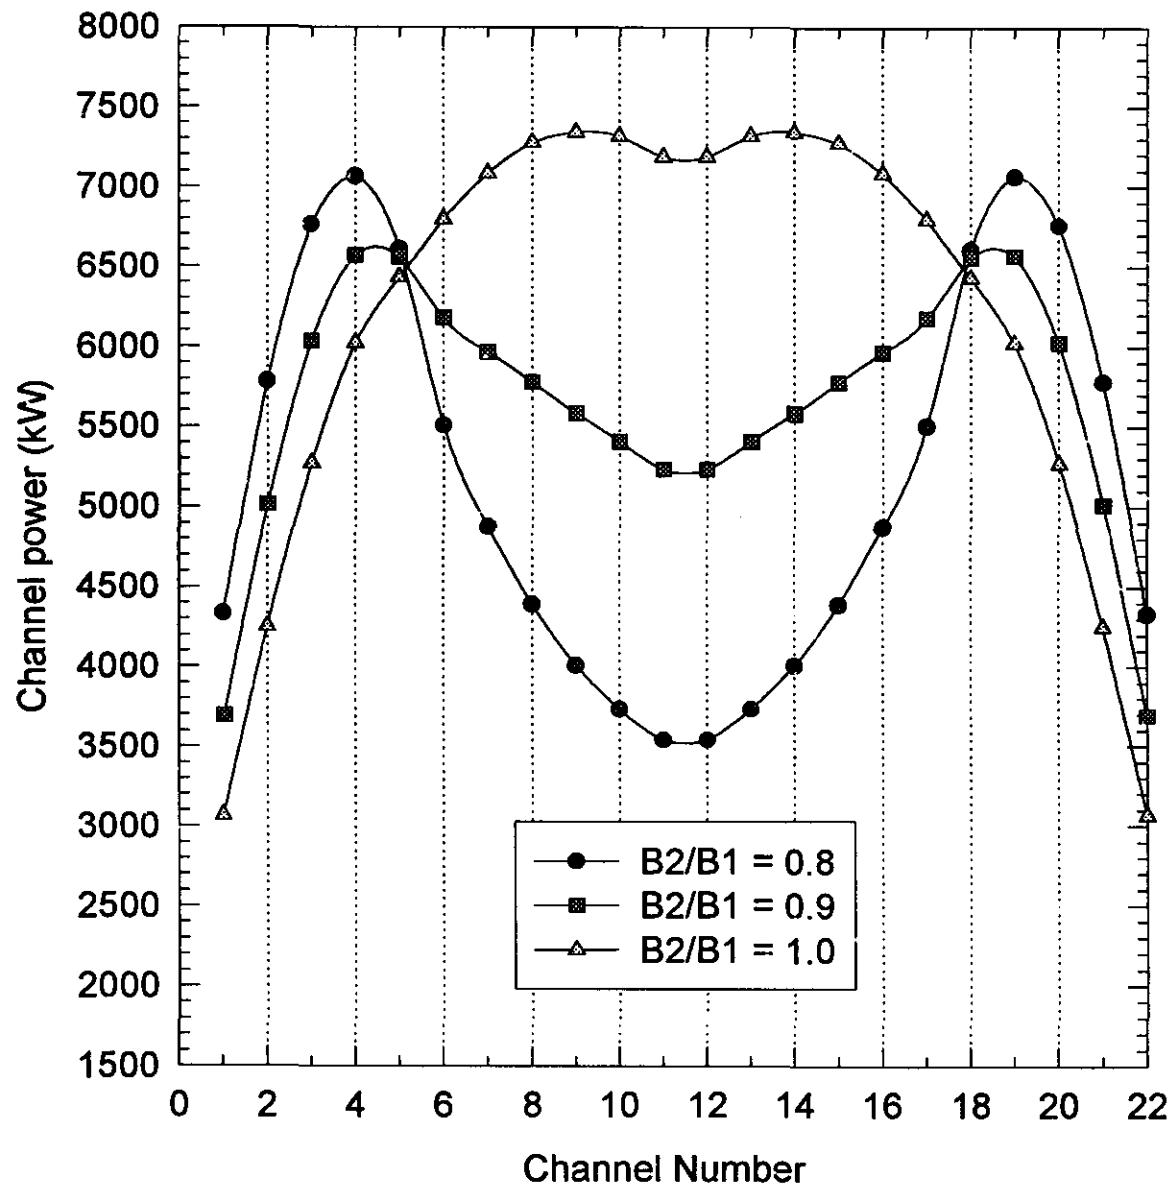


**Radial Channel Power Profiles
(SEU, 1.2 w/o, 2 BS, Row L)**

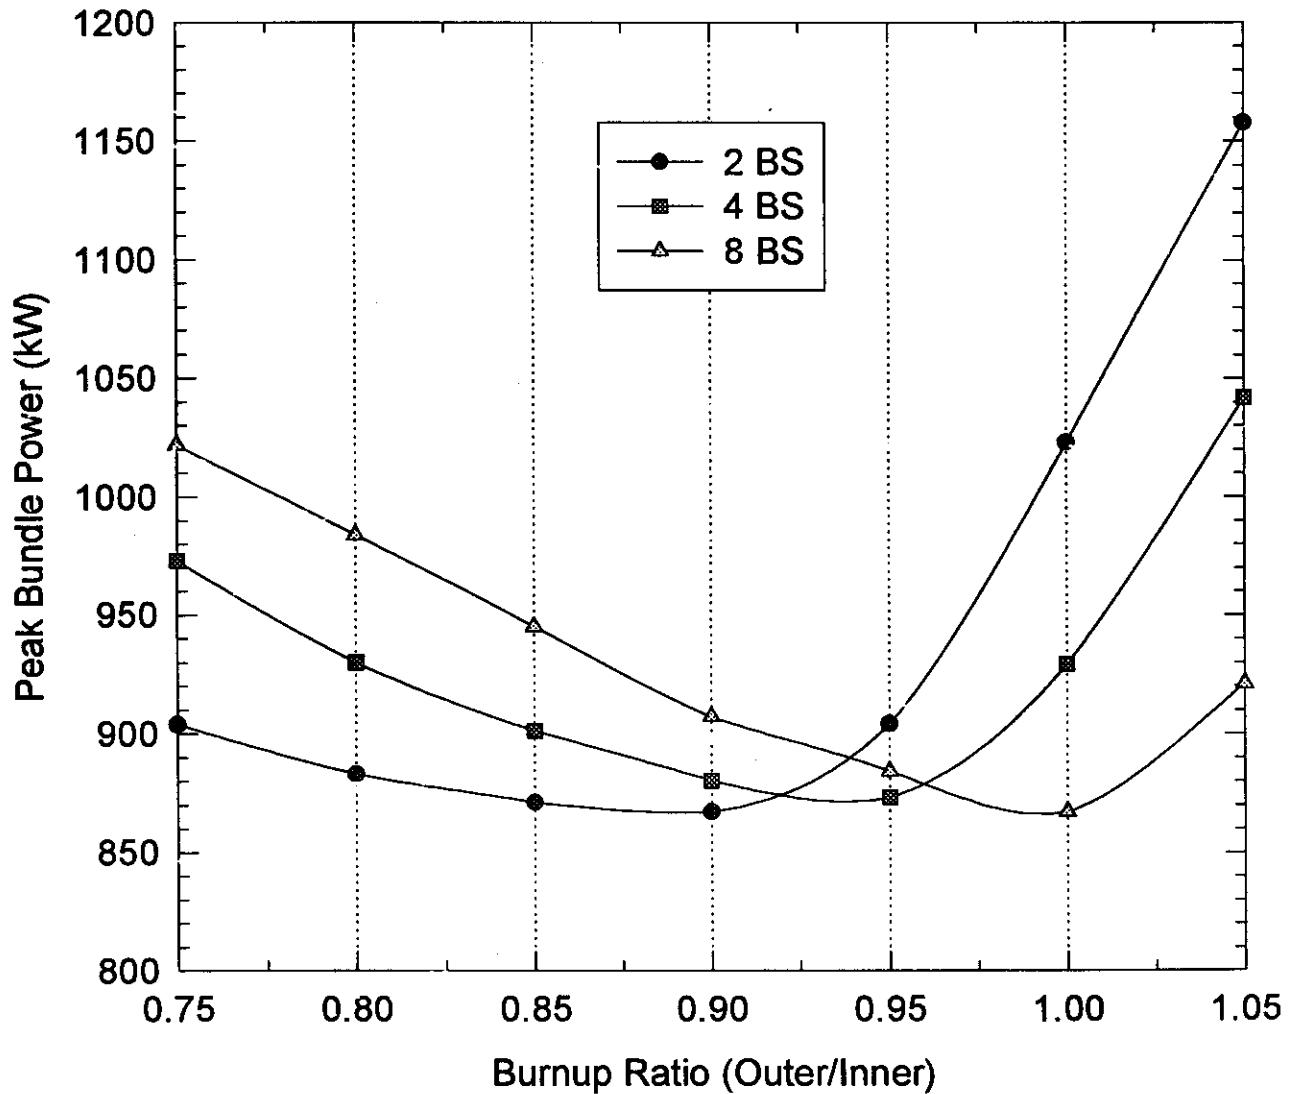


**Peak Bundle Power for Each Refueling Scheme
(SEU, 1.2 w/o)**

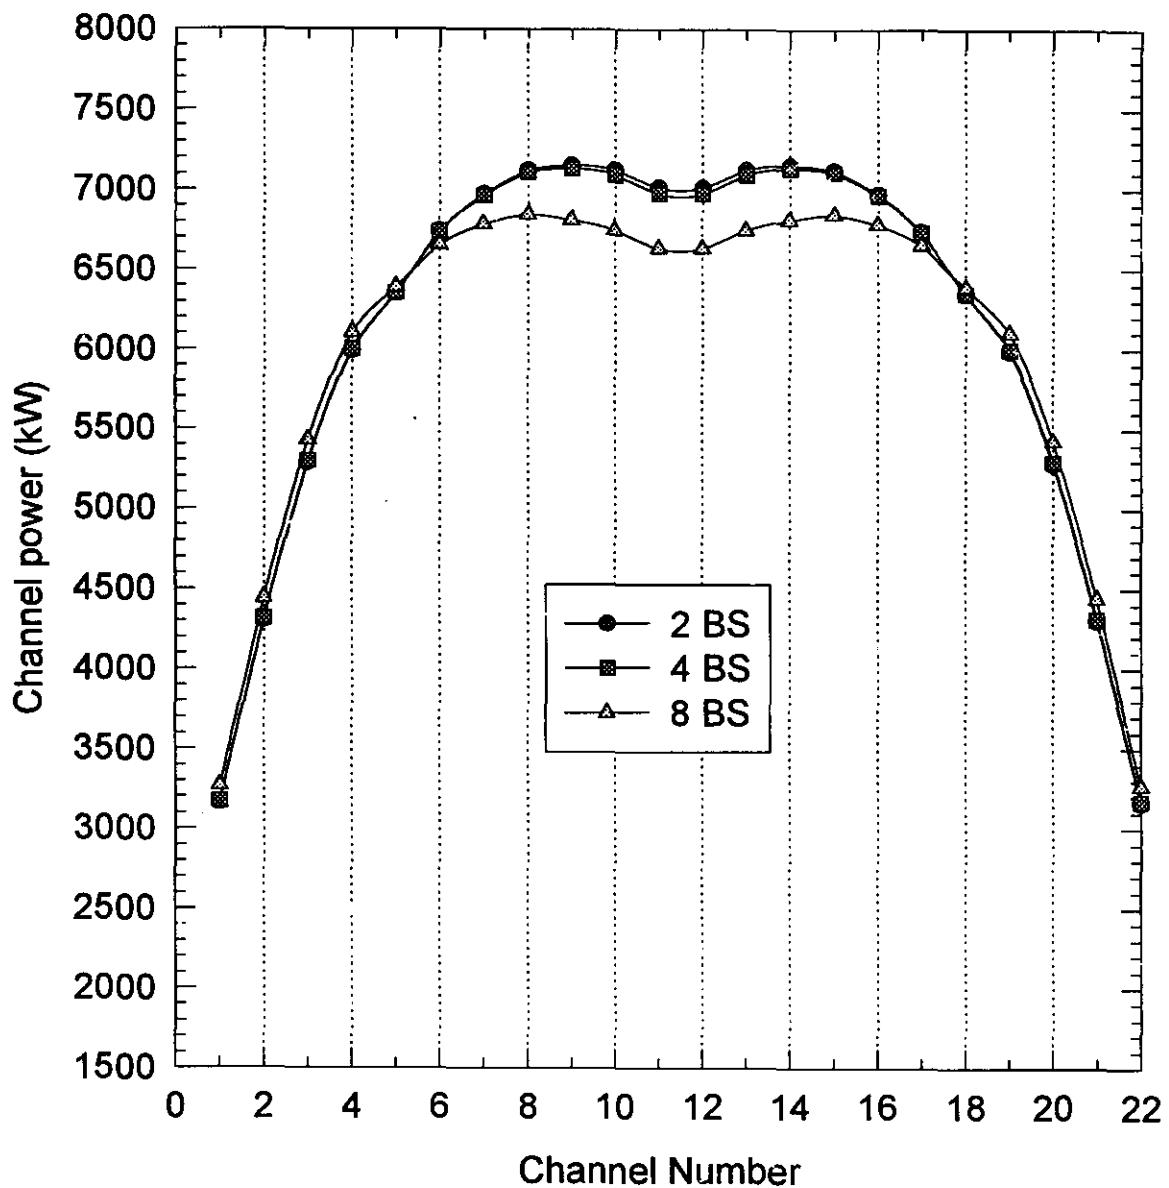


**Radial Channel Power Profiles
(NAT. U, Row L)**

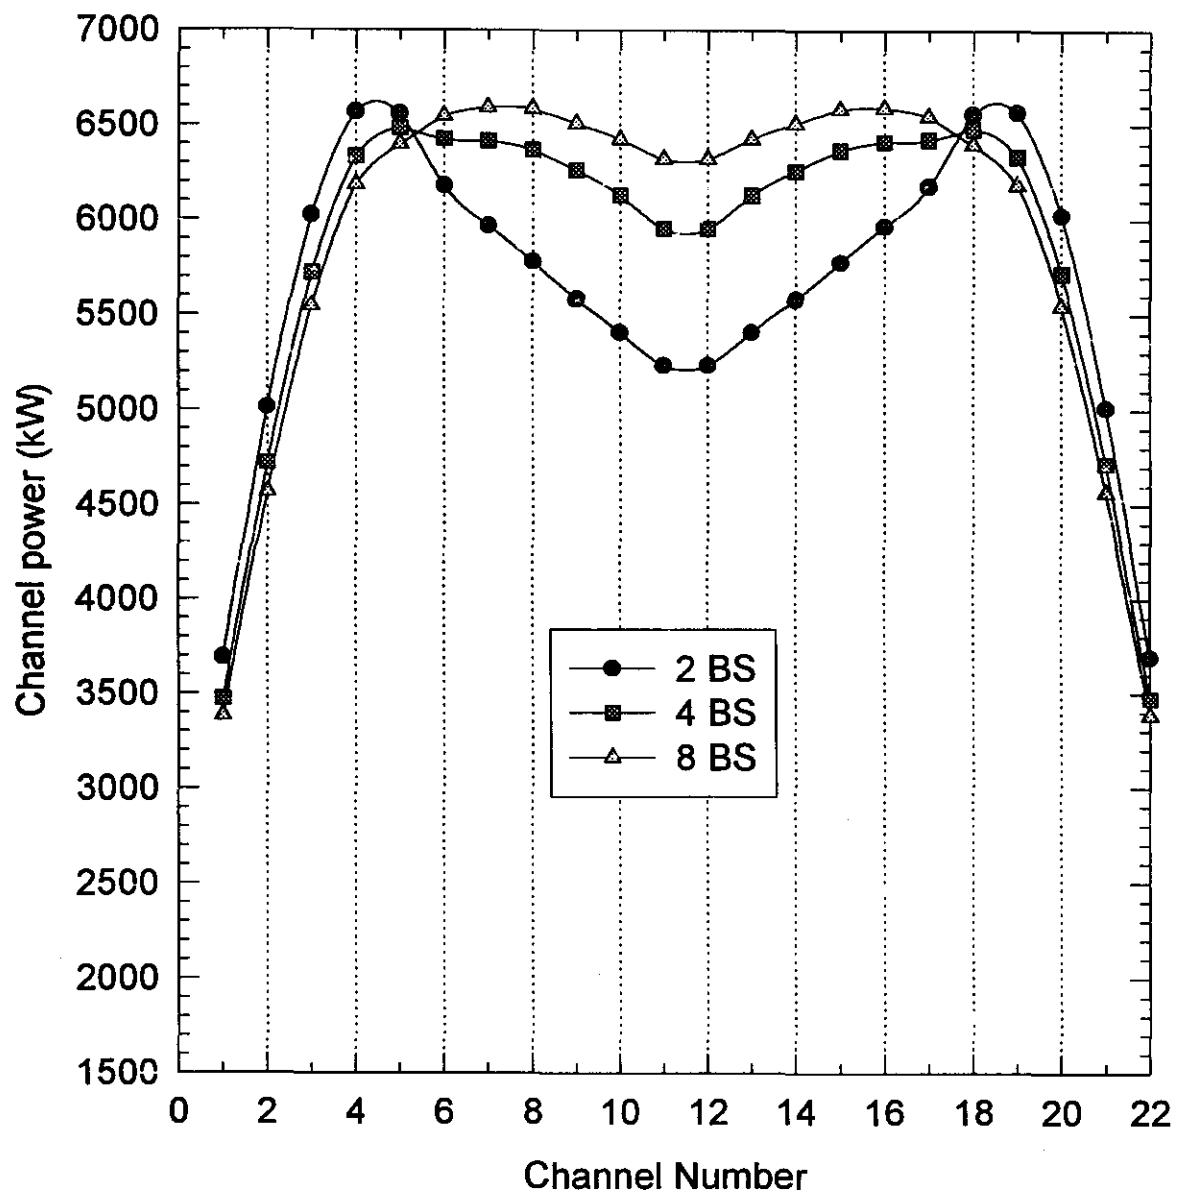


**Radial Channel Power Profiles
(SEU, 1.2 w/o, Row L)**

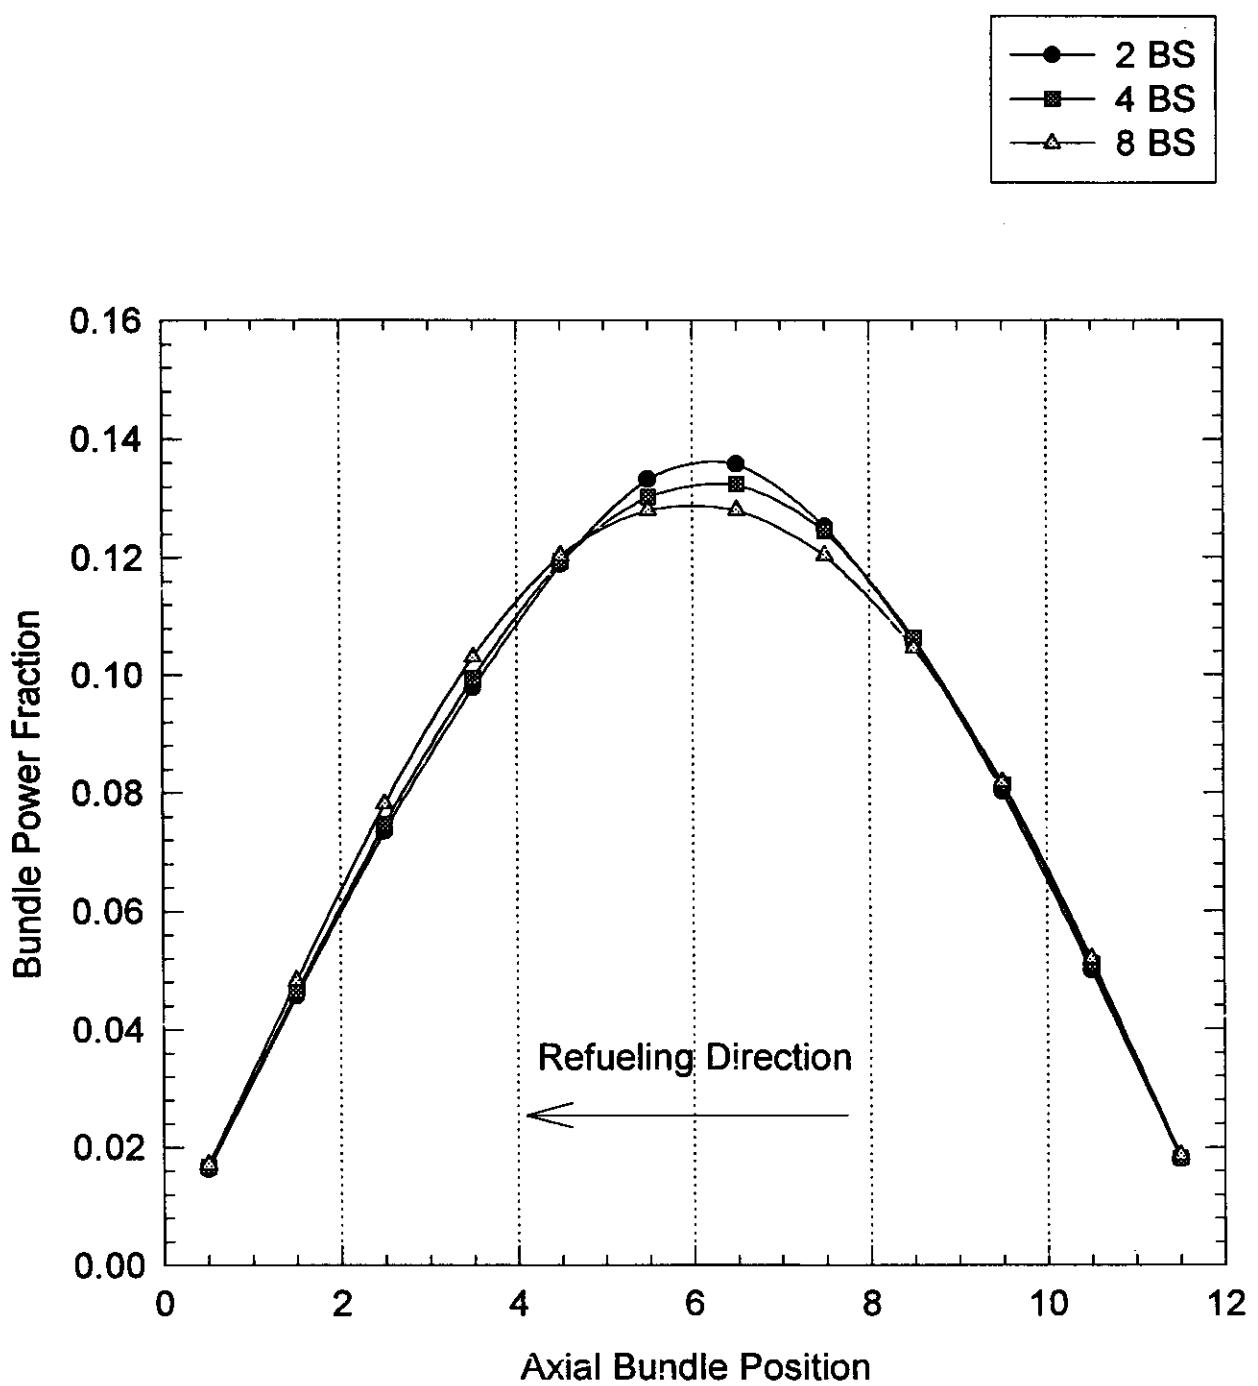


**Typical Time-Average Axial Power Profiles
(NAT. U, Channel L3)**

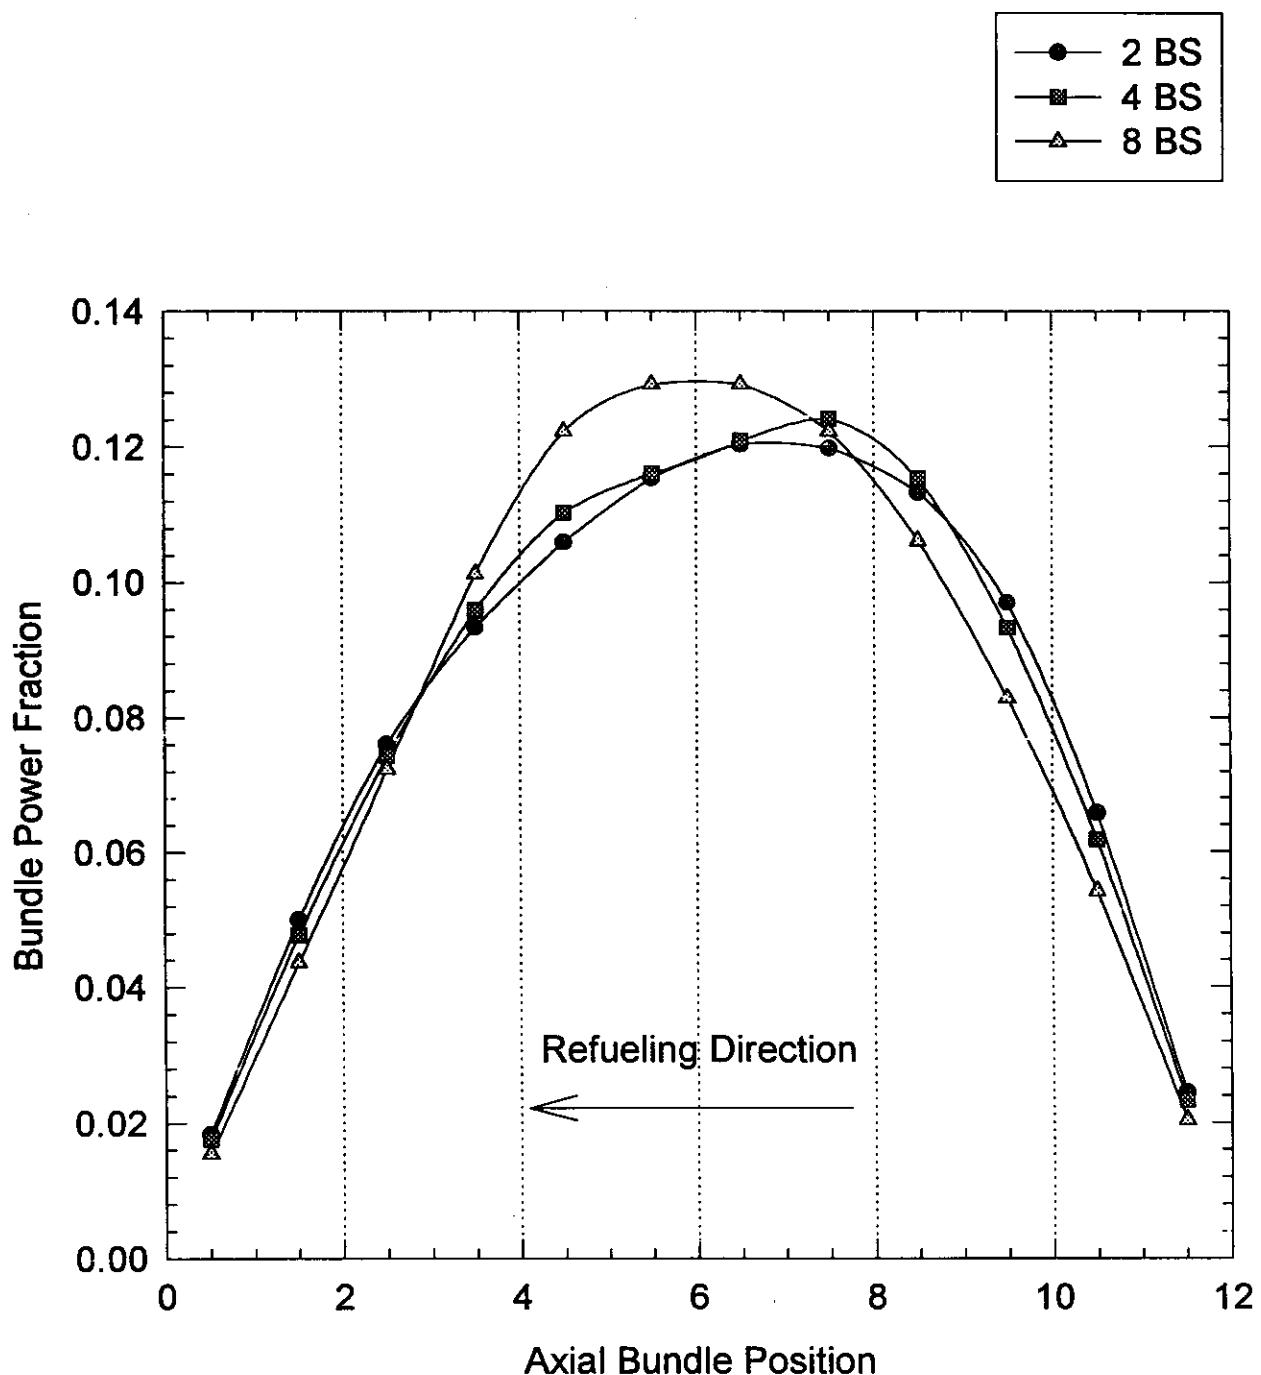


**Typical Time-Average Axial Power Profiles
(SEU, 0.9 w/o, Channel L3)**

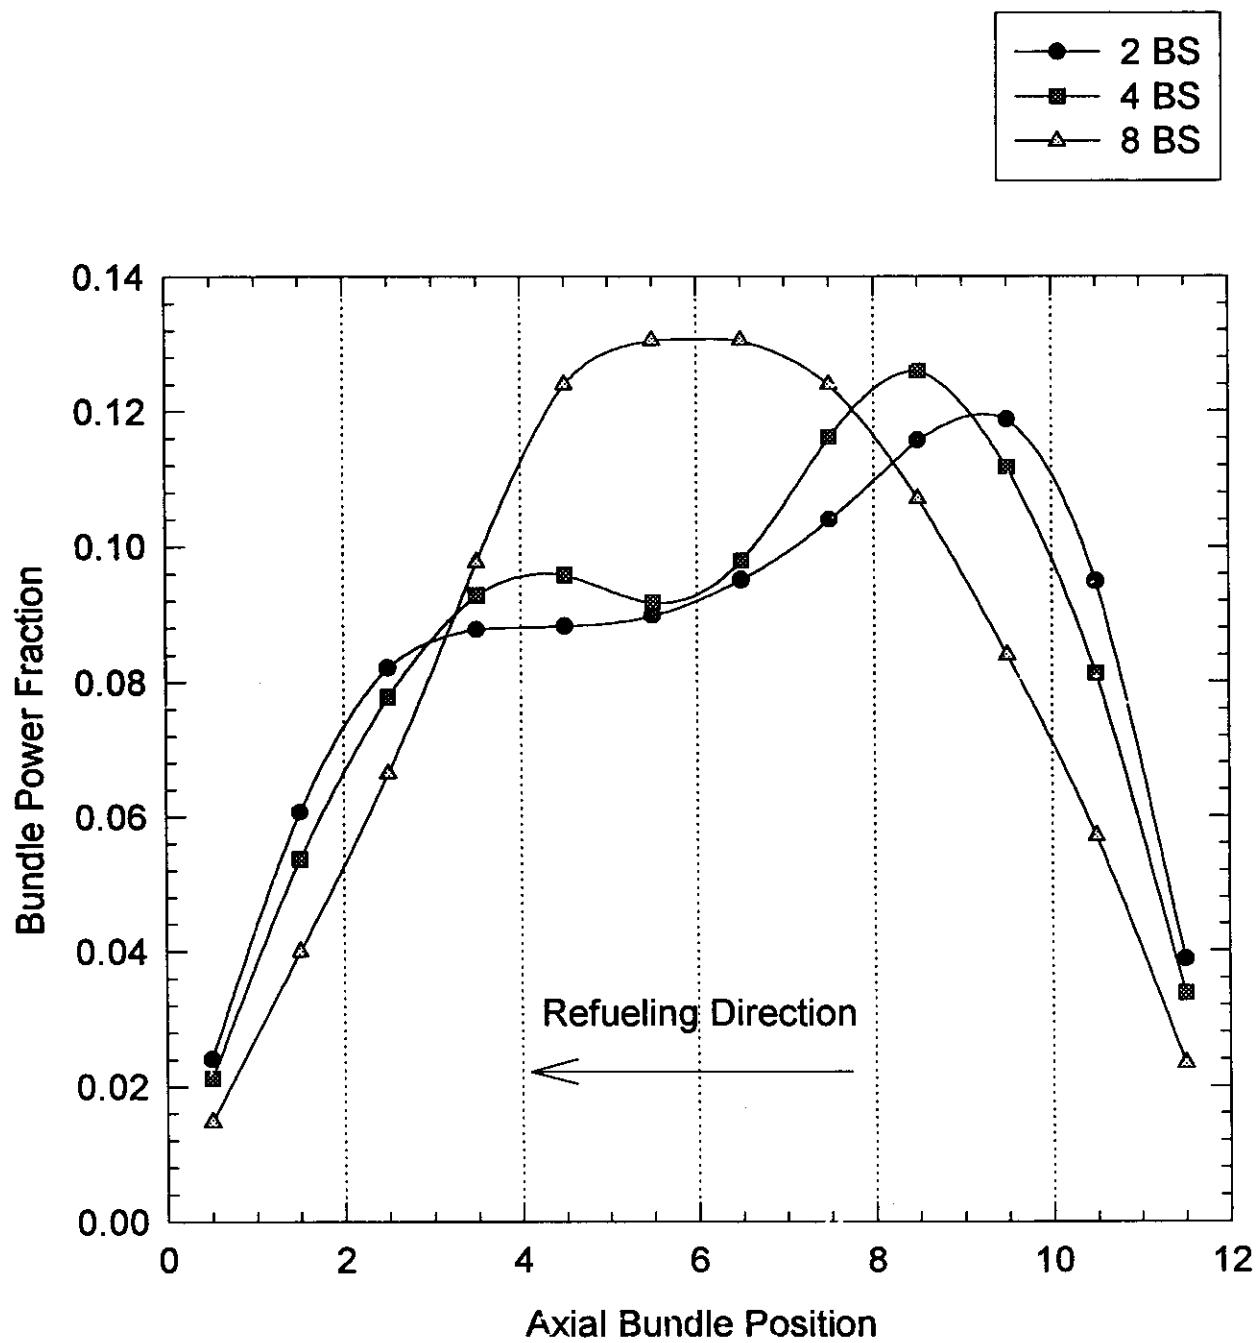


**Typical Time-Average Axial Power Profiles
(SEU, 1.2 w/o, Channel L3)**

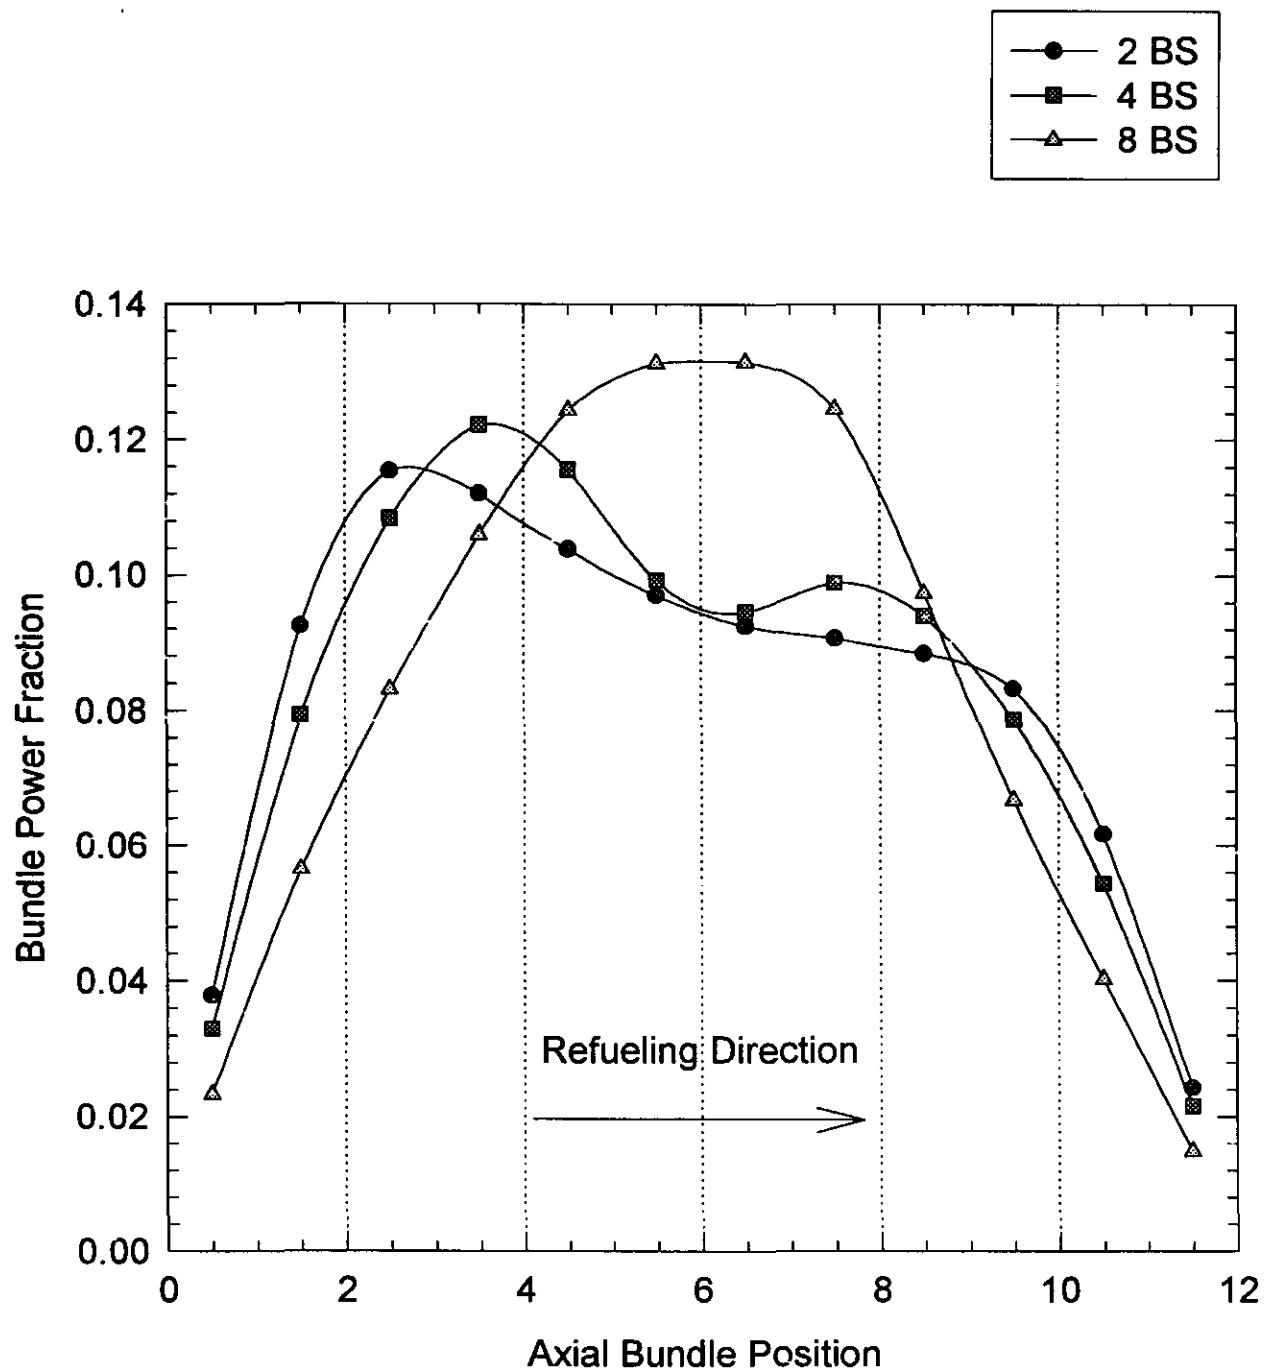


**Typical Time-Average Axial Power Profiles
(SEU, 1.2 w/o, Channel T16)**

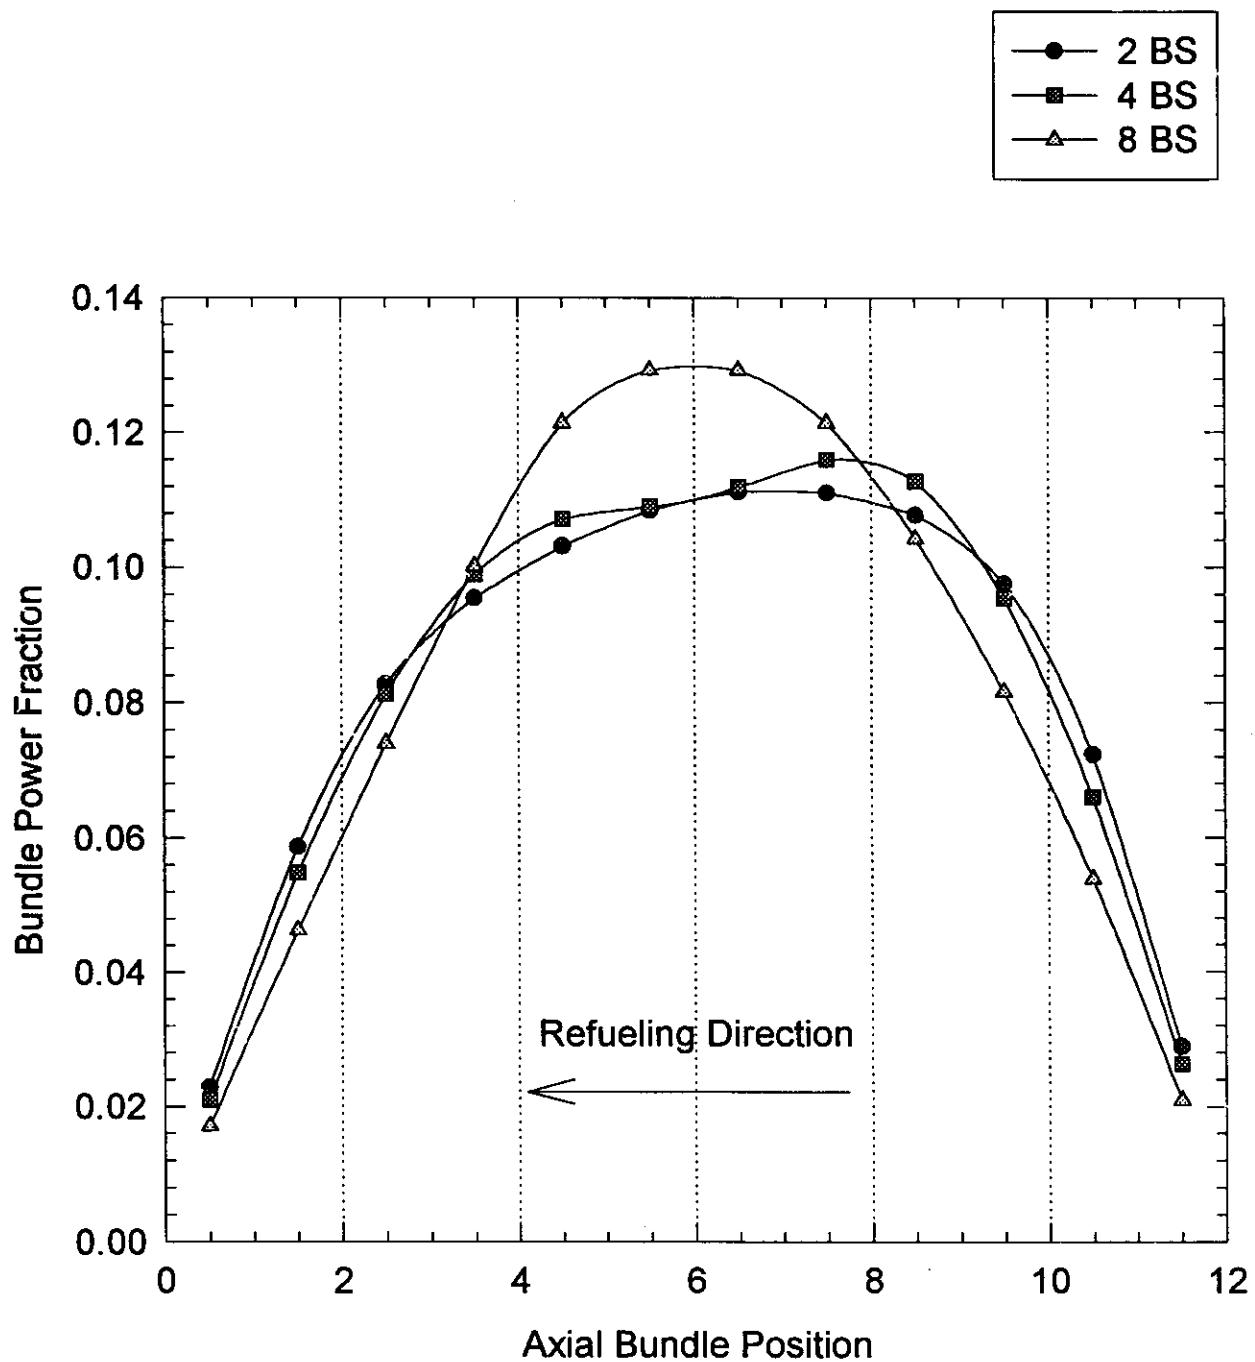


**Typical Time-Average Axial Power Profiles
(MOX, 0.9 w/o, Channel L3)**

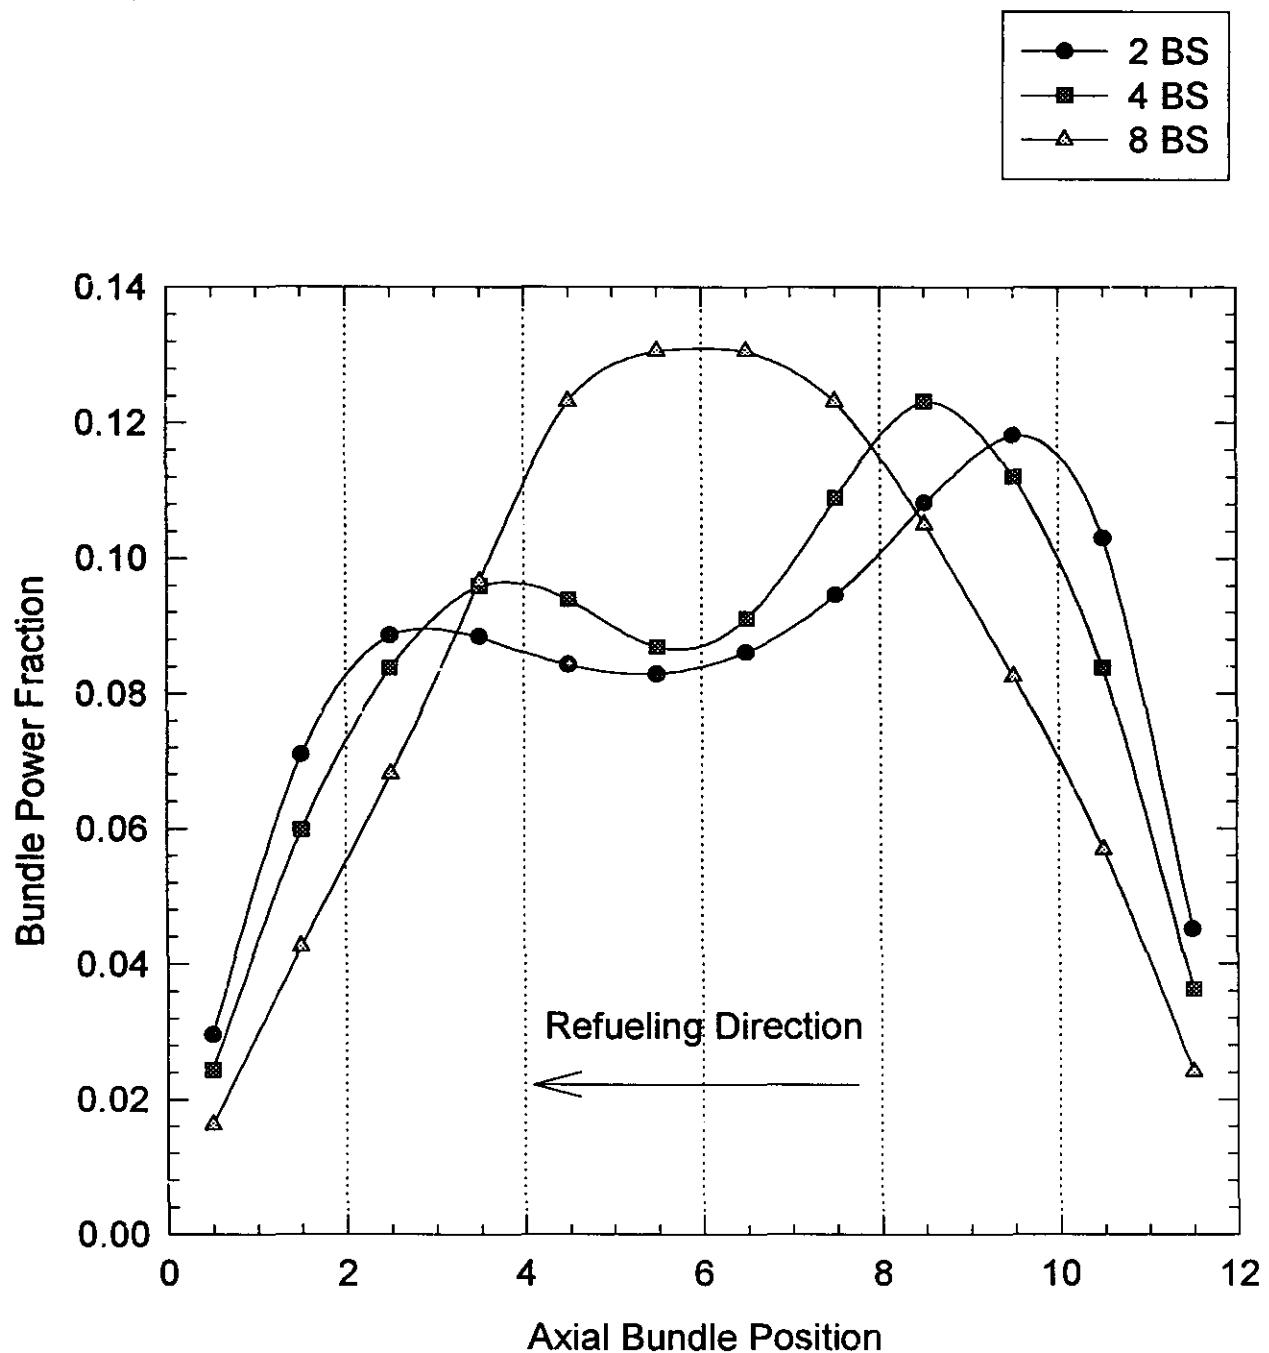

**Typical Time-Average Axial Power Profiles
(MOX, 1.2 w/o, Channel L3)**

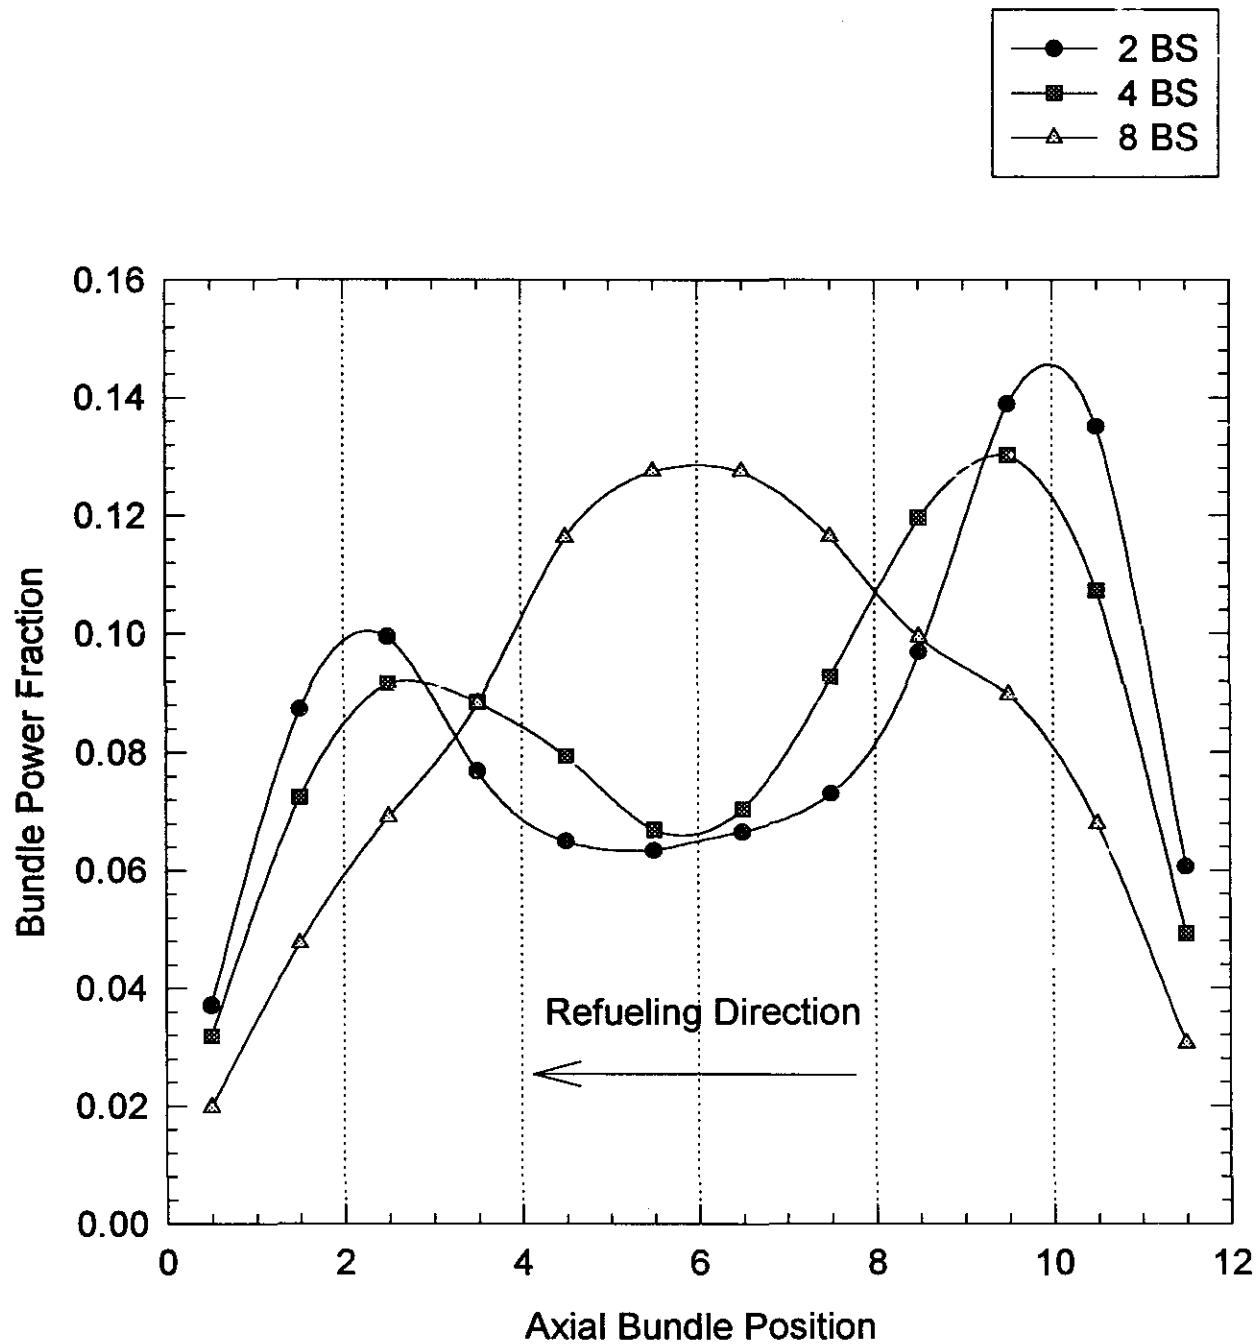


**Typical Time-Average Axial Power Profiles
(SEU, 1.2 w/o, Channel L11)**

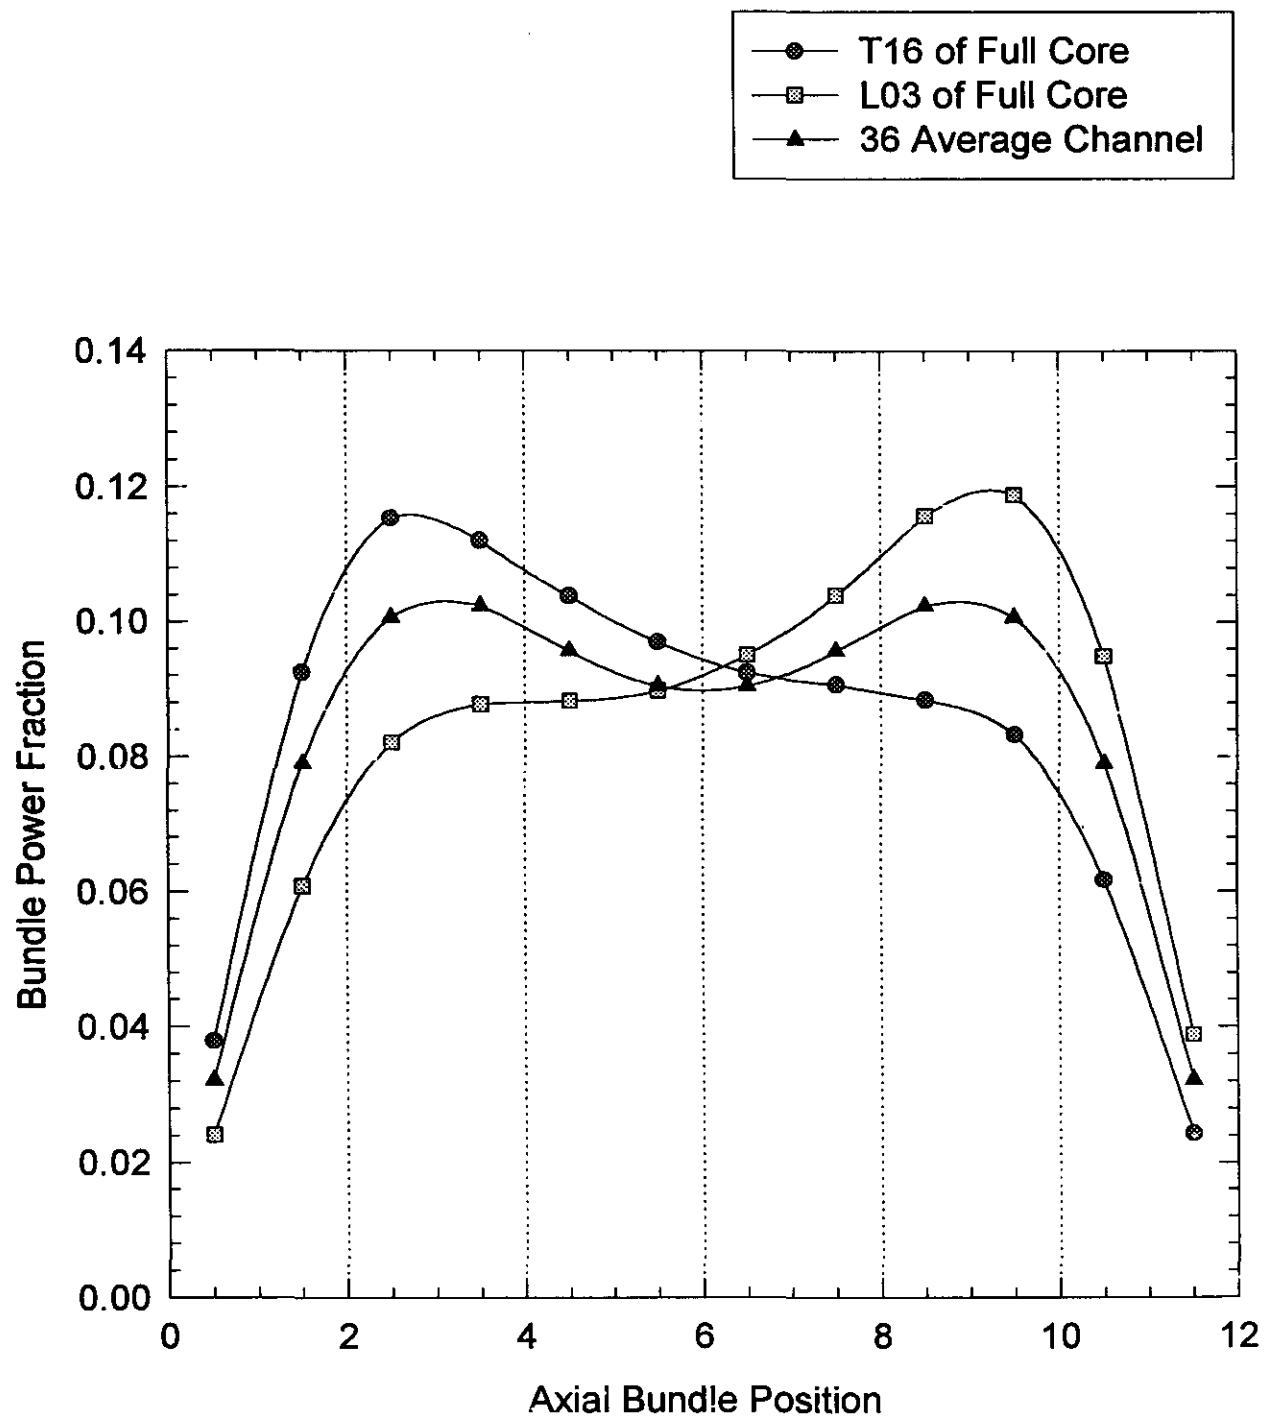


**Typical Time-Average Axial Power Profiles
(SEU, 1.2 w/o, 2 BS)**

36-Channel Supercell Model


- symmetry
 - infinite lattice: periodic boundary conditions in X-Y plane
 - no symmetry in Z-direction (12 bundles in channels)
- bi-directional fueling schemes
 - explicit representation of axial fuel movements in each channel
 - alternating fueling direction in neighboring channels
 - T/A and instantaneous calculations
- refueling sequence used to fix channel «age»: $f_j = n_j / 36$

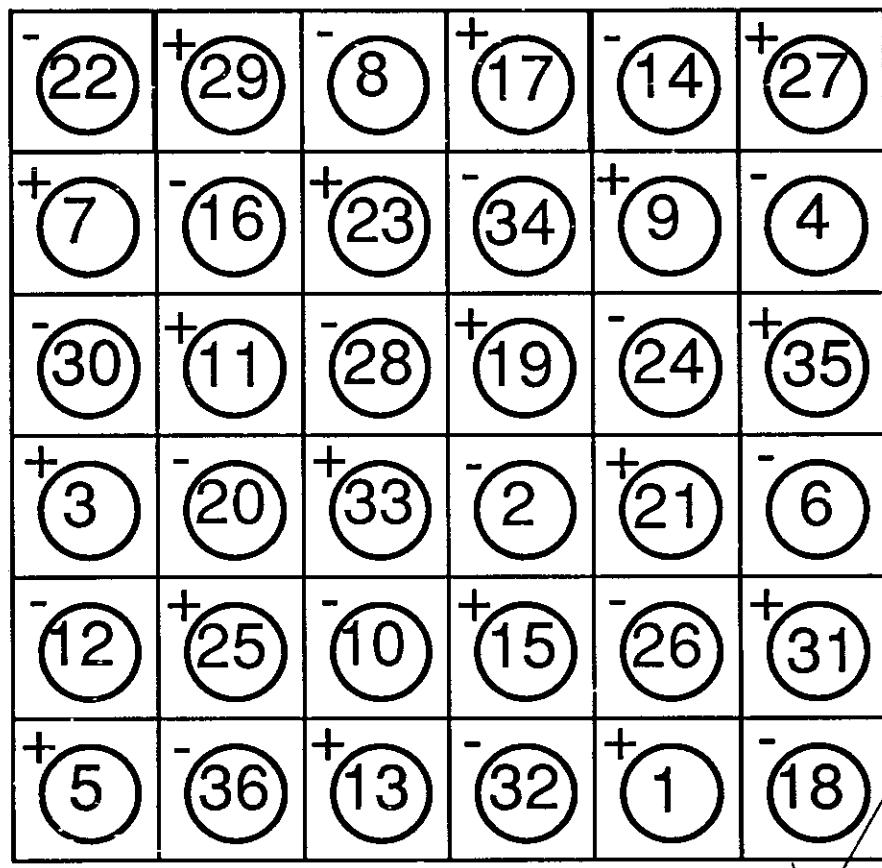


periodic boundary conditions
in X-Y plane

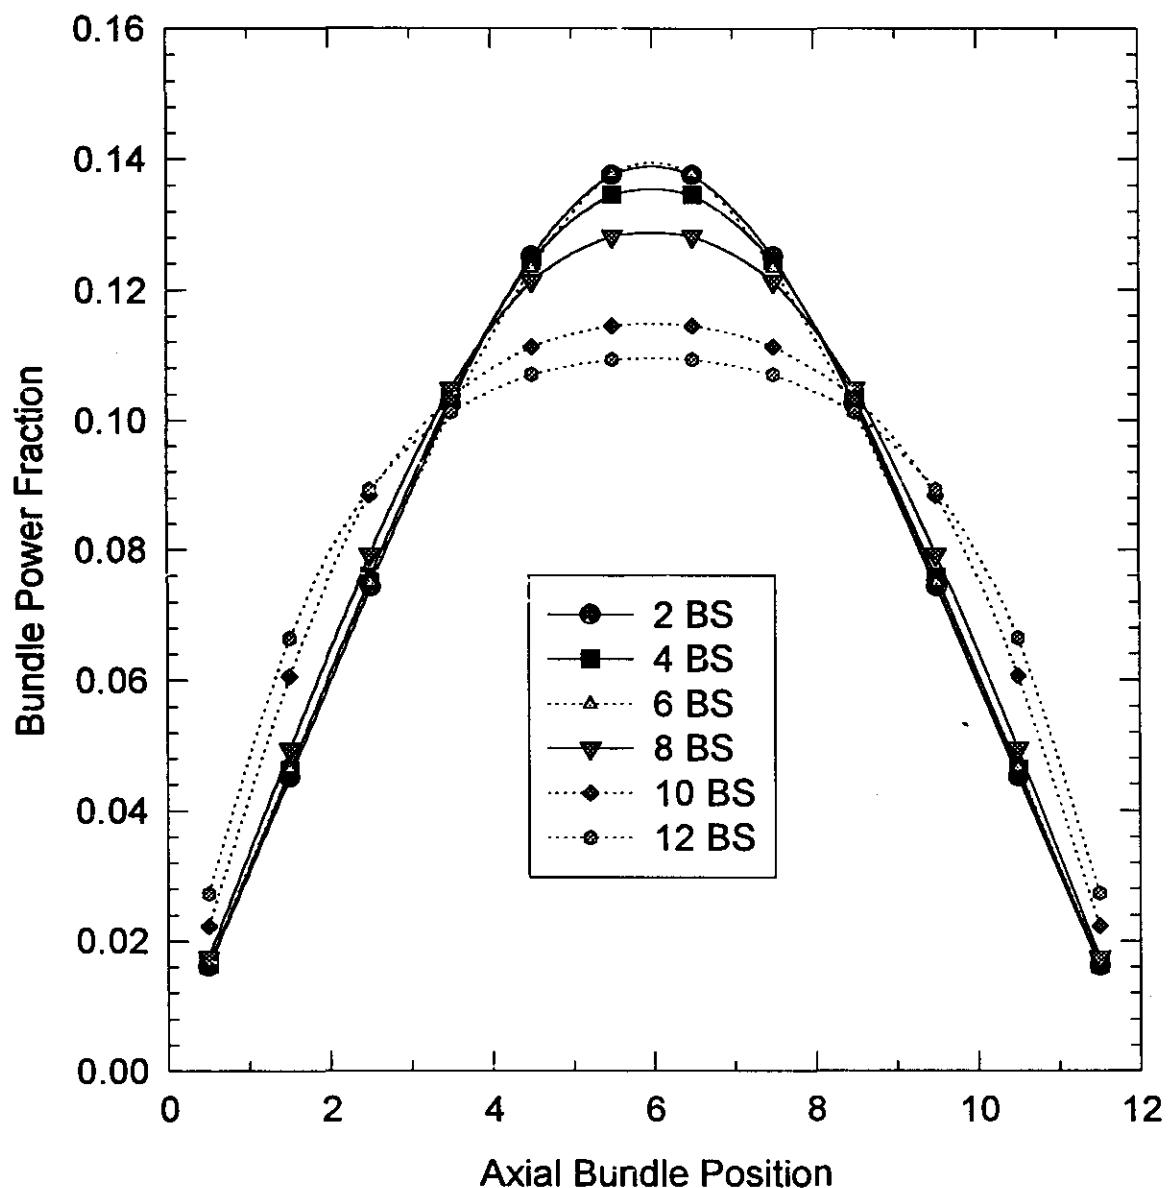


**Bundle Powers in an Average Channel with Various
Bundle Shift Strategies (NAT. U)**

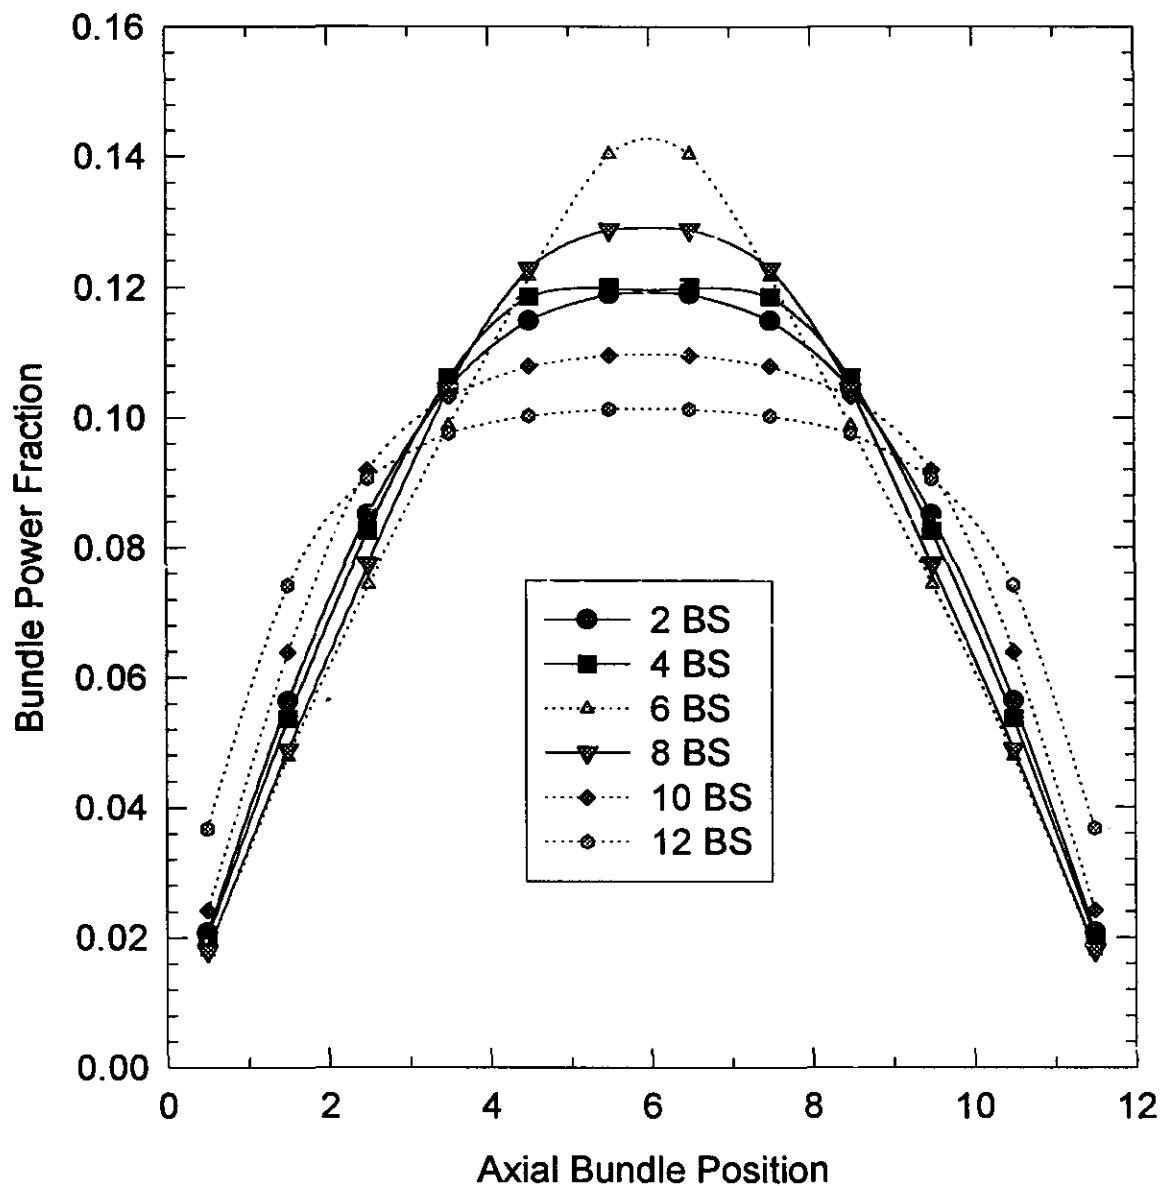


**Bundle Powers in an Average Channel with Various
Bundle Shift Strategies (SEU, 0.9 w/o)**

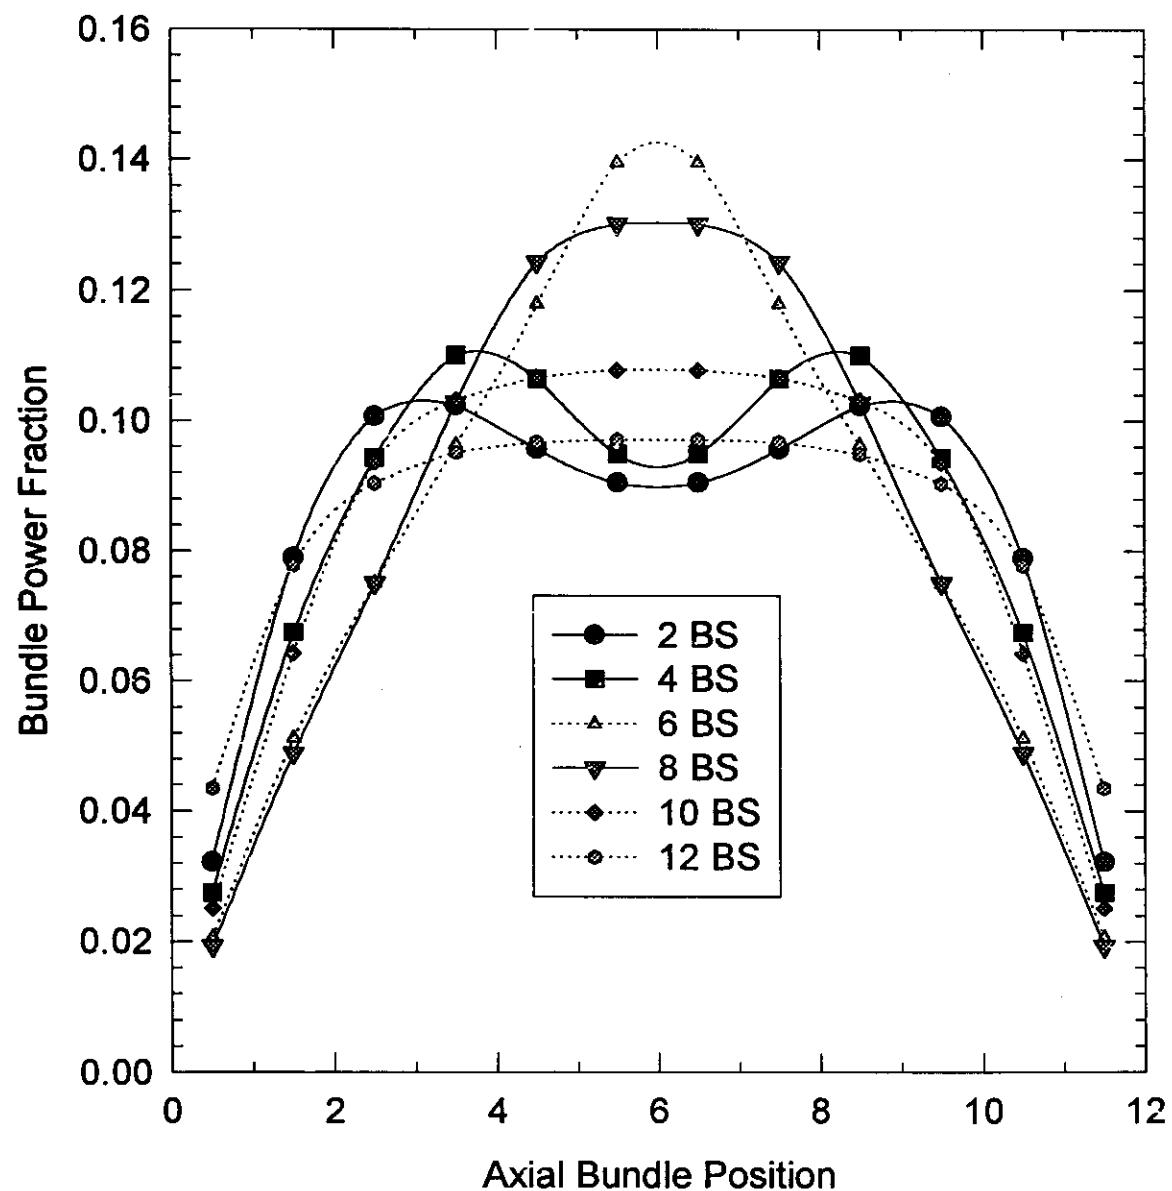

**Bundle Powers in an Average Channel with Various
Bundle Shift Strategies (SEU, 1.2 w/o)**

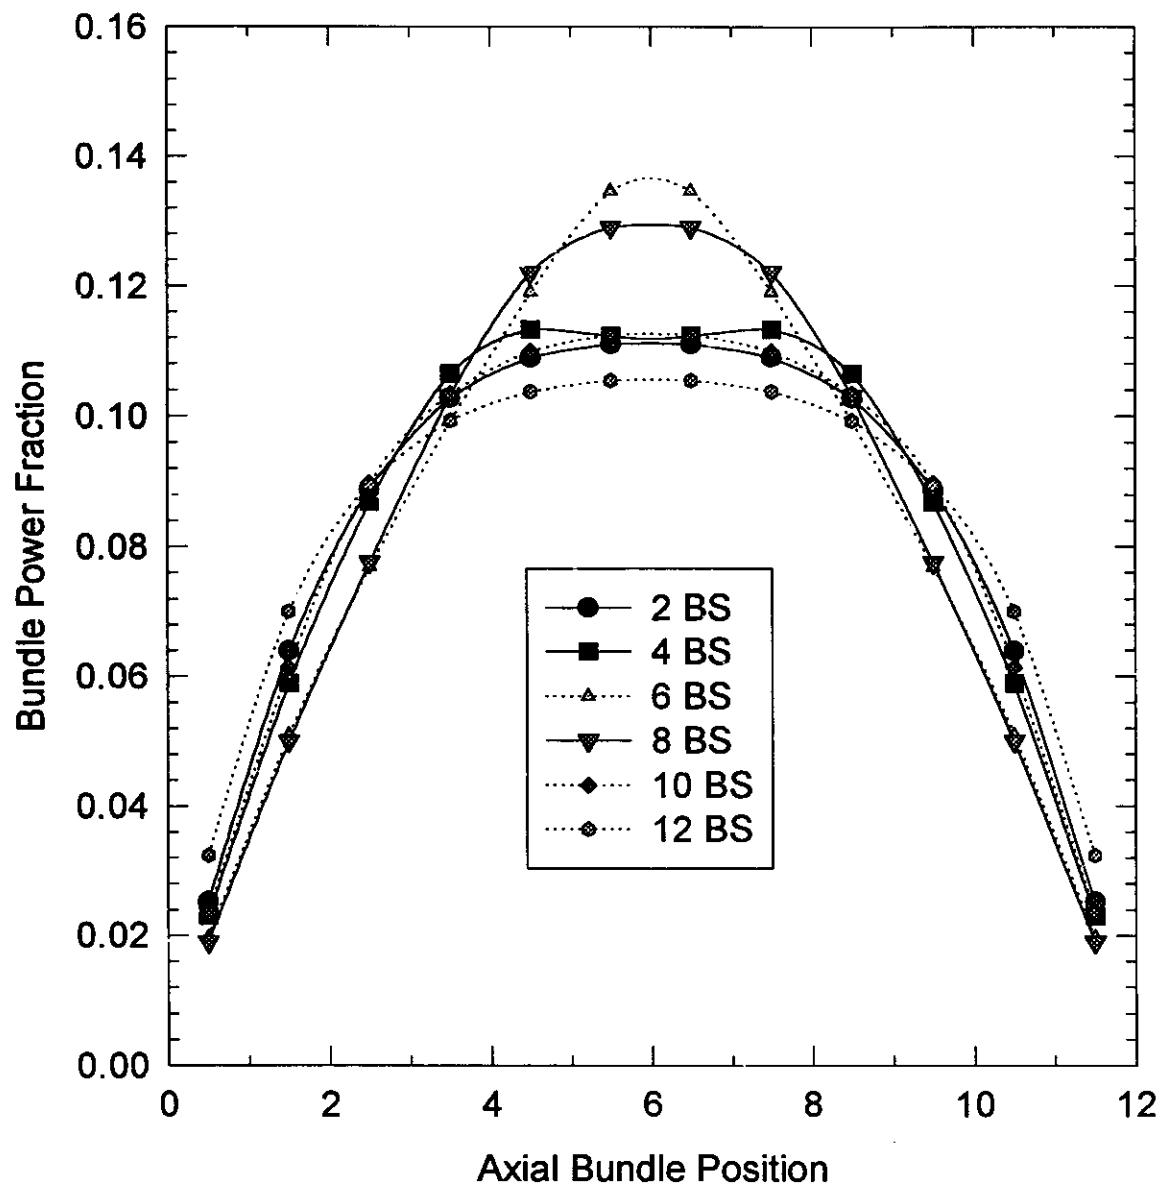


**Bundle Powers in an Average Channel with Various
Bundle Shift Strategies (MOX, 0.9 w/o)**

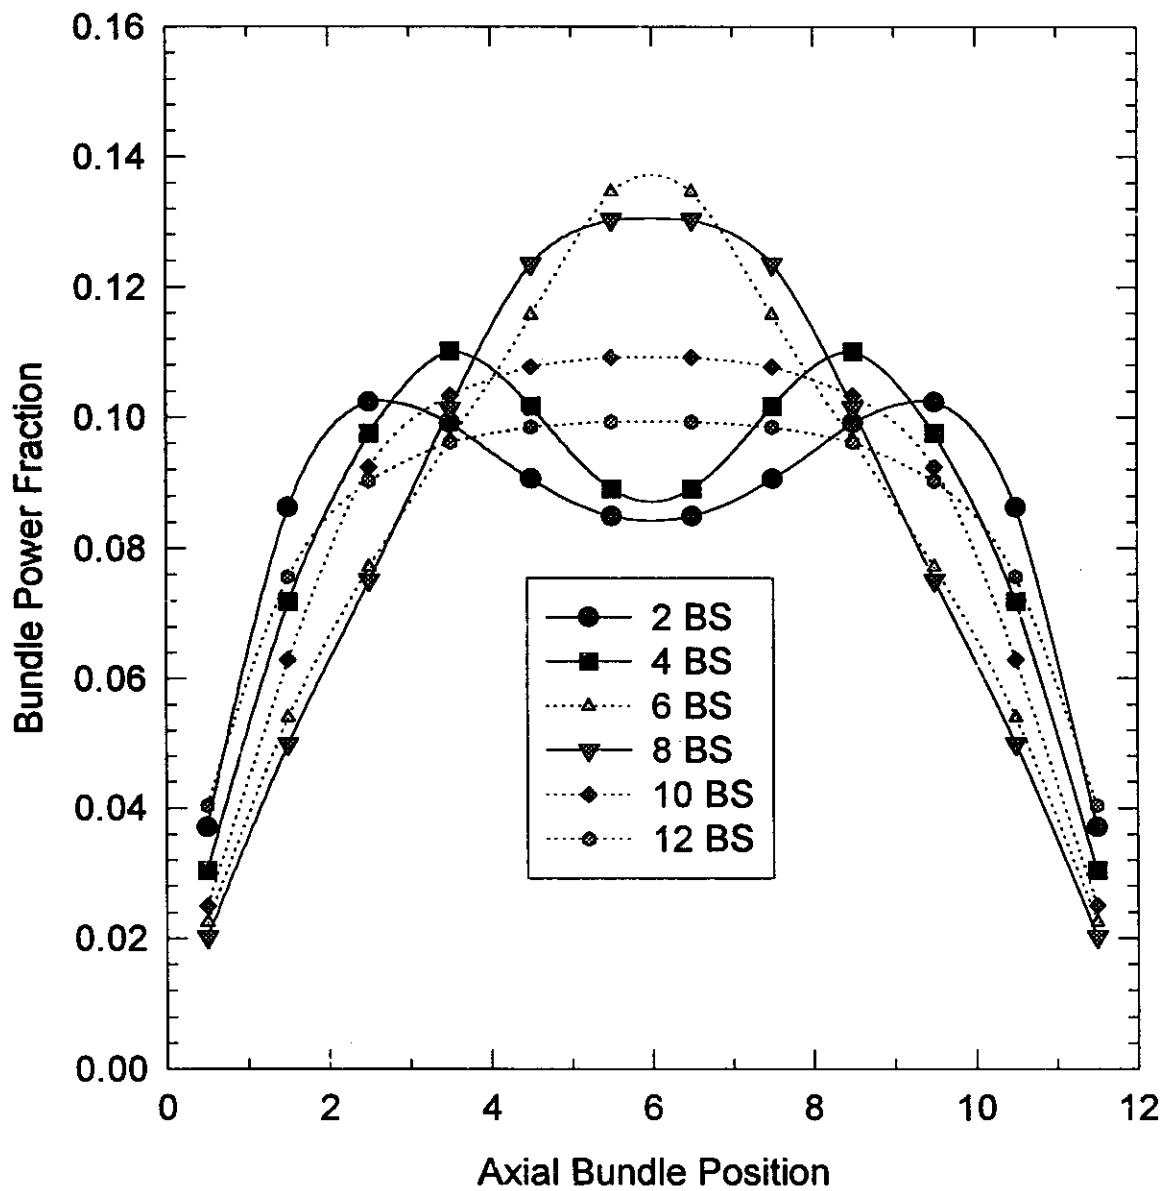

**Bundle Powers in an Average Channel with Various
Bundle Shift Strategies (MOX, 1.2 w/o)**

●	NAT. U
■	SEU 0.9 w/o
▲	SEU 1.2 w/o
▼	MOX 0.9 w/o
◆	MOX 1.2 w/o
- - -	CPPF Limit

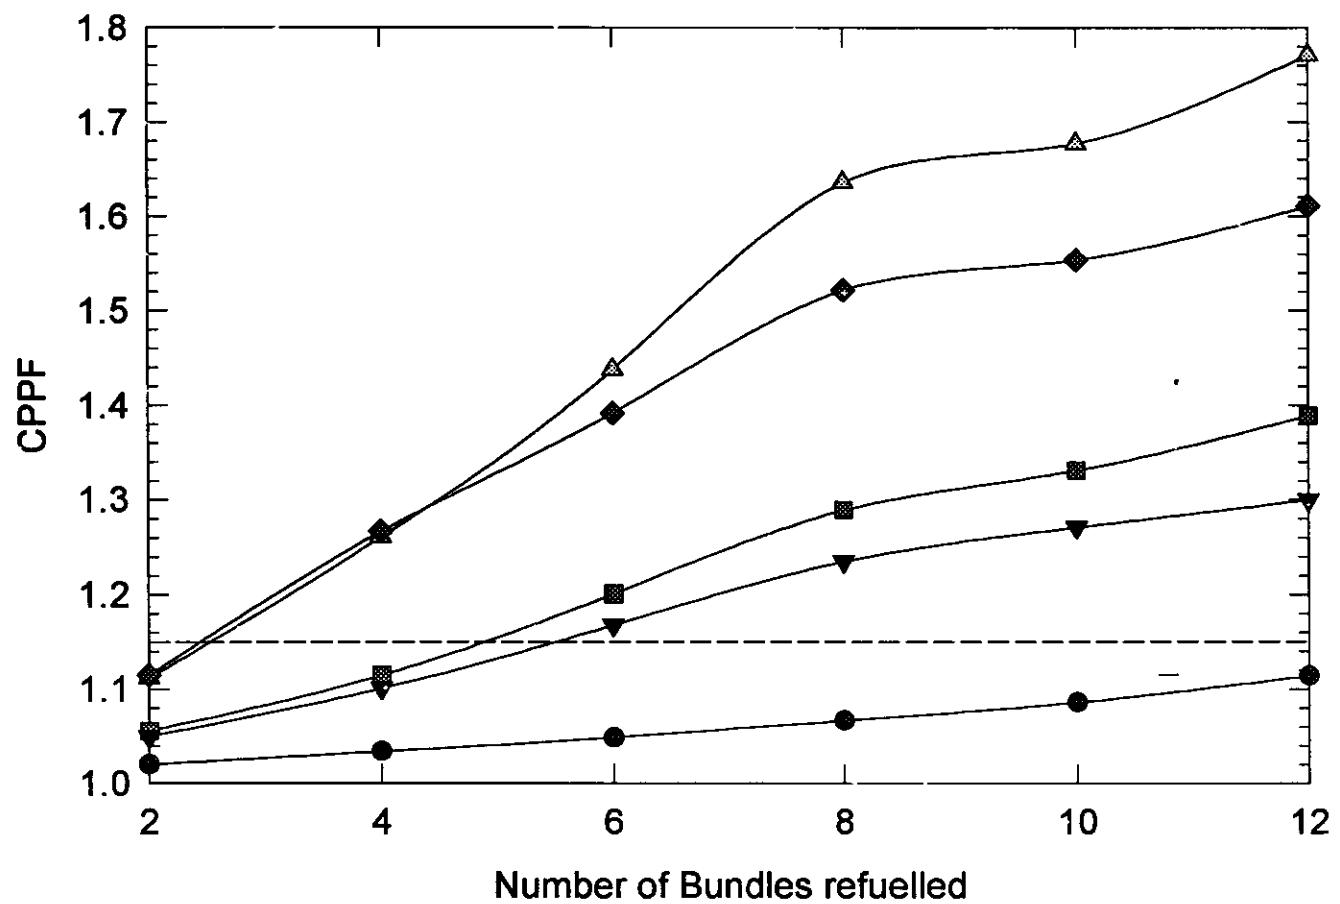

**Channel Power Peaking Factors(CPPF)
vs. Bundle Shift Strategy
(36 Full Channels Caculation)**

Refueling Sequence for Age Map in DONJON

Block Sequence

7	11	1	9
13	3	15	5
6	16	4	14
10	2	12	8

Refueling Sequence in odd blocks

22	29	8	17	14	27
7	16	23	34	9	4
30	11	28	19	24	35
3	20	33	2	21	6
12	25	10	15	26	31
5	36	13	32	1	18

Refueling Sequence in even blocks

21	28	7	16	13	26
6	15	22	33	8	3
29	10	27	18	23	34
2	19	32	1	20	5
11	24	9	14	25	30
4	35	12	31	36	17



Refueling Sequence in the Whole Core

		358	91	39	67	162	234																
		315	113	294	196	248	366	309	109	287	191	245	363										
		59	33	208	346	19	219	61	25	202	340	14	213	55	31								
		271	322	123	261	103	156	273	323	118	254	97	149	265	318	122	260						
		333	7	184	51	377	135	334	8	185	44	371	127	327	1	179	50	376	133				
		176	145	283	226	301	79	173	142	279	232	307	86	177	147	285	228	303	81				
		241	360	93	40	69	164	236	353	88	37	76	171	243	361	95	42	71	166	238	355		
		296	198	250	367	311	110	289	193	246	364	316	116	298	200	252	369	313	112	291	195		
		210	348	21	221	63	27	204	342	16	215	57	35	211	350	23	223	65	29	206	344	18	217
		262	105	158	275	324	119	256	99	151	267	319	125	263	107	160	276	325	121	258	101	153	269
		378	137	336	10	187	46	372	129	329	3	181	53	379	139	338	12	189	48	374	131	331	5
		292	72	167	132	270	224	299	77	172	140	277	216	290	70	165	130	268	222	297	75	170	138
		154	229	345	82	30	66	161	233	351	87	36	58	152	227	343	80	28	64	159	231	349	85
		102	281	183	239	356	308	108	286	190	244	362	302	100	280	182	237	354	306	106	284	188	242
		332	6	207	49	24	201	339	13	212	54	17	194	330	4	205	47	22	199	337	11		
		90	144	259	314	117	253	96	148	264	317	111	247	89	143	257	312	115	251	94	146		
		321	375	175	43	370	126	326	380	178	38	365	120	320	373	174	41	368	124				
		168	134	272	214	288	68	163	128	266	220	295	74	169	136	274	218	293	73				
		83	32	56	150	225	341	78	26	62	157	230	347	84	34	60	155						
		357	300	98	278	180	235	352	305	104	282	186	240	359	304								
		15	192	328	2	203	45	20	197	335	9	209	52										
		141	255	310	114	249	92																

CPPF

FUEL TYPE	BS	AVERAGE EXIT BURNUP MWd/T(U)	CPPF
Nat. U	2	7710	1.021 (P18)
	4	7668	1.038(V12)
	8	7613	1.079 (E16)
SEU 0.9 w/o	2	14226	1.051 (P18)
	4	14292	1.104 (E16)
	8	14768	1.235 (E16)
SEU 1.2 w/o	2	21715	1.086 (L10)
	4	22169	1.191 (E16)
	8	23799	1.458 (P18)
MOX 0.9 w/o	2	5931	1.043(N17)
	4	6051	1.098 (E16)
	8	6327	1.258 (E16)
MOX 1.2 w/o	2	12454	1.094 (L10)
	4	12796	1.211 (E16)
	8	13907	1.505 (E16)

- CPPF increases significantly with enrichment (ϵ) and decreases when bundle shift (n) is reduced:
 \Rightarrow 2 BS is required for enrichment above 1%
- axial flux shape is significantly affected by combined effect of bi-directional bundle scheme and enrichment:
 - o 36 channel supercell can be used to find correlation between CPPF and $(\epsilon, n, B) \Rightarrow$ optimization with T/A model alone (ex. OPTEX-4)
 - o optimization of refueling sequence within blocks for age pattern in full core calculations

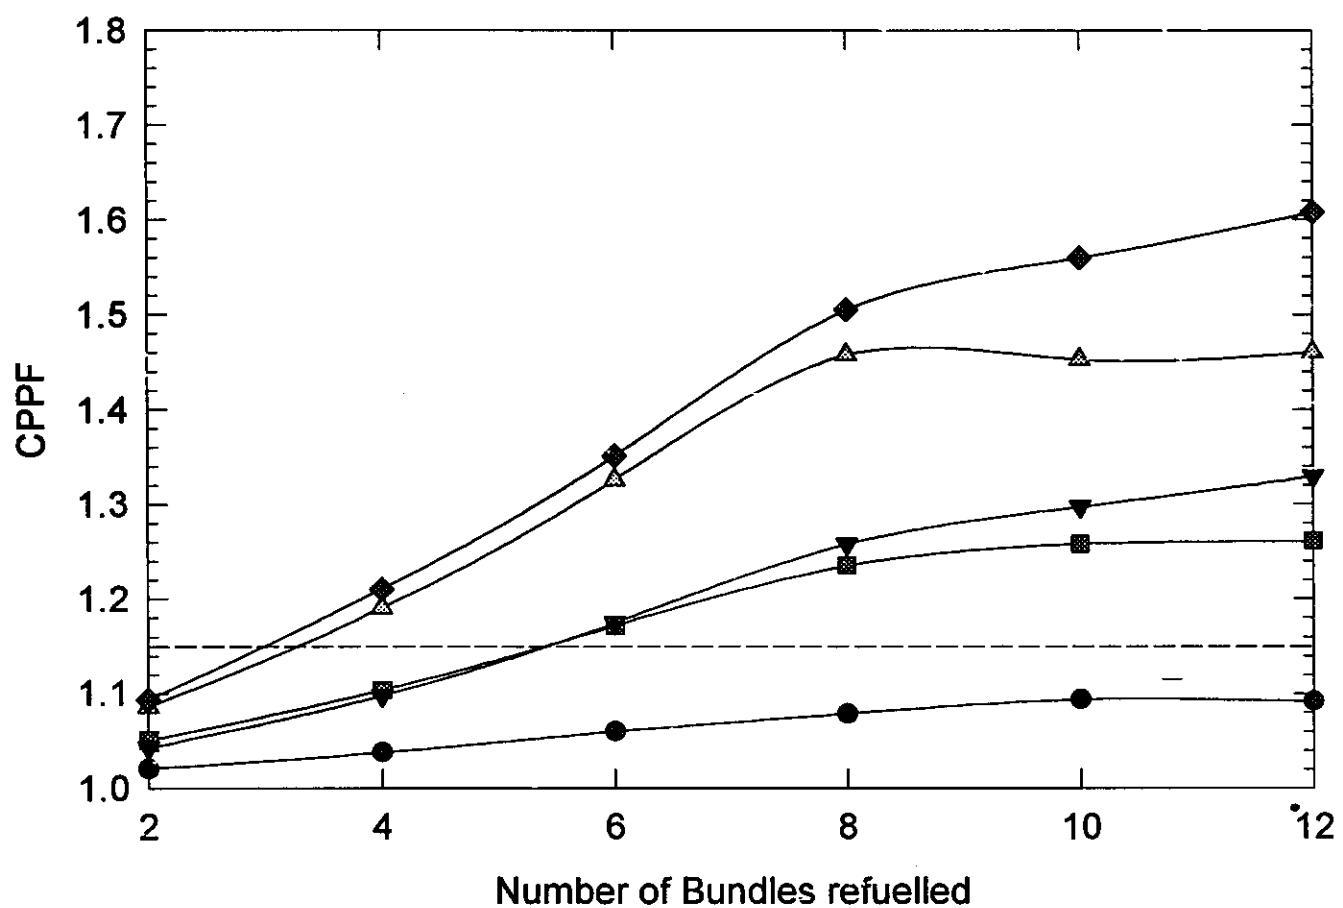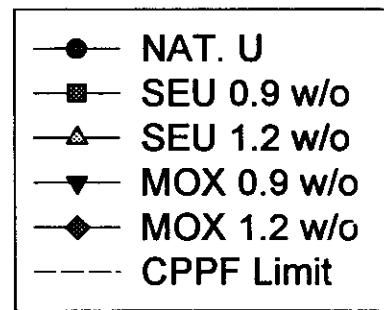

**Channel Power Peaking Factors(CPPF)
vs. Bundle Shift Strategy
(Full Core Caculation)**

6. DUPIC

- Direct use of PWR fuel in CANDU:
 - spent fuel in PWR contains ≈ 1.5 g/kg of fissile material (U+Pu):
 - \Rightarrow chemical reprocessing for recycle of U and Pu in LWR or FBR (Europe, Japan, ...)
 - \Rightarrow remove sheath and create new powder for resintering and remote fabrication of CANDU fuel bundle
- Questions:
 1. What burnup can be achieved in CANDU using PWR fuel after a 10 y cooldown period?
 2. Is performance of DUPIC fuel in CANDU only a function of the burnup of the spent PWR assemblies?
 3. Sensitivity of DUPIC performance characteristics to the uncertainty in initial nuclide field.
- DRAGON/DONJON analysis of DUPIC:¹

PWR 900 (Daya Bay) \Rightarrow CANDU 6 (CANFLEX fuel)

 - same ENDF-B5 library used for both lattices (89 groups)
 - reference (nominal 3.2% enriched replacement fuel)
 - \Rightarrow exit burnup: 30-35 GWd/TeU
 - axial distribution of burnup in PWR assembly (local parameters)
 - use of burnable poisons (PWR and CANDU)
 - increase initial enrichment in PWR:
 $3.2\% \text{ (30 GWd/TeU)} \Rightarrow 3.5\% \text{ (35 GWd/TeU)}$

¹ Calculations performed by Dr Shen Wei, post-doctoral fellow at IGN.
Results are preliminary.

Generating Nuclide Fields of Spent PWR Fuel with DRAGON


- PWR cell/assembly

- 17X17 assembly, water gap
- 264 fuel pins + 24 guide tubes + 1 instrument thimble
- nominal conditions:
 - o power density 39.95 kW/kg
 - o fuel density: 10.41 g/cc (460 kg/assembly)
 - o fuel temperature: 671.6 °C
 - o moderator temp.: 311.7 °C
- Burnable Poison (BP) assembly:
 - o Boron-silicate glass, 16 or 12 BP rods


- Local Parameters


case	power density	moderator temperature	fuel temperature
top	80%	325 °C	615 °C
center	120%	312 °C	769 °C
bottom	80%	293 °C	583 °C
nominal	100%	312 °C	672 °C

a) Power Cycles

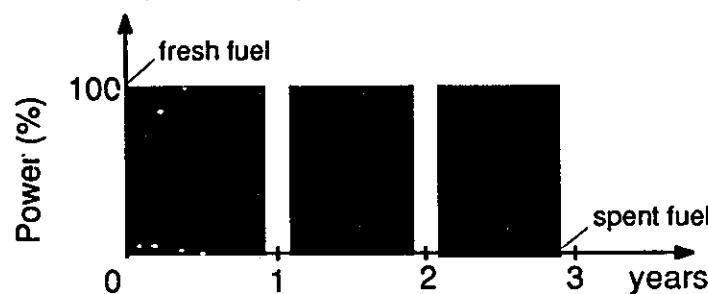


b) Boron Letdown Curve

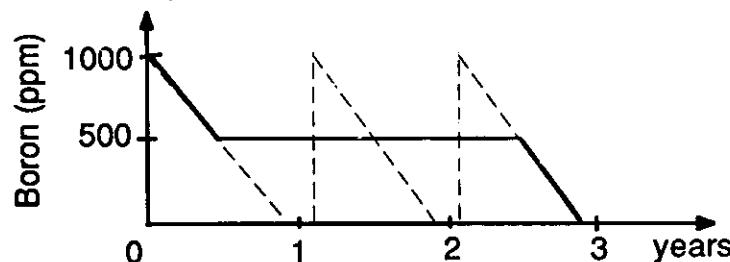


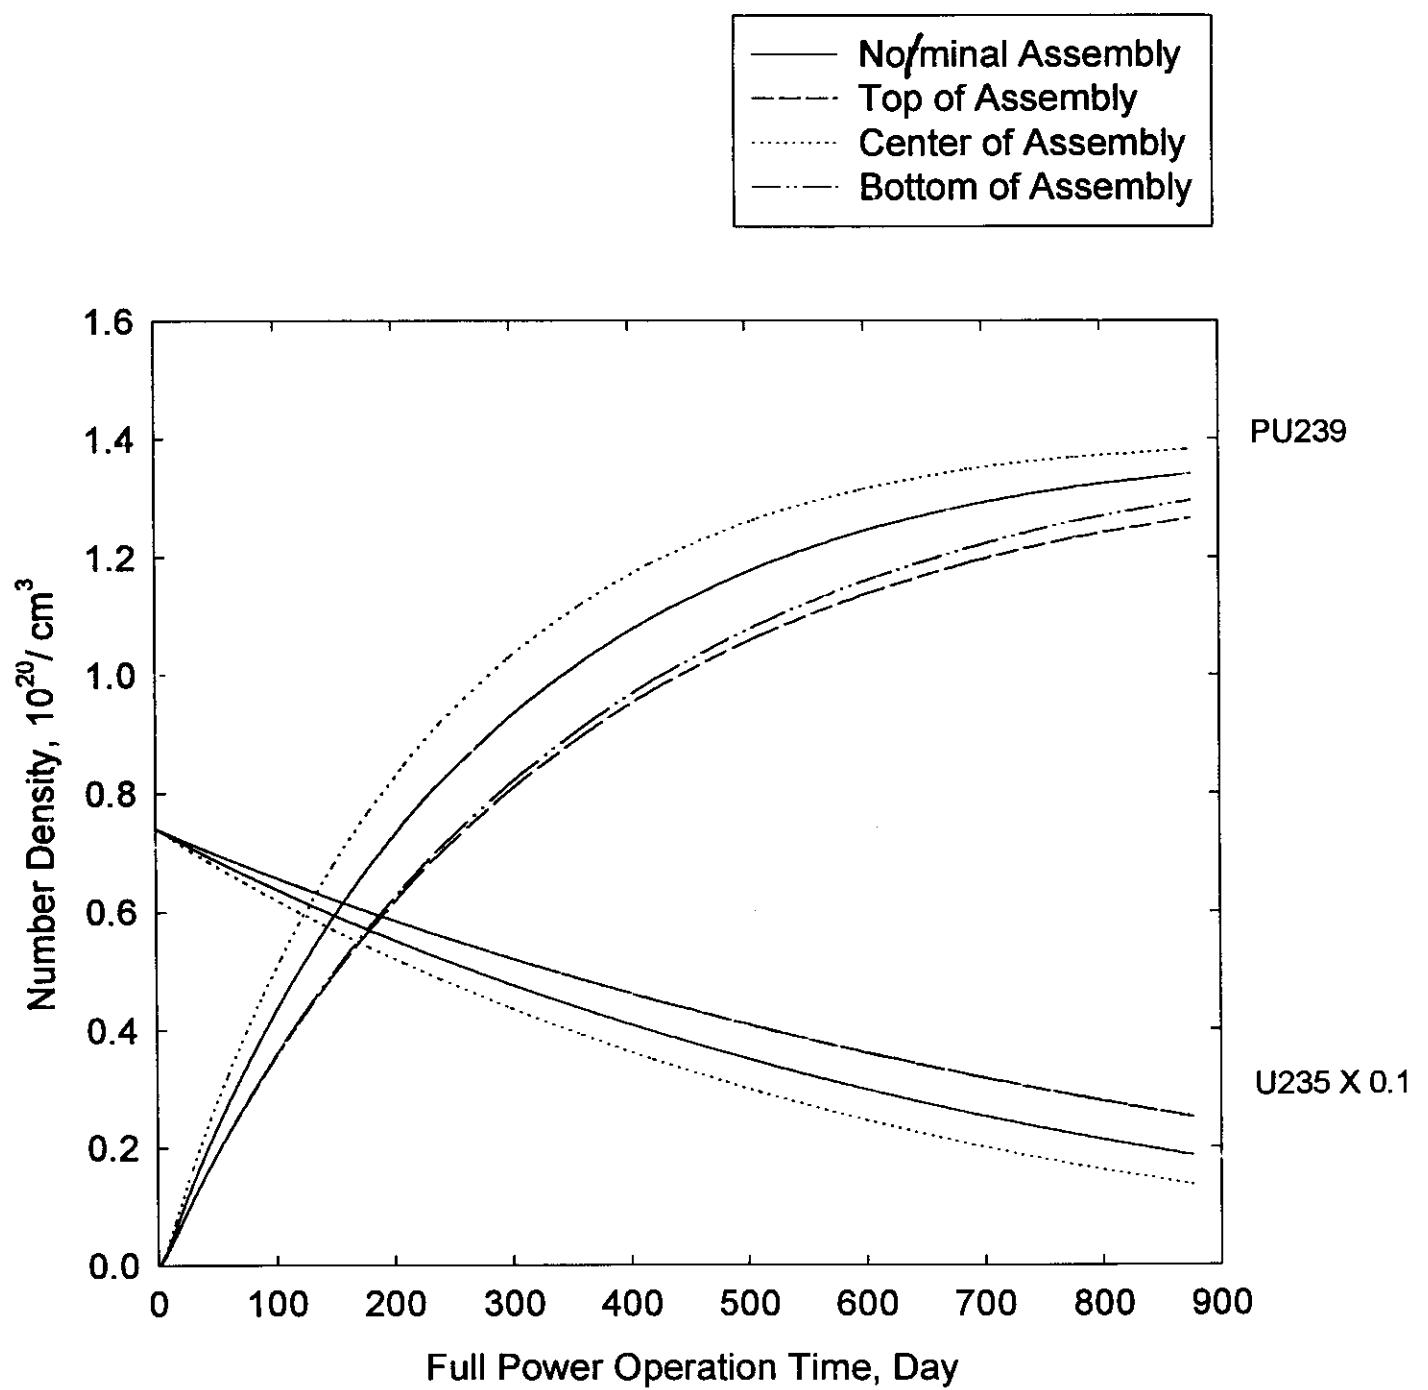


**Variation of PWR Assembly Number Density versus Operation Time
(3.2 w/o, No BP)**

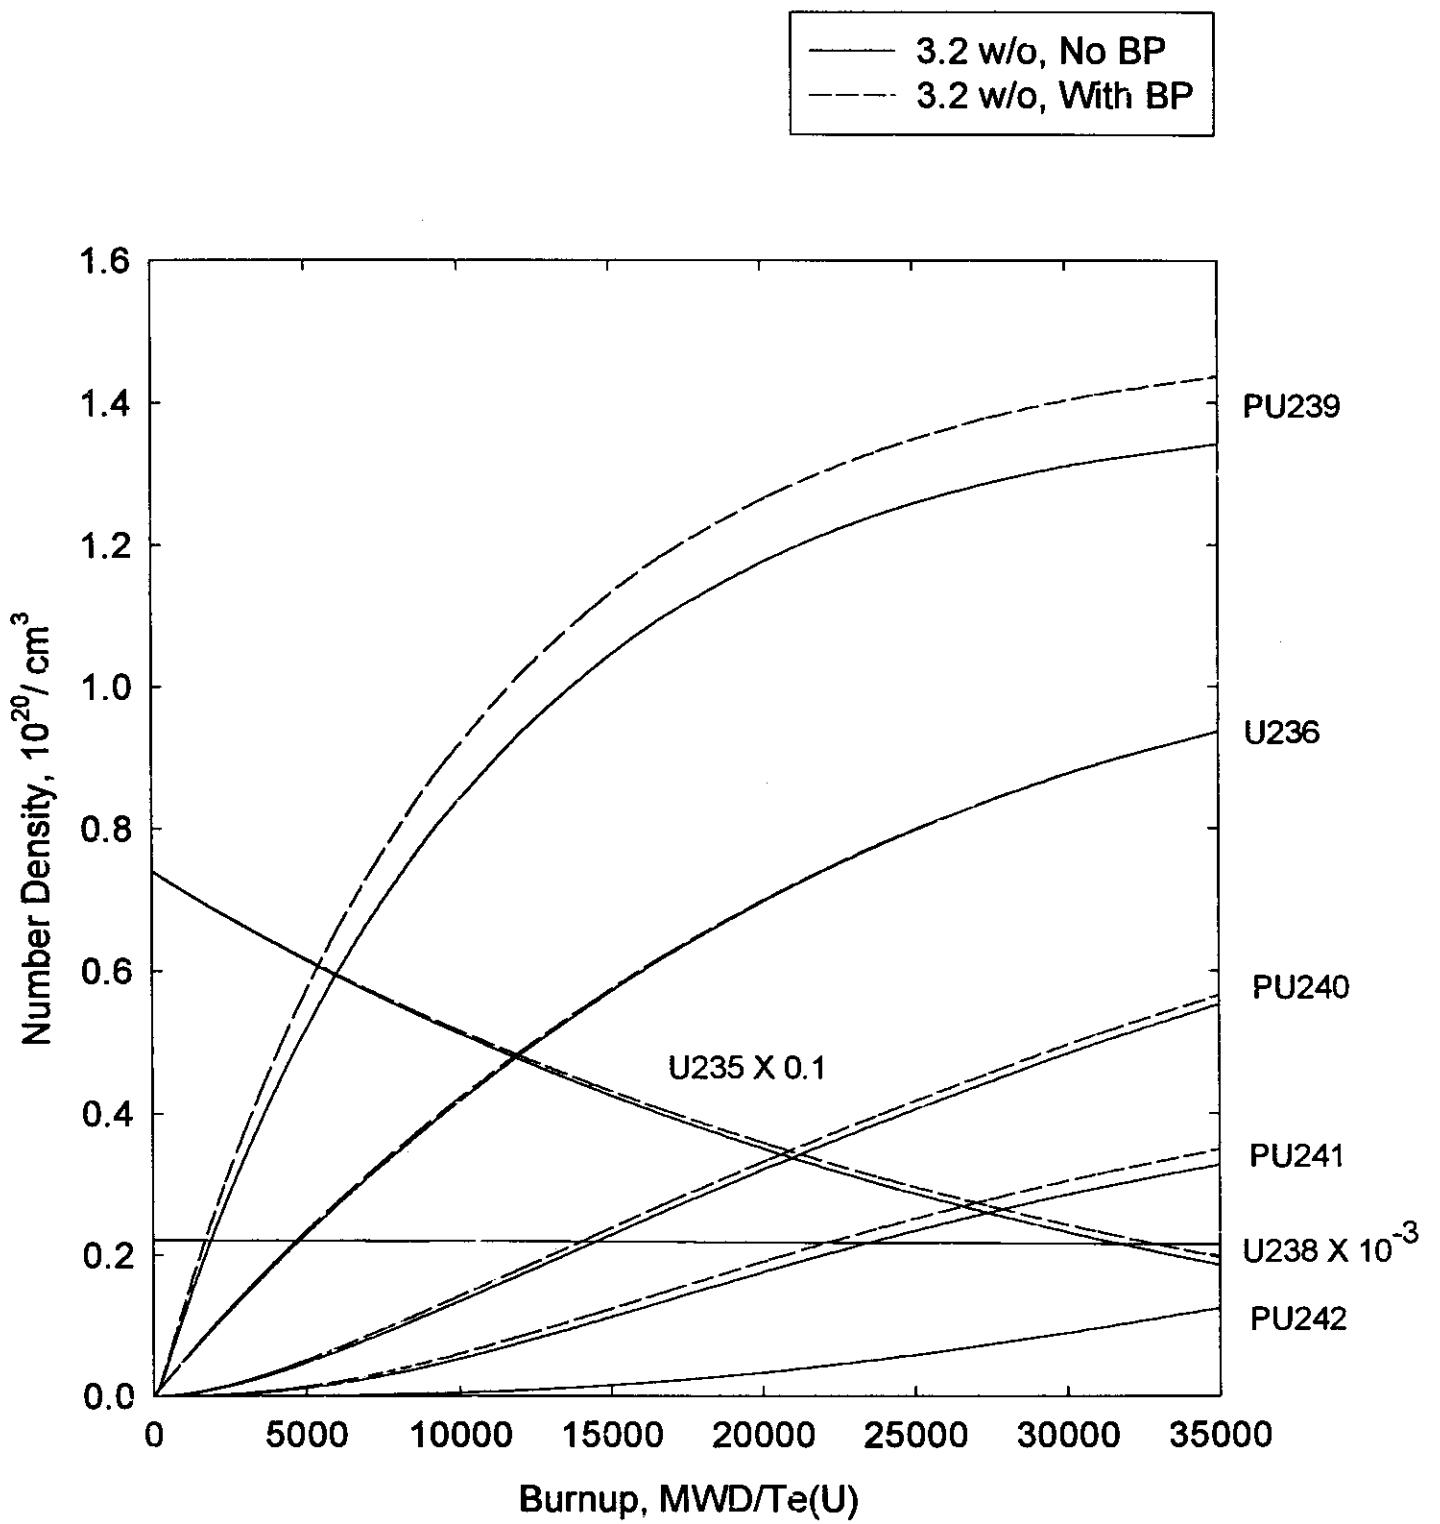

Variation of PWR Fuel Number Density versus Burnup

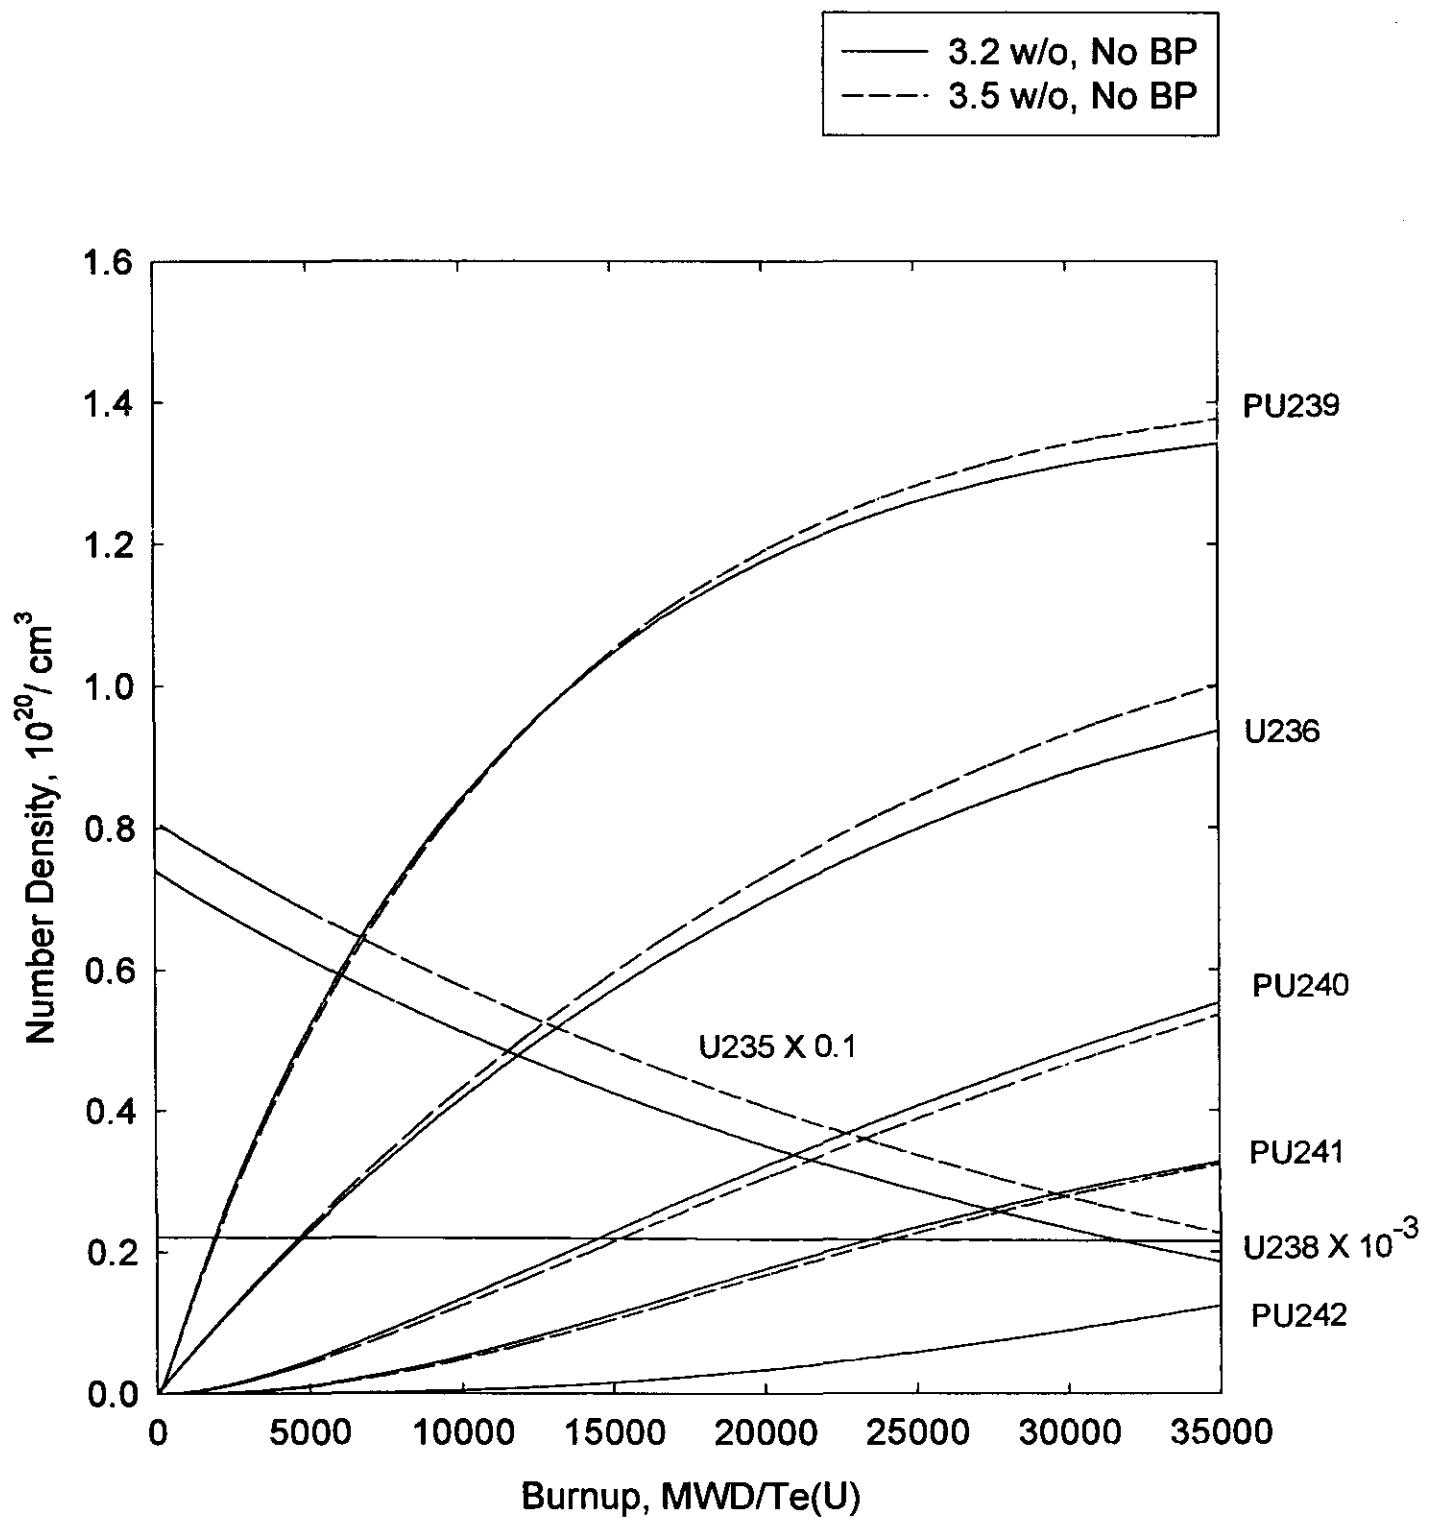


Variation of PWR Fuel Number Density versus Burnup

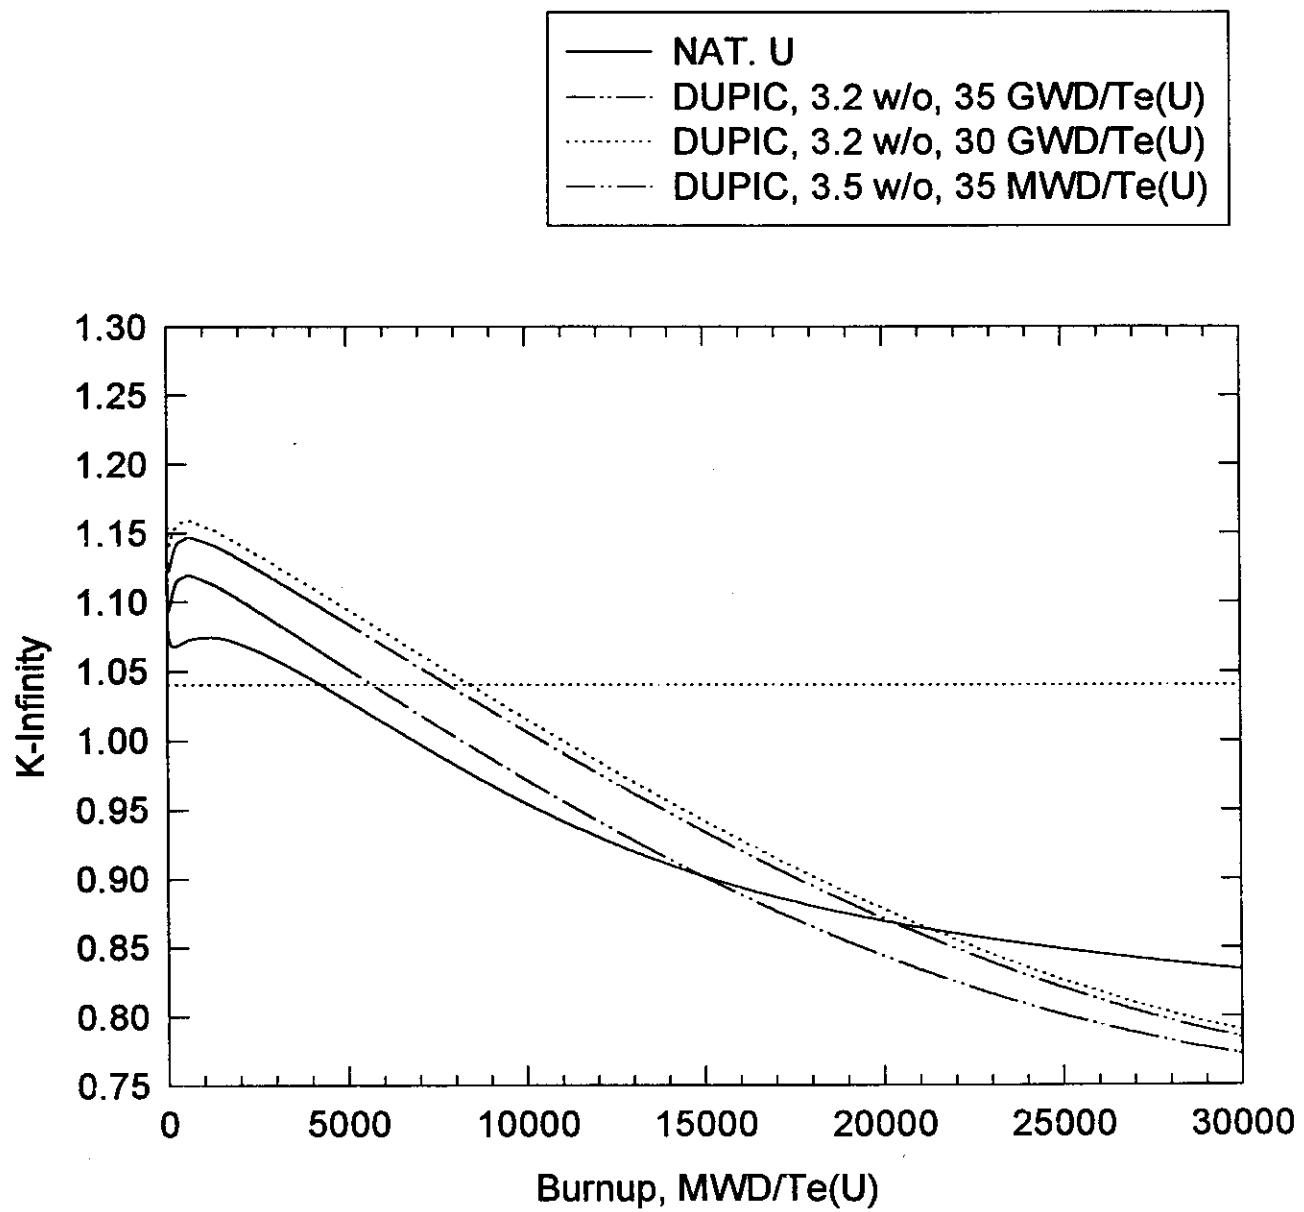


Lattice K-infinity vs. Burnup for Different Fuels


●	2 BS
■	4 BS
△	8 BS

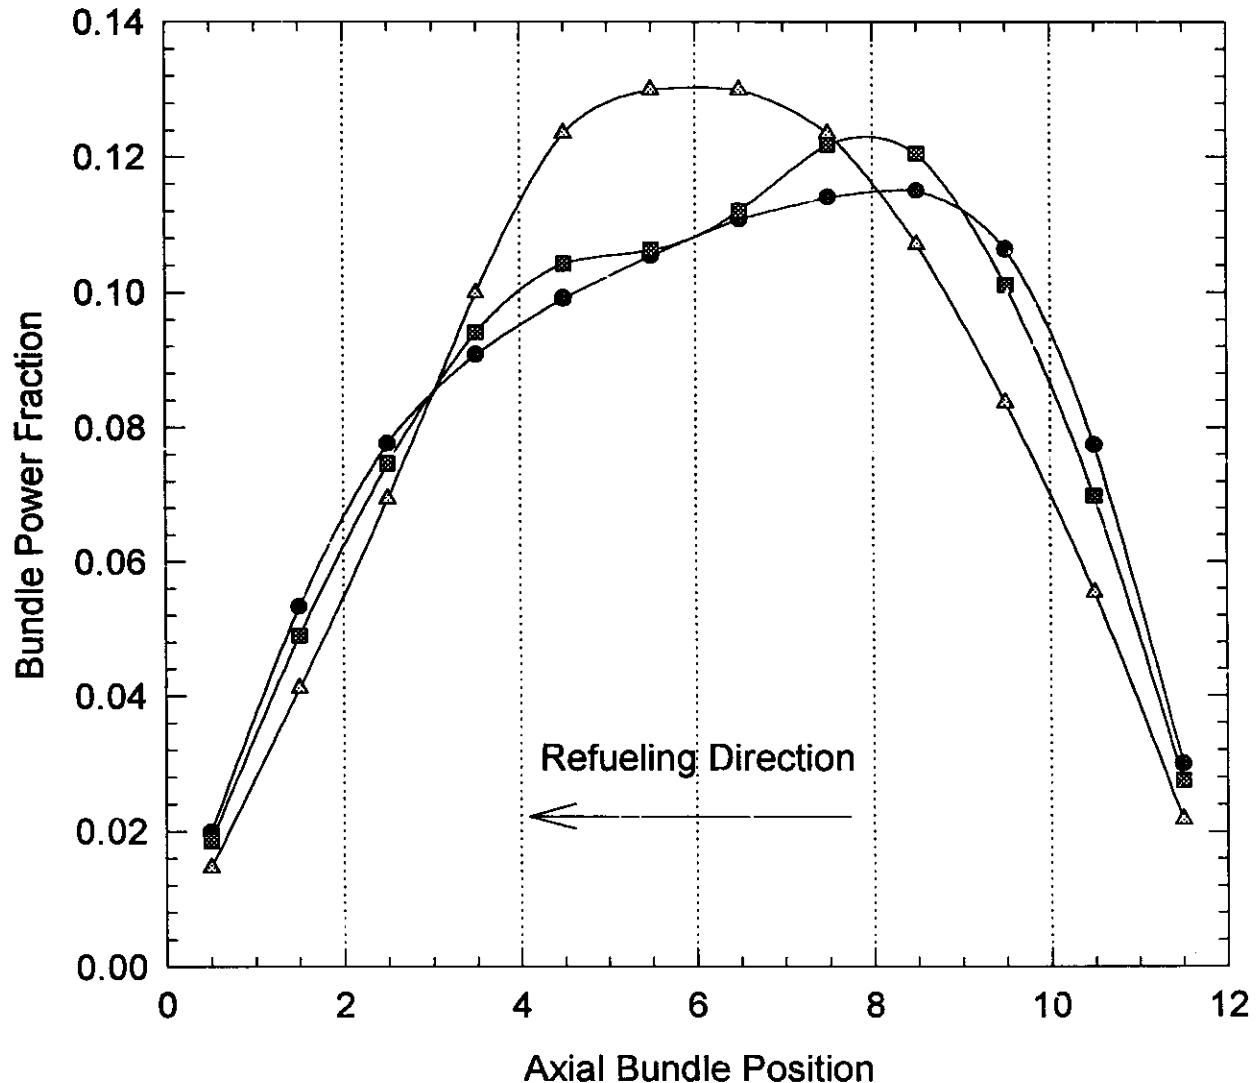

**Typical Time-Average Axial Power Profiles
(DUPIC, 3.2 w/o, 30 GWD/Te(U), Channel L3)**

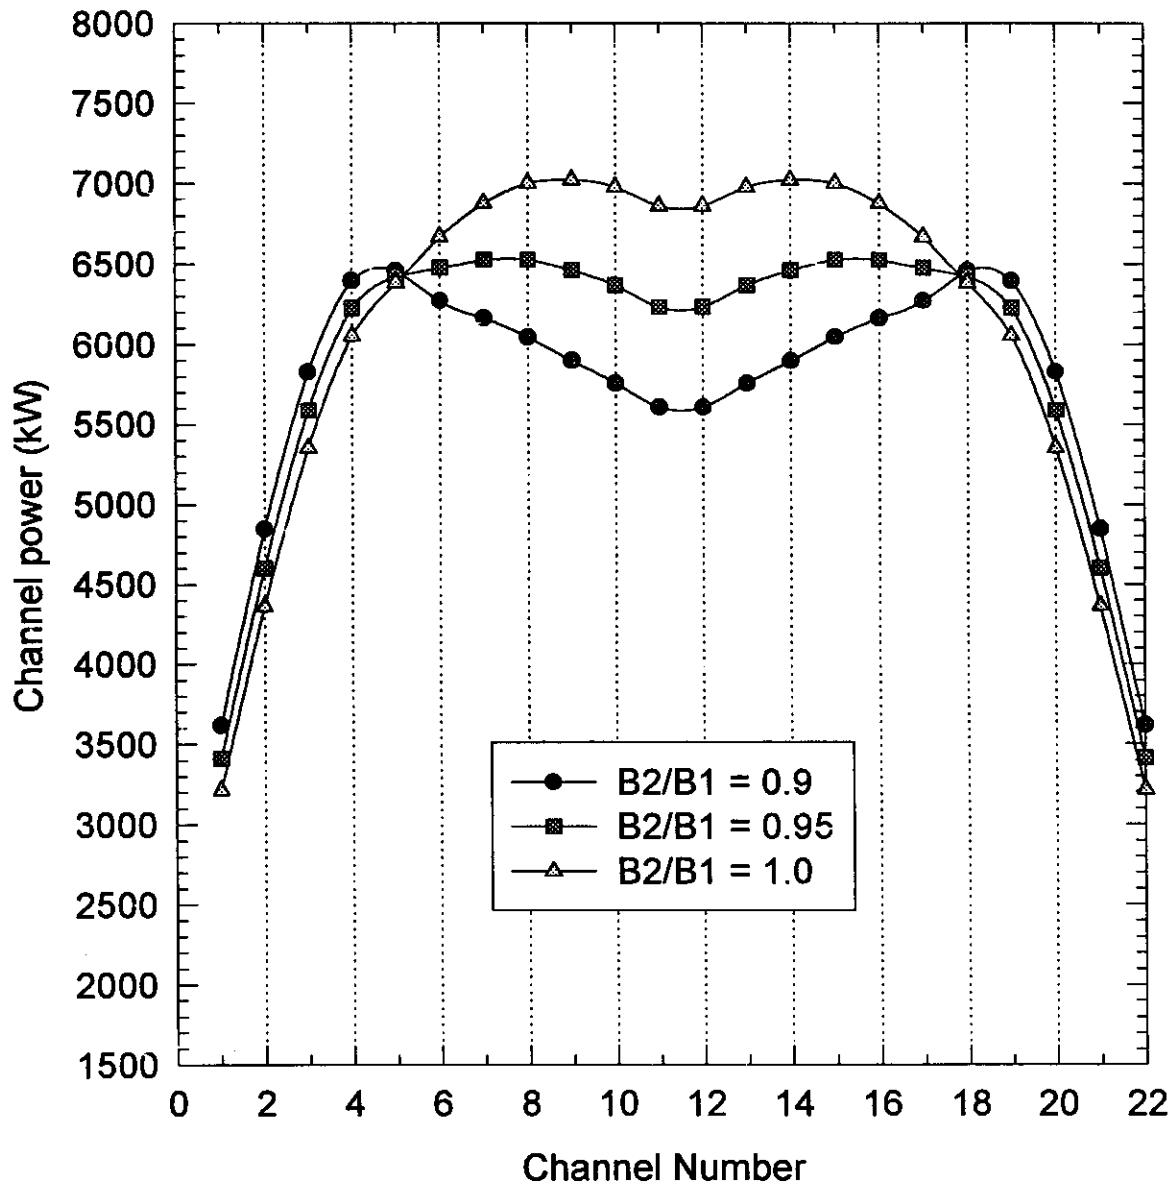

Radial Channel Power Profiles
(DUPIC, 3.2 w/o, 35 GWD/Te(U), 2 BS, Row L)

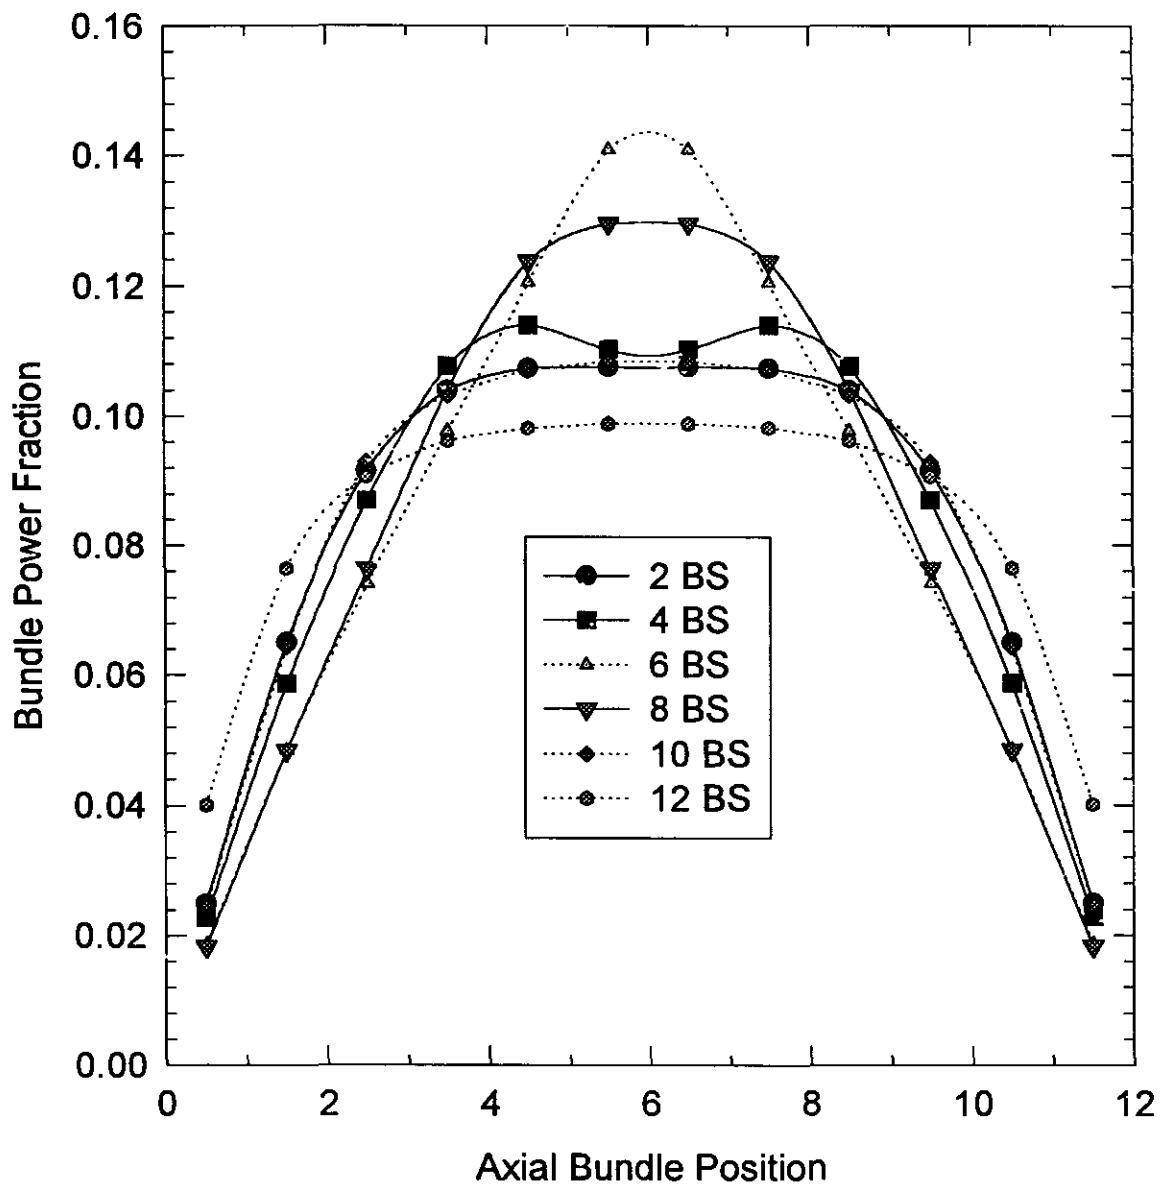

Bundle Powers in an Average Channel with Various Bundle Shift Strategies (DUPIC, 3.2 w/o, 30 GWD/Te(U))

Numerical Results


Characteristics of DUPIC Core (CANFLEX, with BP)

SPENT PWR FUEL TYPE	BS	AVERAGE EXIT BURNUP MWd/T(U)	ADJUSTER WORTH (mk)
Nat. U	2	7710	17.49
	4	7668	17.62
	8	7613	16.64
3.2 w/o 35 GWD/Te(U)	2	11765	11.45
	4	11833	11.79
	8	12298	12.55
3.2 w/o 30 GWD/Te(U)	2	16702	9.72
	4	16970	11.40
	8	17934	12.80
3.5 w/o 35 GWD/Te(U)	2	15878	9.63
	4	15652	11.55
	8	16700	12.57

SPENT PWR FUEL TYPE	BS	PEAK CHANNEL POWER (MW)	PEAK BUNDLE POWER (KW)	CPPF
Nat. U	2	7252 (J11)	868 (E12,6)	1.021 (P18)
	4	7231 (J11)	839 (E12,6)	1.038 (V12)
	8	6991 (H8)	837 (E12,6)	1.079 (E16)
3.2 w/o 35 GWD/Te(U)	2	6745 (G15)	766 (J14,3)	1.049 (P18)
	4	6731 (F15)	792 (H15,4)	1.102 (P18)
	8	6889 (H15)	856 (E12,6)	1.243 (P18)
3.2 w/o 30 GWD/Te(U)	2	6872 (E9)	781 (E14,4)	1.067 (N17)
	4	6765 (F15)	830 (F15,4)	1.141 (P18)
	8	6872 (H8)	863 (H7,7)	1.357 (P18)
3.5 w/o 35 GWD/Te(U)	2	6572 (F15)	819 (F15,4)	1.062 (P18)
	4	6846 (E14)	778 (F15,4)	1.131 (N17)
	8	6878 (H15)	861 (H16,6)	1.326 (P18)

DUPIC Results

- reference DUPIC cycle similar to SEU 0.9
- initial nuclide field in DUPIC sensitive to:
 - PWR assembly burnup: $\frac{\Delta B_{DUPIC}}{\Delta B_{PWR}} \approx -1$
 - PWR local parameters
 - PWR initial enrichment (same burnup)
- with 2BS, CPPF is smaller than with Natural uranium cycle
- axial power shape similar to SEU
- other considerations:
 - CANDU local parameters
 - void effect (influence of B.P.)
 - xenon
 - control rod worth
 - heterogeneity : uncertainty in CPPF due to uncertainty in initial nuclide field.

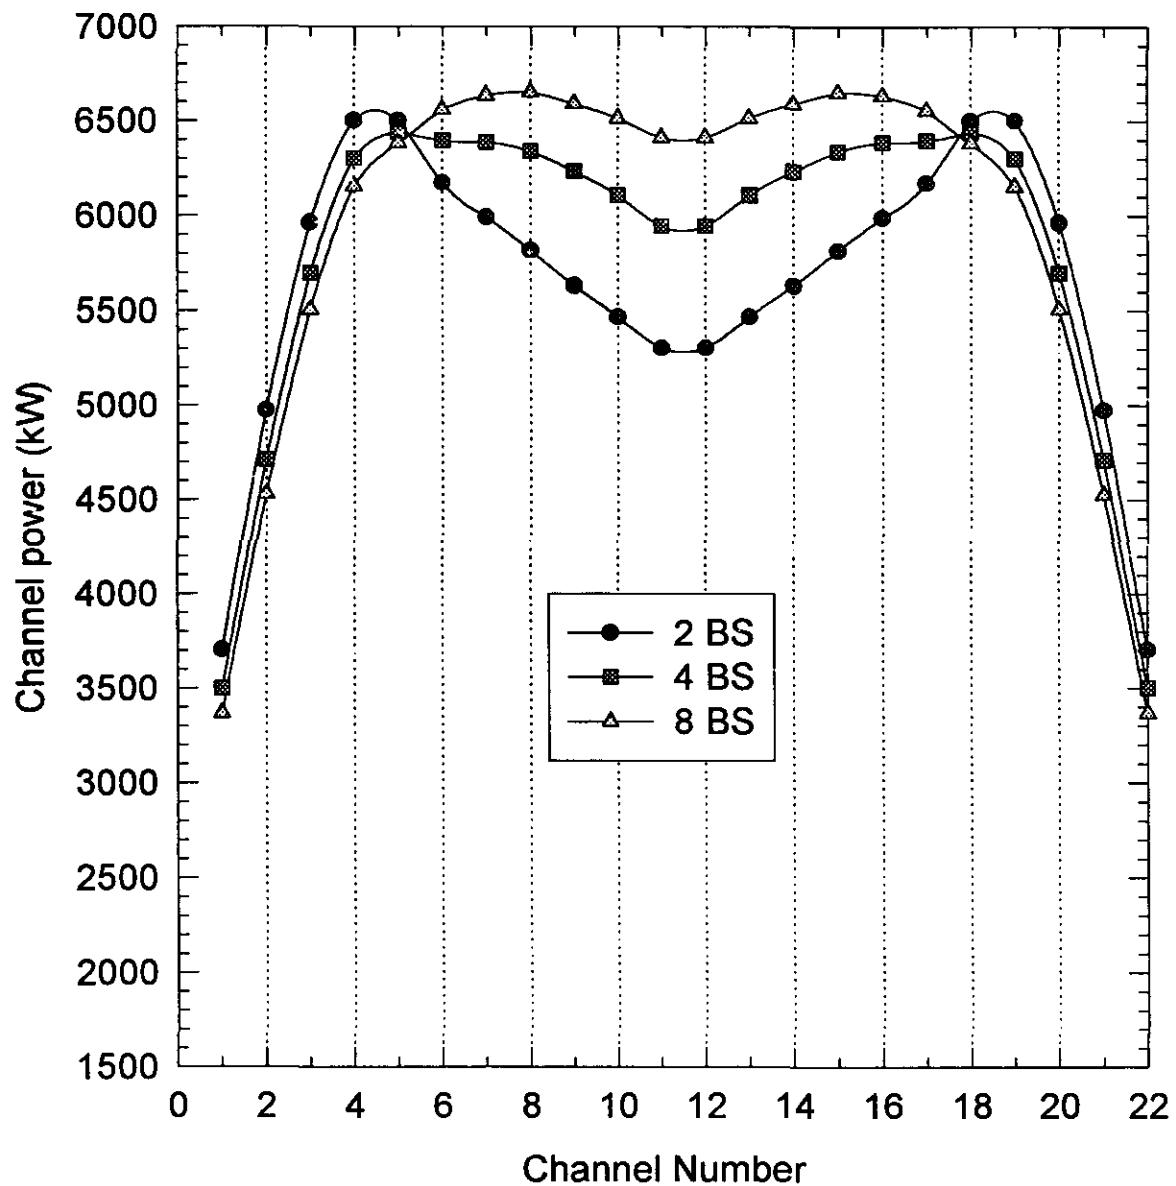

Radial Channel Power Profiles
(DUPIC, 3,5 w/o, 30 GWD/Te(U), Row L)

Conclusion

- increasing the fuel enrichment in CANDU:
 - increases burnup and reduces fueling costs
 - reduce bundle scheme to maintain CPPF within current margins
 - fueling machine utilization (refueling frequency)
- problem with 2BS and high enrichment can easily be solved:
 - relocating of rows of adjusters rods (away from central positions) will:
 - flatten axial shape and reduce peak bundle power
 - increase reactivity worth of adjusters
 - reduce avg. exit burnup (increased leakage and absorption)
 - for reactors without adjusters, use a checkerboard pattern alternating 6BS and 2BS.
- fuel management optimization requires simultaneous optimization of control poisons (adjuster grading and layout in this case)
- flexibility of CANDU fuel cycles:
 - enriched uranium
 - recovered uranium
 - Pu disposal (MOX)
 - PWR spent fuel (DUPIC)
 - thorium fuel